


http://www.koganei.co.jp





Solenoid Valves F Series





SOLENOID VALVES F SERIES F10, F15, F18 series

Contents

Features ———	2
Product Range ———	5
Energy-Saving Proposal Using the Solenoid Valve F10, F15 Series	8
Notification of Changes to the Solenoid Valves F10 and F15 Series Specifications $-$	9
Safety Precautions	13


Operating Principles and Symbols	16
Handling Instructions and Precautions	18
Manifold Unit Adding Procedure	28
eq:product Configurations for the F Series Serial Transmission Compatible Manifolds	37
Specifications of Serial Transmission Compatible Manifolds-	38

Single Valve Unit	F10,15 SERIES 44
Monoblock Manifold A Type (Base Piping Type)	
Monoblock Manifold F Type (Direct Piping Type)-	
Monoblock Manifold A Type, Wire-saving Type (Bas Monoblock Manifold F Type, Wire-saving Type (Dire	









PC Board Manifold A Type (Base Piping Type)	- 54
PC Board Manifold F Type (Direct Piping Type)	- 58
Split Manifold Non-plug-in Type F10,15 SERII	es 60 es 78
Split Manifold Plug-in TypeF10,15 SERIE F18 SERIE	ES 64 ES 82
Serial Transmission Compatible Manifold F10,15 SERI	es 68 es 86

SOLENOID VALVES F10 series ------ 105

Specifications	106
Dimentions	- 111

SOLENOID VALVES F15 SERIES	- 137
Specifications	- 138
Dimentions	- 144

SOLENOID VALVES F18 SERIES	171
Specifications	172
Dimentions	177

F Series Specifications Confirmation Form — 199

1

Solenoid Valves F Series

Environmentally friendly **RoHS** Compliant product !


The F Series is the Result of a Focus on Usability.


Single or double dual use valve

With the F series 2-position valves, you can use a manual override to select either the single solenoid valve or the double solenoid valve function.

Note: A dedicated single solenoid valve is also available.







%2-position valve (Excluding T0 type)

2 Employs dual use fittings


- Koganei's unique dual use fittings can be connected to two different types of tubes with differing outer diameters.
- No need to waste time selecting fittings based on the tube size.




3 Allows the fitting block to be changed for either base piping or direct piping

Since the direction of the fitting blocks can be changed after purchase, the user is free to change the piping direction.

(Excluding monoblock manifold F type, and PC board manifold F type)

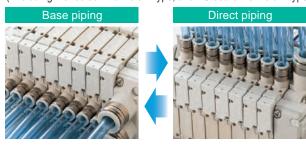

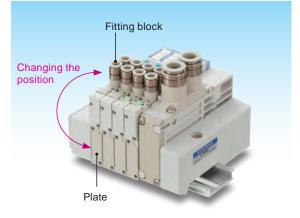




Before use, be sure to read the "Safety Precautions" on p.13.

Redesigned Solenoid Valves F10 and F15 Series!

Six characteristics make it even easier to use

More compact, lower power consumption

The newly developed solenoid valve F10 and F15 series use less power. Total length reduced by 6 mm [0.236 in.].

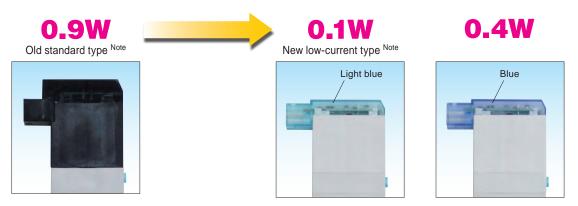


Note: With reverse current protection circuit

7 Tandem 3-port valve (4-position) has newly been added

Two 3-port valve functions in one valve body. Using F series valves as an air-operated valve or for single-acting cylinder control saves space.

Allows combined mounting with 5-port valve.

Model	4(A) side	2(B) side	Symbol
F10 🗌 TA F15 🗌 TA	Normally closed (NC)	Normally closed (NC)	12(SB) 2(B) 4(A) 14(SA)
F10 🗌 TB F15 🗌 TB	Normally open (NO)	Normally open (NO)	$12(SB) \xrightarrow{2(B)} 4(A) 14(SA)$
F10 🗌 TC F15 🗌 TC	Normally closed (NC)	Normally open (NO)	$12(SB) \xrightarrow{2(B)} 4(A) \xrightarrow{14(SA)} \xrightarrow{14(SA)} \xrightarrow{3(R2)} (P) \xrightarrow{5(R1)}$

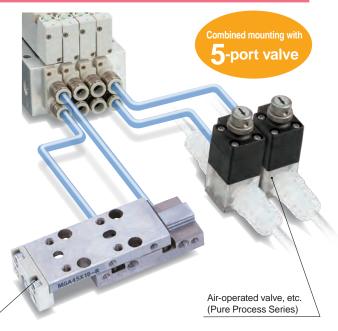

Double acting type cylinders (Mini Guide Sliders)

Wire-saving type has been added to monoblock manifold

- Wire-saving type added to monoblock manifold A and F types.
- Wiring specifications for flat cable connector and D-sub connector are available.

Connector Aluminum manifold


*Photo shows a F10 series monoblock manifold F type wire-saving type.

Stop valve (optional) has been added (Only for Monoblock Manifold)

- Enables replacement of valves without stopping operation of various devices and instrumentation lines.
- Stop valve enables the opening and closing of each unit's flow path without shutting off the main air supply.

5 Back pressure prevention valve (optional) has been added

Prevents back pressure problems caused when operating single acting cylinders, etc.

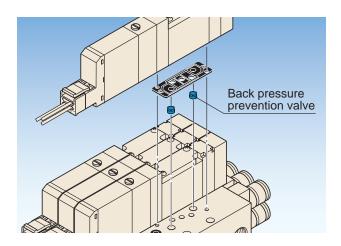



Back pressure prevention valve

Two back pressure prevention valves are mounted on the manifold side. This prevents cylinder malfunctions caused by the exhaust air from other valves.

6 Slim and compact

Monoblock manifold F type



*Photo shows F10 series.

Serial transmission type

 Transmission portion and manifold combined in a singlepiece construction.

Compatible devices with serial transmission integrated manifold

- For OMRON CompoBus/S (16 outputs)
- For CC-Link (16 outputs) For CC-Link (32 outputs) For DeviceNet (16 outputs) For DeviceNet (32 outputs) For CompoNet (16 outputs) For EtherCAT (16 outputs)
- For EtherCAT (16 outputs) For EtherCAT (32 outputs)
- NEW For EtherNet/IP (16 outputs)
- NEW For EtherNet/IP (32 outputs)



Product Range



Single Valve Unit

Solenoid Valves F15 Series





Valves can be used as single units by attaching inlet port blocks. Mounting brackets are also available.

Outlet port specifications

	With su	ıb-base		For single valve unit or manifold use								
Series	Female	thread	With fen	nale threa	ad block	With dua	al use fitti	ng block	With	single us	e fitting b	lock
Series	Rc1/8 NPT1/8	Rc1/4 NPT1/4	M5 10-32 UNF	Rc1/8 NPT1/8	Rc1/4 NPT1/4	φ4&φ6	φ6&φ8	φ8&φ10	φ4	φ6	φ8	φ10
F10												
F15												
F18								•				

With fitting block









 F10,F15
 p.44,45

 Order codes
 p.72,73


 F10
 p.111


 F15
 p.144

 F18
 p.144

Monoblock Manifold A Type (Base Piping Type)

This base piping type manifold offers easy maintenance and cost performance. Replacing the outlet block enables its use as a direct piping type manifold. Using a pre-wired common terminal plug connector greatly reduces wiring work.

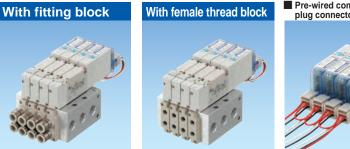




Monoblock Manifold F Type (Direct Piping Type)

The direct piping type manifold offers excellent cost performance. Using a pre-wired common terminal plug connector

greatly reduces wiring work.

With fitting block






NEW Monoblock Manifold A Type, Wire-Saving Type (Base Piping Type)

Wire-saving type of monoblock manifold A type. Wiring specifications include the flat cable connector mounting type and the D-sub connector mounting type.

Note: Not available in the F18 series.

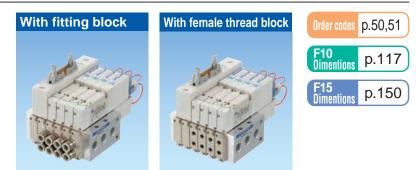

NEW Monoblock Manifold F Type, Wire-Saving Type (Direct Piping Type)

Wire-saving type of monoblock manifold F type. Wiring specifications include the flat cable connector mounting type and the D-sub connector mounting type.


Note: Not available in the F18 series.

manifold F type. e flat cable connector	With fitting block	With female thread block	Order codes p.52,53
connector mounting	1 march	Altron.	F10 Dimentions p.118
	Min B	Sin A	F15 Dimentions p.151


PC Board Manifold

A MIL type 20-pin flat cable connector is installed on the monoblock manifold to achieve both wiring savings and cost performance. Combined use of the Koganei PC wiring system and wiring specification -F201 allows for more effective wiring savings.

Note: Not available in the F18 series.

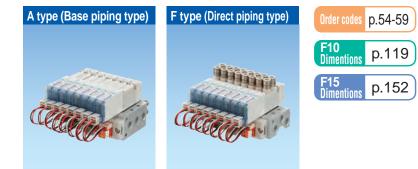


Split Manifold Non-Plug-in Type

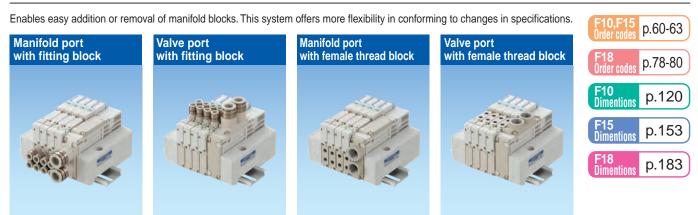

Split Manifold Plug-in Type

Manifold conforms to reducing wiring work. Adding on wiring allows adding manifold units. Combined use of the Koganei PC wiring system and wiring specification -F201 offers more effective wiring savings.

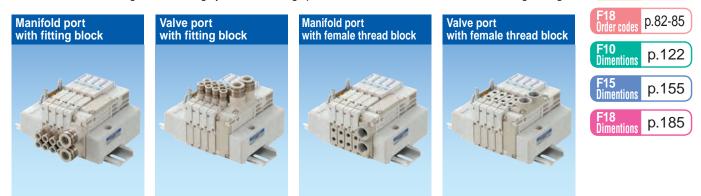

Wiring Specifications



Flat cable connector top surface (vertical) wiring type Note



Flat cable connector side surface (horizontal) wiring type Note

For the flat cable connector and D-sub connector, the no power supply terminal type is also available.



top surface (vertical) wiring type Note



D-sub connector side surface (horizontal) wiring type Note

Note: You can change the connector direction.

Caution: For the F18 series, neither the connector side surface (horizontal) wiring type nor the no power supply terminal type is available.



F10,F15

p.64-67



cable connector.

Remark: You can also select the wiring position (wiring block) for right-side mounting.

Serial Transmission Compatible Manifold



Integrated type (F10, F15 series)



Stand-alone type



- For OMRON CompoBus/S
- For CompoNet
- For DeviceNet Note
- For EtherCAT Note
- For EtherNet/IP Note

Note: Not available in the F18 series.

*For details, see p. 37-40.






For EtherCAT (F10,F15 series) For EtherNet/IP (F10,F15 series) NEW Remark: You can also select the wiring position (transmission block) for right-side mounting.

Energy-Saving Proposal Using the Solenoid Valves F10 and F15 Series

Comparison of power consumption (Reference)


With the cylinder conditions operating 5 seconds in the extended side and 5 seconds in the retraced side, and an operating time of 12 hours per day, five days per week, and 50 weeks per year, the power consumption for one year is calculated. (Annual power consumption: Power consumption per hour×12 hours×5 days×50 weeks)

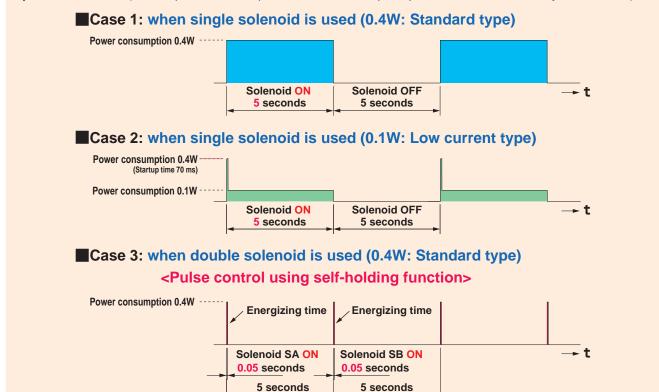

Results for calculation of power consumption under the above conditions, and power consumption graph

Solenoid	Power consumption	Energizing time (s)		Number of operations	Electric energy	Annual electric energy (kWh) and
Solenola	(W)	SA:ON	SB:ON	per hour (cycles)	per hour (Wh)	annual electric energy cost
Single solenoid (standard type)	0.4	5	-	360	0.200	0.6 [13.2 yen]
Single solenoid (low-current type)	Starting: 0.4/holding: 0.1	5	_	360	0.052	0.156 [3.43 yen]
Double solenoid (standard type)	0.4	0.05	0.05	360	0.004	0.012 [0.264 yen]

Remark: Comparison using new type solenoid 24VDC specification. Electricity charges are assumed to be 22 yen/kWh.

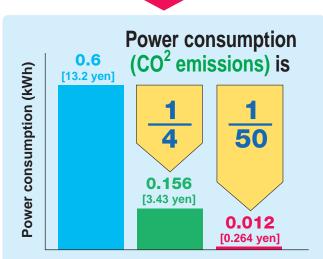

The double solenoid valve (pulse control) shows a lower electric energy result. Note that with higher operation frequency, this difference will narrow somewhat. With use of 0.1W low-current type, the power consumption is reduced to 1/4.

Furthermore,

- If pulse control is performed using a double solenoid, power consumption can be sharply reduced.
- Solenoid valves F series is single/ double dual use valves.

Since the single solenoid and double solenoid are the same price^{Note}, it also enables cost benefits.

Note: For 2-position valve. Excluding T0 type.

Notification of Changes to the Solenoid Valves F10 and F15 Series Specifications

Thank you for using our products.

Now we have undertaken to introduce some changes to the specifications of the popular Solenoid Valves F10 and F15 Series (no specification changes have been made to the Solenoid Valves F18 Series).


With these new solenoids, we have reduced both the wattage and total length of the valve. In addition, we have made the F type and serial transmission manifolds more compact.

We hope for your understanding of these changes and for your continued use in the future.

Descriptions of changes

Single valve unit

• Large reduction in power consumption and 6 mm [0.236 in.] shorter in total length while maintaining 100% mounting and wiring interchangeability with the old model.

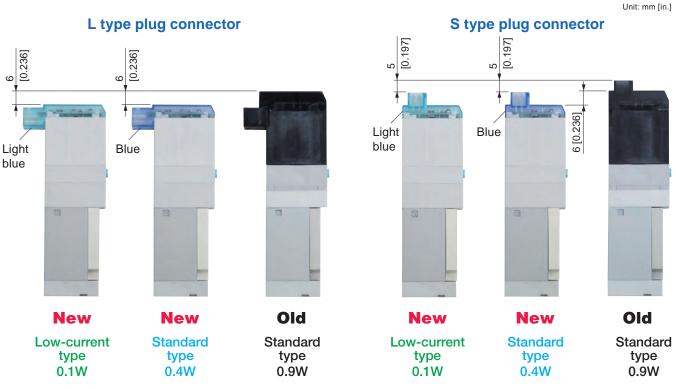

*Photo shows F10 series. (F15 series is similar.)

• High-speed circuit employed on coil circuit board to achieve faster OFF response.


• Newly designed A and B independent coils allow for optional tandem 3-port valve.

Monoblock manifold

• More compact F type manifold that eliminates PR port (collected in 5 (R1) port).


■ F10 Series (reference) mm [in.]


New F type manifold

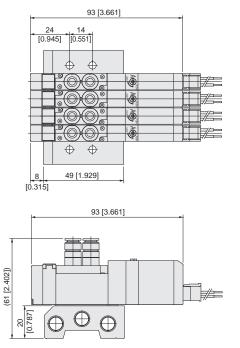


■ F15 Series (reference) mm [in.]


New F type manifold






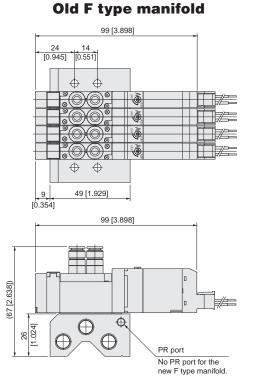

Old F type manifold






• Optional back pressure prevention valve for both the A type and F type manifolds now available.

• Optional sandwich-type stop valve now available.


• Split type manifold/serial transmission compatible manifold

- Coil portion flattened by minimizing the valve size.
- Enables selection and switching between top surface wiring and side surface wiring with flat cable connector and D-sub connector installation.
- Optional no power supply terminal type (standard type comes with power supply terminal) now available.
- More compact serial transmission device and manifold combined in single-piece construction (some models connected with flat cable).
- Optional back pressure prevention valve now available.
- Changed color of a valve base assembly cover from light blue to ivory in order to enable identification between the old type and new type. (For differentiation between new and old type, see p.12.)


■ F10 Series split manifold plug-in type (reference) mm [in.]

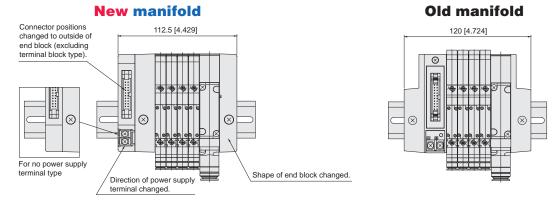

■ F15 Series split manifold plug-in type (reference) mm [in.]









■ F10 Series serial transmission compatible manifold (reference) mm [in.] New manifold Old manifold

74.3 [2.925]


Integrated type


 $(Compatible \ with \ CC-Link, \ DeviceNet, \ CompoNet, \ CompoBus/S, \ and \ EtherCAT)$





Stand alone type (flat cable connection) (Compatible with OMRON B7A Link Terminal)

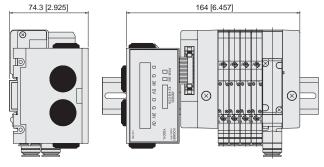

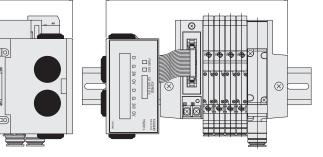


171.5 [6.752]

*While dimensions show F10 Series, the F15 Series is similar. ■ Reference photo: Valve base assembly (Photo shows F10 Series.)



Color of cover: Ivory




Color of cover: Light blue

Others

1. Changes in the monoblock manifold (aluminum manifold) gasket

Along with the back pressure prevention valve becoming an option, the gasket configuration has also been changed. Note that a new gasket type cannot be fitted onto and used on an old type manifold. When replacing a mounted valve, order an old type gasket if you need to replace the gasket of an old type manifold. (Old type gasket model for the F10 Series: **Q-F10Z-GS1**, old type gasket model for the F15 Series: **Q-F15Z-GS1**)






For old type manifold

6	
NO S	

Mounted valve	New/old type gasket	New type manifold	Old type manifold
Now type yelve	New type gasket	0	×
New type valve	Old type gasket	×	0
	New type gasket	0	×
Old type valve	New type gasket Old type gasket	×	0

Note: There is no gasket replacement for a split manifold or serial transmission compatible manifold.

2. Determining whether a monoblock manifold A type or F type, or PC board manifold A type or F type is an old type or new type




3. Connectors

New type connector (gray)



There have been no changes in shapes.

Old type manifold



Old type connector (black)



Before selecting and using the products, please read all the "Safety Precautions" carefully to ensure proper product use. The Safety Precautions described below are to help you use the product safely and correctly, and to prevent injury or damage to you, other people, and assets.

Be sure to observe these safety precautions together with the following safety regulations of ISO4414 (Pneumatic fluid power - General rules and safety requirements for systems and their components), and JIS B 8370 (General rules relating to systems).

The directions are ranked according to degree of potential danger or damage: "DANGER", "WARNING", "CAUTION" and "ATTENTION."

Indicates situations that can be clearly predicted as dangerous. Death or serious injury may result if the situation is not avoided. It could also result in damage or destruction of assets.
Indicates situations that, while not immediately dangerous, could become dangerous. Death or serious injury may result if the situation is not avoided. It could also result in damage or destruction of assets.
Indicates situations that, while not immediately dangerous, could become dangerous. Failure to avoid the situation creates the risk of minor or semi-serious injury. It could also result in damage or destruction of assets.
While there is little chance of injury, this content refers to points that should be observed for appropriate use of the product.

This product was designed and manufactured for use in general industrial machinery.

When selecting and handling equipment, the system designer or another person with sufficient knowledge and experience should always read the "Safety Precautions", "catalog", "instruction manual", and other literature before commencing operation. Improper handling is dangerous.

- After reading the instruction manual, catalog, and other documentation, always place them in a location that allows easy availability for reference to users of this product.
- Whenever transferring or lending the product to another person, always attach the catalog, instruction manual, and other information to the product where they are easily visible in order to ensure that the new user can use the product safely and properly.
- The danger, warning and caution items listed under these "Safety Precautions" do not cover all possible contingencies. Read the catalog and instruction manual carefully, and always keep safety first.

Do not use for the purposes listed below:

- 1. Medical equipment related to maintenance or management of human lives or bodies.
- 2. Mechanical devices or equipment designed for the purpose of moving or transporting people.
- 3. Critical safety components in mechanical devices.

This product has not been planned or designed for purposes that require advanced stages of safety. It could cause injury to human life.

- Do not use in locations with or near dangerous substances such as flammable or ignitable substances. This product is not explosion-proof. It could ignite or burst into flames.
- When attaching the product, always firmly support and secure them (including workpieces) in place. Dropping or falling of the product or improper operation could result in injury.
- Persons who use a pacemaker, etc., should keep a distance of at least 1 meter [3.28 ft.] away from the product. There is a possibility that the pacemaker will malfunction due to the strong magnet built into the product.
- Never attempt to modify the product. It could result in abnormal operation leading to injury, etc.
- Never attempt inappropriate disassembly, assembly or repair of the product's basic construction, or of its performance or functions. This could result in injury, electric shock, fire, etc.
- Do not splash water on the product. Spraying it with water, washing it, or using it underwater could result in malfunction of the product leading to injury, electric shock, fire, etc.
- While the product is in operation, avoid touching it with your hands or otherwise approaching too close. In addition, do not make any adjustments to the interior or to the attached mechanisms (manual override, connecting and disconnecting of wiring connectors, adjustment of pressure switches, or release or connection of piping tubes or plugs) while in operation. The actuator can move suddenly, possibly resulting in injury.

- Do not use the product in excess of its specification range. Such use could result in product breakdowns, function stop, damage or drastically reduce the operating life.
- Before supplying air or electricity to the device and before starting operation, always conduct a safety check of the area of machine operation. Unintentional supply of air or electricity could possibly result in electric shock, or in injury caused by contact with moving parts.

- Do not touch the terminal and the miscellaneous switches, etc., while the device is powered on. There is a possibility of electric shock and abnormal operation.
- Do not throw the product into fire. The product could explode and/or release toxic gases.
- Do not sit on the product, place your foot on it, or place other objects on it. Accidents such as falling or tripping over the product could result in injury. Dropping the product could result in injury, or also damage or break it resulting in abnormal or erratic operation, or runaway, etc.
- When conducting any kind of operation for the product, such as maintenance, inspection, repair, or connection/disconnection or replacement of piping, always turn off the air supply completely and confirm that residual pressure inside the product or in piping connected to the product is zero before proceeding. In particular, be aware that residual air will still be in the air compressor, vaccum pump or air storage tank. The actuator could abruptly move if residual air pressure remains inside the piping, causing injury.
- Before commencing normal operation, always release the lock of the locking type manual override, and confirm that the manual override is in the normal position and that the main valve is in the proper switching position, and only then commence the operation. Failure to do so could lead to erroneous operation.
- Always shut OFF the power before wiring operations. Wiring with the power ON could result in electric shock.
- Always apply the specified voltage to the solenoid. Applying the wrong voltage could result in failure to perform the intended function, and could damage or burn the product itself.
- Avoid scratching the cords of lead wires, etc. Letting the cords be subject to scratching, excessive bending, pulling, rolling up, or being placed under heavy objects or squeezed between two objects, may result in current leaks or defective continuity that lead to fire, electric shock, or abnormal operation.
- Do not pull out the connectors while the power is ON. Also, do not apply unnecessary stress on the connector. It could result in erratic equipment operation that could lead to personal injury, equipment breakdown, or electrical shock, etc.
- Always check the Catalog to ensure that the product wiring and piping is done correctly. Errors in wiring and piping could lead to abnormal operation of the actuators, etc.
- In the first operation after the equipment has been idle for 48 hours or more, or has been in storage, there is a possibility that contacting parts have got stuck, resulting in equipment operation delays or sudden movements. For these first operations, always run a test operation before use to check that operating performance is normal.

- In low frequency use (more than 30 days between uses), there is a possibility that contacting parts may have stuck toghter, resulting in equipment operation delays or sudden movements that could lead to personal injury. Run a test operation at least once every 30 days to confirm that movement is normal.
- For double solenoid type (excluding the Tandem 3-port valve), do not apply current through both solenoids simultaneously. It is impossible in such a situation to maintain the correct valve position, and the equipment may operate in an unintended direction, leading to the possibility of equipment breakdown or personal injury.
- Do not use the solenoid valves or the wiring that controls them, near power lines where large electrical currents are flowing, or in locations subject to high magnetic fields or power surges. Such application could lead to unintended operation.
- The solenoid valve can generate surge voltage and electromagnetic waves when the switch is turned OFF, affecting the operations of surrounding equipment. Use solenoids with surge suppression, or take countermeasures in the electrical circuits for surges or electromagnetic waves.
- Do not use the product where ozone may be generated, such as near ocean beaches or other places subject to direct sunlight or mercury lamps. Ozone can cause rubber parts to deteriorate, which can lead to degraded performance and functions, or to equipment stoppages. (Excludes items where measures against ozone have been taken.)
- Do not use any media other than shown on the specifications. Use of non-specified media could lead to functional shutdown after a short period, to sudden performance drops, or to shorter operating life.
- If mounting the solenoid valve inside a control panel, or if energizing it for long periods, provide heat radiation measures to ensure that temperatures surrounding the solenoid valve always remain within the specified temperature range. In addition, if energizing continuously over long periods, rising temperatures due to generation of heat in the coil can lead to a decline in solenoid valve performance and operating life, and have adverse effects on nearby equipment. As a result, when the solenoid valve is continuously energized over long periods of time, or when the solenoid valve is energized for longer periods than it is non-energized on any day, a good suggestion is to keep the solenoid valve in a normally open (NO) specification as one possible method of reducing the amount of time the valve is energized. For details, consult us.
- After wiring operations, always check to ensure that no wiring connection errors exist before turning ON the power.
- Do not collect the exhaust lines for air cylinders, etc. with pilot exhaust lines for solenoid valves into the same piping, etc. Interference in the exhaust could result in erratic operation.
- When using the valve in a manifold, be aware when operating an air cylinder or performing air blowing operations that back pressure could cause erratic operations of the cylinder or erroneous air delivery from the air blow port. Caution is particularly needed when using valves with 3-position exhaust center specification, when operating single acting cylinders, or when operating a cylinder and blowing air using the same manifold. If there are concerns in this area, take such countermeasures as using individual exhaust spacers or back pressure prevention valves.

- When mounting the product, leave room for adequate working space around it. Failure to ensure adequate working space will make it more difficult to conduct daily inspections or maintenance, which could eventually lead to system shutdown or damage to the product.
- For mounting or transport of heavy products, use a lift, supporting tool, or several people, to provide firm support, and proceed with due caution to ensure personal safety.
- Do not bring magnetic media, within 1 meter [3.28 ft.] of the product. There is the possibility that the data on the magnetic media will be destroyed due to the magnetism of the magnet.
- If leakage current is flowing in the control circuit, there is a possibility of the product performing an unintended operation. Take measures against current leaking in the control circuit, to ensure that the leakage current value does not exceed the allowed range in the product specifications.
- Do not block the product's breathing holes. Pressure changes occur due to changes in volume during operation. Blocking the breathing holes destroys the pressure balance, and could cause failure of the intentional operation, equipment damage, or personal injury.

- Do not use the solenoid valve in locations subject to large electrical currents or magnetic fields. It could result in erratic operation.
- Oily materials from the compressor (excluding the oil-free compressor) can cause drastic deterioration in product performance, and even a functional shutdown. Always install a mist filter before pneumatic equipment to remove the oily component.
- The properties of the lubrication oil can change when used in dry air where dew point temperatures is lower than -20°C [-4°F]. It could result in degraded performance or in functional shutdown.
- Do not use the product in locations that are subjected to direct sunlight (ultraviolet ray), to dust, salt, or iron powder, high temperature, high humidity or in media or ambient atmospheres that include organic solvents, phosphate ester type hydraulic oil, sulfur dioxide, chlorine gas, acids, etc. It could lead to an early shutdown of some functions or a sudden degradation of performance, and result in reduced operating life. For materials used, see Major Parts and Materials.
- Always carefully wash your hands after touching oil or grease used in the valves. If you smoke a cigarette while there is oil or grease remains on your hands, oil or grease transferred to the cigarette could catch fire and emit toxic gases.

- When considering the possibility of using this product in situations or environments not specifically noted in the Catalog or Instruction Manual, or in applications where safety is an important requirement, such as in an airplane facility, combustion equipment, leisure equipment, safety equipment and other places where human life or assets may be greatly affected, take adequate safety precautions such as application with enough margins for ratings and performance or fail-safe measures. Be sure to consult us with such applications.
- Always check the Catalog and other reference materials for product wiring and plumbing setup.
- Install a muffler, etc. on the exhaust port. It is effective in reducing exhaust noise.
- When handling the product, wear protective gloves, safety glasses, safety shoes, etc. to keep safety.
- When the product can no longer be used or is no longer needed, dispose of it appropriately as industrial waste in accordance with the Waste Disposal and Public Cleaning Law, and other ordinances and regulations imposed by local government authorities. As incineration disposal of oil or grease used in the valves will generate corrosive, toxic hydrofluoric acid (HF), dispose of these compounds in an acid-resistant incinerator with toxic removal facilities. For large volumes, use a registered industrial waste disposer.
- Pneumatic equipment can exhibit degraded performance and function over its operating life. Always conduct daily inspections of the pneumatic equipment, and confirm that all requisite system functions are satisfied, to prevent accidents from happening.
- Air leaks from the valve are not zero. For application of requiring holding pressure (including vacuum) inside the pressure vessel, consider adequate margin of capacity and holding time in design of the system.
- When using a valve for air blowing, use an external pilot specification. With the internal pilot specification, air blowing can cause a pressure drop that could affect valve operations.
- For inquiries about the product, consult your nearest Koganei sales office, or Koganei overseas department. The address and telephone number is shown on the back cover of this catalog.

- Always observe the following items.
 - 1. When using this product in pneumatic systems, always use genuine KOGANEI parts or compatible parts (recommended parts).
 - When conducting maintenance and repairs, always use genuine KOGANEI parts or compatible parts (recommended parts). Always observe the required methods and procedure.
 - Do not attempt inappropriate disassembly or assembly of the product relating to basic configurations, or its performance or functions.

Koganei cannot be responsible if these items are not properly observed.



General Precautions

Mounting

- **1.** While any mounting direction is allowed, be sure to avoid strong shocks or vibrations applied directly to the body.
- 2. Avoid using in the locations and environment listed below, as it could result in malfunction of the valve. If use in such conditions is unavoidable, always provide a cover or other adequate protective measures.
 - Location directly exposed to water drops or oil drops
 - Environment where a valve body is subject to dew condensation
 - Location directly exposed to machining chips, dust, etc
- In piping connection with valves, flush the tube completely (by blowing compressed air) before piping. Intrusion of machining chips or sealing tape, rust, etc.,
 - generated during plumbing could result in air leaks and other defective operations.
- **4.** Never use the valve with the 4(A) and 2(B) ports vented to the atmosphere.
- **5.** When mounting a valve inside a control panel, or when energizing time is long, make adequate consideration for ventilation and other heat dissipation measures.
- **6.** When adding or subtracting units in the manifold, or replacing a fitting block, be sure to tighten to within the specified tightening torque range.

Media

- 1. Use air for the media. For the use of any other media, consult us.
- 2. Air used for the cylinder should be clean air that contains no deteriorated compressor oil, etc. Install an air filter (filtration of 40 μm or less) near the valve to remove collected liquid or dust. In addition, drain the air filter periodically.
- **3.** When supply pressure is low, use piping for the 1(P) port with sufficient tube size.

Lubrication

Can be used without lubrication due to the factory lubricant (grease). When the pneumatic products require lubrication, use Turbine Oil Class 1 (ISO VG32) or the equivalent. In addition, cutting off oil feed while an operation is in progress could lead to malfunction due to the dissipation of the factory lubricant (grease). As a result, always keep the oil feed running continuously. However, use caution since excessive oil feed can also be a cause of malfunction. Avoid using spindle oil or machine oil.

Atmosphere

The product cannot be used when the media or ambient atmosphere contains any of the substances listed below. Organic solvents, phosphate ester type hydraulic oil, sulphur dioxide, chlorine gas, or acids, etc.

Wiring


After wiring, check that there is no error in the wiring connections.

Piping

Since the 1(P), 3(R2), and 5(R1) ports are on both ends of the manifold, piping direction can be selected depending on the application (in monoblock manifolds).

At shipping, plugs are temporarily screwed in ports at one end, but are not firmly tightened. Regardless of which end piping is connected, always remove the plugs, use sealing tape or apply other sealing agent, and securely tighten the plugs into the unused ports.


- 1. Sealing tape wrapping method
- ⁽¹⁾Before piping, perform air blowing (flushing) or cleaning to eliminate any machining chips, cutting oil, or dust, etc., remaining inside the pipes.
- ②When screwing in piping or fittings, caution should be taken to avoid letting machining chips or sealing materials from entering into the valves. When using sealing tape, wrap it so that $1.5\sim2$ screw threads remain.




Prevention of erratic operation in the manifold type

When using a manifold-type valve to operate an air cylinder, or to perform air blowing or similar operations, erratic operation due to exhaust interference or malfunction due to insufficient flow rate could occur. When using the manifold type valves, be sure to take the following measures beforehand.

- 1. Erratic operation due to large exhaust flow rate
 - Cause: When a large-bore cylinder is operating, or multiple cylinders are operating at the same time, the exhaust air in the collective exhaust can flow backward through the exhaust ports of other solenoid valves. This could lead to an obstruction of the operations of other cylinders and may cause erratic operation in single acting cylinders or an Air Hand module due to inflow of air into them. The erratic operation is caused by insufficient manifold exhaust (large exhaust resistance).
 - Countermeasure: To reduce the exhaust resistance, for the base monoblock manifold, vent the exhaust ports at both ends. For the split manifold, attach piping blocks to both ends to exhaust from both sides. If still affected even after exhausting from both ends, consider splitting the manifold, or if using a split manifold, either install a port isolator to separate the exhaust, or use a back pressure prevention valve.
- 2. Malfunctions due to insufficient pressure or flow rate
 - Cause: When operating a large-bore cylinder, operating multiple cylinders at the same time, or using circuits to perform air blowing, etc., sudden consumption of air with the manifold type can result in insufficient flow rate to nearby cylinders, causing a reduction in speed or a shortage of thrust. In addition, in the pilot-type valve, this sudden consumption can lead to a pressure shortage for the pilot signals, and it causes erratic operations in the main stem.
 - Countermeasure: Because it causes insufficient air delivery to the manifold, supply air from both ends of the manifold, or from the piping block 1(P) port mounted on both sides. For air blowing, consider either dividing the air lines for independent use, or use of an external pilot valve.

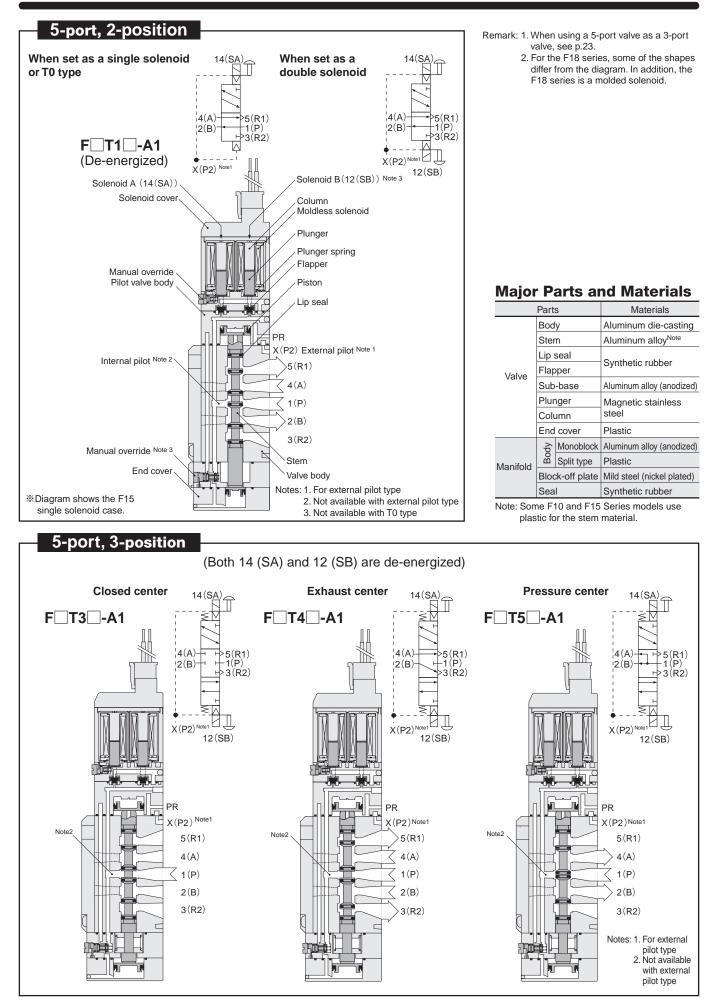

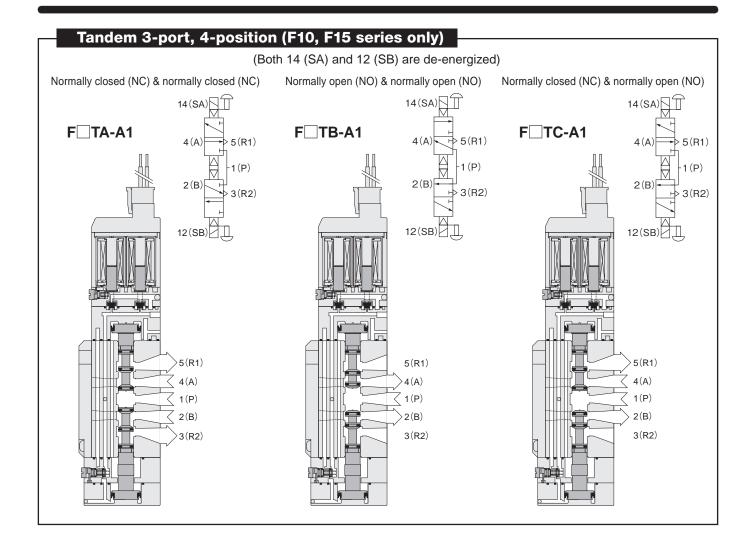



Solenoid

Single and double solenoid switching procedure

By switching the manual override, model $F \Box T1$ (2-position value) can be used as either a single solenoid valve or a double solenoid valve (switching not possible with a 3-position valve and a tandem 3-port valve). Note that the **FT1** is set to the single solenoid specification at shipping.

Switching from a single solenoid valve to a double solenoid valve

- 1.As shown in Fig.1, insert the flatblade edge of a small screwdriver into the gap between the valve and the cover, and then peel it off and remove the cover.
- Caution: As shown in Fig.1, make sure to insert a small screwdriver from the side of the valve cover. The cover claw may be damaged when the cover is removed from the direction of the valve stem. Never remove the cover for any reason other than valve function switching.
- 2.As shown in Fig.2, use a small screwdriver, etc. to turn the manual override on the B side by 90 degrees in the counterclockwise direction, so that the manual override button's slit is horizontal, as shown on the right side of the figure. Then the unit can be used as a double solenoid valve. When using it as a double solenoid valve, the button is used as the manual override button for the B side

Caution: When using it as a double solenoid valve, do not attach the cover that was removed in Fig. 1.


Switching from a double solenoid valve to a single solenoid valve

As shown in Fig.3, use a small screwdriver, etc. to push lightly against the manual override button, and then turn it by 90 degrees in the clockwise direction, so that the manual override button's slit is in the vertical direction, and then attach the cover.


Caution: The cover has directionality (F15 and F18 series only). When attaching, always align the detent on the back of the cover with the manual override button's slit, as shown in Fig.4.

Note about the wiring for the above switching

See the "Wiring instructions" to the right. End cover







Push lightly, then turn the manual overrride button clockwise to set as the single solenoid Manual override button $\langle \rangle \rangle B$ Double solenoid state Single solenoid state The manual override button is protruding. Г Figure 3 Cover (Back face)





Figure 4

Wiring instructions (When used as a single unit, non-plug-in type manifold)

1. Attaching and removing plug connector

Use fingers to insert the connector into the pin, push it in until the lever claw latches onto the protruded section of the connector housing, and complete the connection.

To remove the connector, squeeze the lever along with the connector, lift the lever claw up from the protruded section of the housing, and pull it out. Housing



Cautions: 1. When removing the connector, confirm that the lever claw is positively disengaged from the protruded section before pulling out. The housing may be damaged if it is pulled out while engaged with the protruded section.

- 2. The plug connector lead wires for model F
 T1 (2-position valve) are set to the single solenoid specification at shipping (for plug connector types).
- When switching from a single solenoid to a double solenoid specification for use, disconnect the plug connector from the valve, check the hook directions on the lead wire (white) with the con tacts, and then insert the lead wire into the plug connector's B side \square hole (see the illustration above). Use the same procedure to switch the manifold type single solenoid to a double solenoid specification.

3. When using the plug-in type manifold, caution should be exercised that even if the valve has been switched to a double solenoid, no power will be supplied to the B side solenoid unless the valve base wiring is set to the double wiring.


2. Attaching and removing plug connector and contact

Attaching

Insert the contact with a lead wire into a plug connector \Box hole until the contact hook latches on the connector and is secured to the plug connector. Confirm that the lead wire cannot be easily pulled out (see the diagram below).


Removing

To remove it, insert a tool with a fine tip (such as a small screwdriver) into the rectangular hole on the side of the plug connector to push down on the hook, and then pull out the lead wire. When re-using the contacts, restore the hook back so that they spread outward.




3. Common terminal and short bar

A short bar is attached to the plug connector to ensure that the solenoid A and B wiring are positive common. Do not remove the short bar.



4. Crimping of lead wire and contact

To crimp lead wires into contacts, strip off 4 mm [0.16 in.] of the insulation from the end of the lead wire, insert it into the contact, and crimp it. Be sure to avoid catching the insulation on the exposed wire crimping section.



Cautions: 1. Do not pull hard on the lead wire.


For crimping of lead wire and contact, always use a dedicated tool.

Contact: Model 706312-2MK Manufactured by Sumiko Tech, Inc. Crimping tool: Model F1 (for 706312-2MK) Manufactured by Sumiko Tech, Inc.

5.F10, F15 Common connector assembly

Using a common connector assembly for solenoid valves for a manifold provides common wiring for all the solenoid valves and greatly reduces wiring work.


The common connector assembly types are determined by looking at them from the lead wire side; the right end one is A type, the left end one is C type, and all the others are B type (see Fig. 5). (see the illustration below).

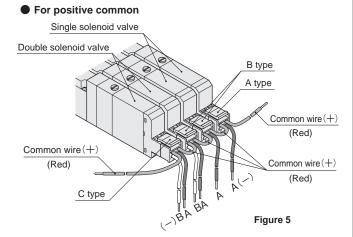


For negative common (F10, F15 series only) Note


In the new F10, F15 series, you can order the separately sold common connector assembly for use with negative common specification.

Note: Cannot be used with the conventional F10, F15 series.

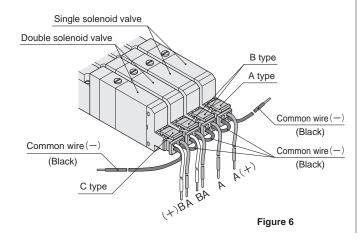

If ordering the common connector assembly, order from the common connector assemblies listed below.

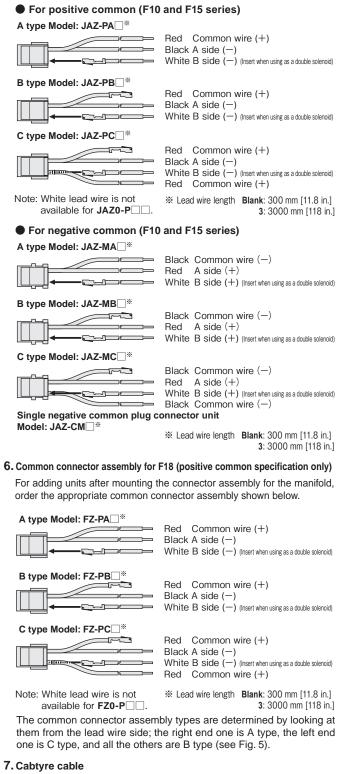




Caution: Exercise caution that this is not dust-proof and drip-proof specification.


Internal circuit


For F10, F15 Series

Positive common

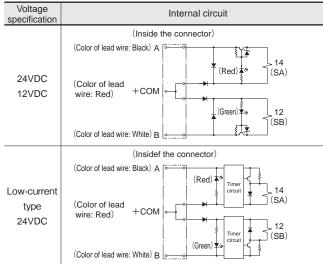


Negative common (-129W)

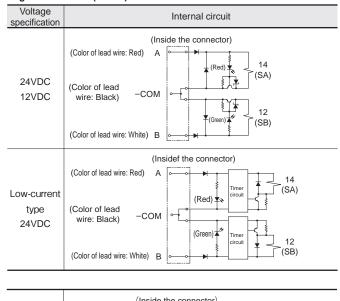





•For F18 Series

Positive common

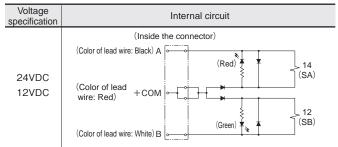

Negative common (-129W)

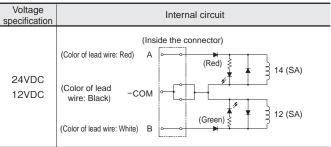


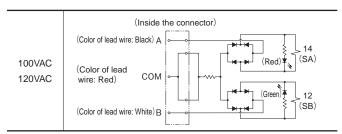

Cautions: 1. Do not apply megger between the pins.

- 2. Leakage current inside the circuit could result in failure of the solenoid valve to return, or in other erratic operation. Always use at less than the allowable leakage current shown in the solenoid specifications on p.106, 138, and 172, If circuit conditions etc. cause the leakage current to exceed the allowable leakage current, consult us.
- **3.** For the double solenoid specification, avoid energizing both solenoids at the same time (except for tandem 3-port valve).
- 4. For the housing color, standard type is blue and low-current type is light blue (F18 is black).
- 5. The low-current type will not operate if the power voltage is gradually increasing. Always apply a suitable voltage.
- 6. For the T0 type, there is one solenoid.

•For F15, 18 Series DIN connector type

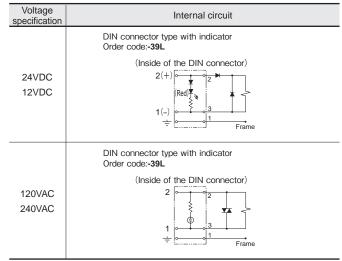


Cautions: 1. Do not apply megger between the pins.

- 2. Leakage current inside the circuit could result in failure of the solenoid valve to return, or in other erratic operation. Always use at less than the allowable leakage current shown in the solenoid specifications on p.139, and 173. If circuit conditions etc. cause the leakage current to exceed the allowable leakage current, consult us.
- **3.** For the double solenoid specification, avoid energizing both solenoids at the same time.

PC board manifold

When connecting a power line to the power supply terminal on the PC board manifold, care should be taken in regard to the following points when connecting.



Terminal screw tightening torque: $0.4 \text{ N} \cdot \text{m} [3.5 \text{ in} \cdot \text{lbf}]$ Stripped wire length: 7 mm [0.28 in.] Connecting wire size: $0.13 \sim 2.5 \text{ mm}^2 [0.00020 \sim 0.00388 \text{ in}.^2]$ AWG: No.26...14

When planning to use crimp-style terminals, use bar terminals. Recommended crimp-style terminals (bar terminals): Manufactured by Nichifu, Inc. Model BT1.25-9-1 (for 0.25~1.65 mm² [0.00039~0.00256 in²])

Wiring of the terminal block




Care should be taken with the terminal screw tightening torque. Overtightening beyond the tightening torque could result in breakage.

Terminal screw tightening torque: Max. 49.0 N \cdot cm [4.3 in \cdot lbf].

Operating principles for the low-current type

The low-current type uses a timer circuit, as shown on the previous page, that achieves power consumption savings by switching to a holding operations mode after a certain period of time to operate at about 1/4 of the starting power consumption.

Power waveform



Precautions for use of the double solenoid

When using models $F\Box T1$ or $F\Box T2$ (2-position valve) as double solenoid valves, caution should be exercised as energizing the A side solenoid or pushing the manual override button on the A side, while pushing the B side manual override button or in a locked state, or energizing the solenoid on the B side, will cause the valve to switch over the valve position. (At that time, the valve will operate in the same state as the single solenoid valve.)



Manual override

Manual override button (locking and non-locking dual use type)


To lock the manual override, use a small screwdriver to push down the manual override button all the way down and turn it clockwise 90 degrees. To release the manual override, turn the button 90 degrees counterclockwise, which will release the manual override lock by spring action and return it to its normal position. To operate the unit in the same way as the non-locking type, leave the manual override button unturned.

- **Cautions:1.** The F series valves are pilot type solenoid valves. As a result, the manual override cannot switch the main valve without air supplied from the 1(P) port (X(P2) port for external pilot type).
 - 2. Always release the lock of the manual overrides before commencing normal operation. Caution should be exercised to release the lock of the manual override on the B side that also works as the switching button between the single solenoid and double solenoid (excluding the 3-position valve and tandem 3-port valve). For details, see "Switching from a double solenoid valve to a single solenoid valve" on p.18.
 - Do not attempt to operate the manual override button with a pin or other object having an extremely fine tip. It could damage the manual override button.
 - Take care to avoid excessive turning of the manual override button, it could damage the override.
 - 5. When operating the solenoid valve's manual override button for maintenance etc. always confirm that the solenoid valve's override button has been restored to its normal position, and that the main valve is in the required switching position before restarting operations.

Manual override lever (locking and non-locking dual use type)


To lock the manual override lever, use fingers to push the lever all the way down and turn it clockwise 90 degrees. To release the manual override, turn the lever 90 degrees counterclockwise, which will release the manual override lock by spring action and return it to its normal position. To operate the unit in the same way as the non-locking type, leave the lever unturned.

- $\label{eq:Caution: Model F_T1 (2-position valve) has a manual override lever on the A side, and a manual override button with cover on the B side.$
 - Model $F\Box T2$ has a manual override lever on the A side only, and a manual override button on the B side.
 - The 3-position valve has manual override lever on both the A and B sides.

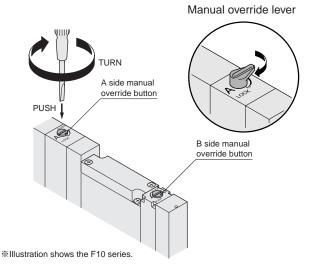

Locking protruding type -83

Use a small screwdriver or the fingers to press down and rotate the manual override button by at least 45 degrees, to lock in place. Either rotation direction is acceptable. In the locked position, rotate further the manual override which will release the manual override lock by spring action and return it to its normal position. If the manual override is not rotated, the unit can be operated in the same way as the non-locking type.






DIN connector

Wiring instructions

Remove the cover mounting screws, and lift the terminal cover off from the solenoid. Use a screwdriver, etc., to push strongly against the terminal body through the hole of the terminal cover's mounting screw, and remove the terminal body.

Slip a cable ground, washer, and cable gasket over a cable, insert the cable into the terminal cover's wiring port, and connect the lead wire to the terminal body (screwdriver blade width of about 3 mm [0.12 in]).

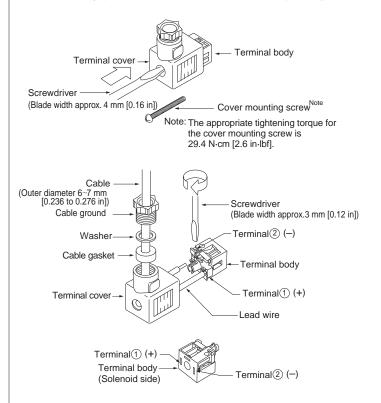

**For the DC24V solenoid with surge suppression, connect (+) to terminal ①, and (-) to terminal ②.




3-port valves

While the F series is a 5-port valve (excluding tandem 3-port valve), it can be used as a normally closed (NC) or normally open (NO) 3-port valve by plugging one of either outlet port 4(A) or 2(B). In this case, leave the exhaust ports 3(R2) and 5(R1) open for use. It can also be used as a double solenoid type 3-port valve.


When using a single use fitting block or female thread block for 3-port In the F10 and F15 series, a single use fitting block and female thread

block for 3-port with one plugged port can be selected at the time of order. (Note: Not available for F18 series.)

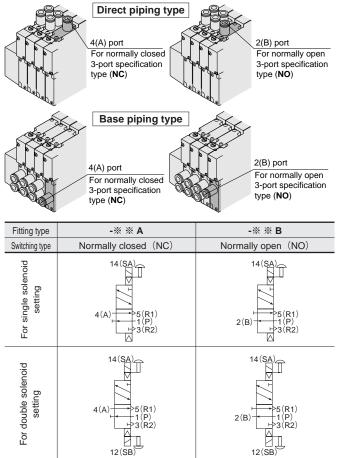

When using a plug


The F10, F15, and F18 series can be used as either a normally closed (NC) or normally open (NO) 3-port valve by plugging either outlet port of 4(A) or 2(B).

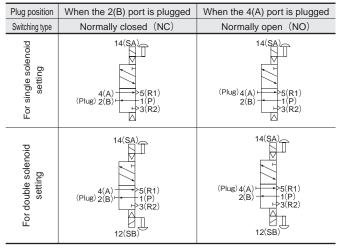



Attaching and removing valves

To remove the valve body from the sub-base or manifold, loosen the valve mounting screws (2 places), and lift it up in the direction of the arrow (see the illustration at right). To install it, reverse the above procedure. The recommended tightening torques for the valve mounting screws are as shown below.



N·cm [in·lhf]

*Illustration shows the F10 series (split manifold).

Series	Recommended tightening torque
F10	17.6 [1.6]
F15	49.0 [4.3]
F18	49.0 [4.3]

Precautions for using manifold

Observe the following precautions when using the split type and serial transmission compatible manifold (except for the monoblock manifold and PC board manifold).


- When using the direct piping type manifold
- Avoid using valves at an operating frequency exceeding 2 Hz, as such use can result in heat-related breakdowns.
- When using the base piping type manifold

When plugs have been attached on the 4(A) and/or 2(B) ports, avoid using valves at an operating frequency exceeding 2 Hz, as such use can result in heat-related breakdowns.

Stop valve usage procedure (F10, F15 series)

Mount a stop valve on a manifold to stop the air supply to valves on the individual station. For the operation procedure, use a small screwdriver or the hand to press down and rotate the stop valve manual knob clockwise 90 degrees to lock in place, shutting off the air supply. In the locked position, rotate the stop valve manual knob counterclockwise 90 degrees, and air pressure returns the stop valve manual knob to its original position, releasing the lock. Note that use of the stop valve reduces the flow rate volume by about 30%.

Stop valve manual knob





Stop valve manual knob is locked, and air supply shut off.

Cautions: 1. Do not disassemble the stop valve.


- 2. When using a stop valve to remove the valve, be careful of residual pressure in the affected station.
 - 3. When using a stop valve to remove the valve, be aware that exhaust from other stations can be exhausted through the stop valve's exhaust hole. If this will cause a problem during use, when ordering the manifold, select the back pressure prevention valve (-E1).
 - 4. To use a stop valve in combination with a back pressure prevention valve, select the combination when ordering the manifold. The back pressure prevention valve (F1 Z-E1) in additional parts cannot be installed after purchase.
 - 5. Do not release the locked stop valve manual knob when valves have been removed by using the stop valve.

Port isolator

In the split manifold, installing port isolators to the 1(P), 3(R2) and 5(R1) ports between each station isolates the air path between stations equipped with port isolators and stations with smaller station numbers. However, a piping block must be placed on both ends.

Port isolator for the 1(P) port (Model : F Z-SP)	 Can supply two different pressures
Port isolators for	Can isolate exhaust air
the 3(R2), 5(R1) ports (Model : F□Z-SR)	(prevents exhaust interference)
Port isolators for	Can supply two different pres-
the 1(P), 3(R2), 5(R1)	sures, and can isolate exhaust air
ports	(prevents exhaust interference)
(Model : FZ-SA)	

%□ denotes valve size.

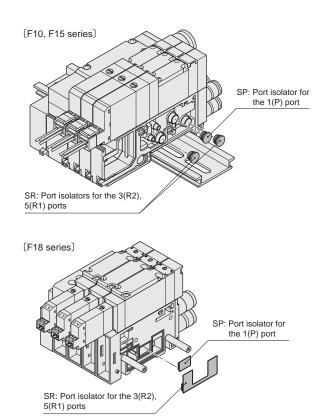

Caution: Installing port isolators requires the disassembly and re-assembly of manifolds. See the disassembly illustration, unit adding procedure, and cautions on p.28-33.

However, since the F18 series serial transmission compatible manifold cannot be disassembled, port isolators cannot be installed on it after purchase.

Precautions for the use of individual air supply and exhaust spacers

By mounting an individual air supply or exhaust spacer on the manifold, the air supply or exhaust can be operated individually on the unit. It is also effective in preventing erratic operation due to back pressure. Caution should be exercised when spacers are used, as the effective area is reduced by about 30%. If mounting additional spacers to an existing unit, observe the following items:

Spacer mounting procedure (F10 series)


- Loosen the valve mounting screws where the individual air supply or exhaust spacer will be installed, and remove the valve.
- ② Install the gaskets and exhaust valve provided with the individual air supply or exhaust spacer, and use the mounting screws provided to secure the valve on the manifold (see Fig. 7).
- Remark: When attaching fittings to the F10 spacer, use the recommended fittings shown below:
 - TSH4-M5M, TSH4-M5, TSH6-M5M, TS4-M50, TS4-M5M

Spacer mounting procedure (F 15 and F18 series)

- ① Loosen the valve mounting screws where the individual air supply or exhaust spacer will be installed, and remove the valve.
- ② Open the cover of the manifold, and pull out the plug-in connector in the near side direction (for the plug-in type) (see Fig. 8).
- ③ Insert the plug-in connector firmly into the connector attaching section of the individual air supply or exhaust spacer, and then close the cover, while watching to ensure that the lead wires are not caught by the cover (for the plug-in type) (see Fig. 9).
- ④ Attach the gasket and exhaust valve provided with the individual air supply or exhaust spacer, and use the mounting screws provided to mount the valve on the manifold.
- Cautions: Locations where the spacers are mounted make the valve height higher by the height of the spacer (see the dimensions below).


Muffler for the individual exhaust spacer

A muffler for the individual exhaust spacer is available. For dimensions, see p.133, 166, and 196.




• Dimensions Unit: mm [in.]


F10Z-N (For F10 series) Mass 7 g [0.25 oz.]




F15Z-N (For F15 series) Mass 26 g [0.92 oz.]




F18Z-N (For F18 series) Mass 41 g [1.45 oz.]




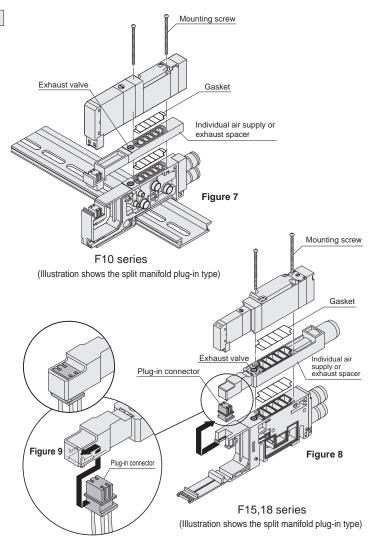


F10Z-P (For F10 series) Mass 9 g [0.32 oz.]



F15Z-P (For F15 series) Mass 29 g [1.02 oz.]




F18Z-P (For F18 series) Mass 44 g [1.55 oz.]




Precautions for use of the back pressure prevention valve (F10, F15 series)

A back pressure prevention valve can be mounted on the manifold to prevent erratic operation of the cylinder due to exhaust from other valves. It is particularly effective when using a single acting cylinder or when using an exhaust center valve. Note that when a back pressure prevention valve is used, the OUT-EXH flow rate volume is reduced by as much as 30%. In addition, since the back pressure prevention valve allows back pressure leaks, be careful to avoid letting the manifold exhaust port throttle the exhaust air. When mounting the back pressure prevention valve on an existing system, observe the following points.

- 1 Loosen the valve screws mounting the back pressure prevention valve, and remove the valve.
- ② For a monoblock manifold, temporarily remove the gasket between the valve and manifold, insert the back pressure prevention valve into the exhaust port, attach

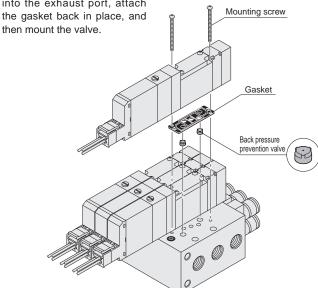


For a split type manifold, insert the back pressure prevention valve into the exhaust port, attach the dedicated gasket and plate provided, and then mount the valve.

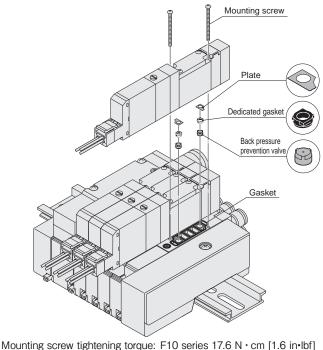

F15 series 49.0 N · cm [1.6 In·lbf]

Changing the connector bracket direction (F10, F15 series)

Remove the wiring block mounting screws, position the connector bracket as shown in the illustration, and rotate the connector 90 degrees so that it faces outward. The connector can be changed to either the top surface (vertical) wiring or side surface (horizontal) wiring positions.



Mounting screw tightening torque: 49 N·cm [4.3 in·lbf]

Securing the manifold in place

When securing a DIN rail mounting type manifold to the installation surface, use the number of screws table below as a guide, depending on the installation direction and with or without vibration, to secure the DIN rail in place using screws. If not secured in place, be aware that there is a possibility of air leaks or other problems occurring.

Mounting condition	Number of screws			
Horizontal mounting		2 screv	vs or more	
Vertical mounting or	2 to 5 units	6 to 10 units	11 to 15 units	16 to 20 units
vibration area	2 screws or more	3 screws or more	4 screws or more	5 screws or more



Fitting

Piping

1. Procedure for switching between the base piping type and the direct piping type

Base piping and direct piping can be switched by replacing the plate with a fitting block or a female thread block (see Fig. 10).





Figure 10

*Illustration shows the F10 series.

- Cautions: 1. Firmly tighten the screws after completing a re-combination. Recommended tightening torques are shown below.
 - Perform piping carefully in regards to the locations of each connection port (see Figs. 11, 12).
 - 3. Care should be taken not to lose the gaskets while changing plates.

	N∙cm [in lbf]
Series	Recommended tightening torque
F10	17.6 [1.6]
F15	49.0 [4.3]
F18	49.0 [4.3]


Direct piping type

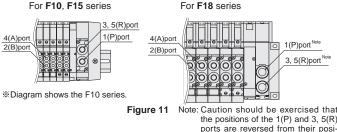

Base piping type



tions in the F10 and F15 series



*Diagram shows the F10 series.

2. Attaching fittings to female thread blocks

When attaching fittings to female thread blocks, secure with the tightening torques shown below or less.

Screw size	Tightening torque N·cm [in·lbf]
Rc 1/8, NPT1/8	686 [60.7]
Rc 1/4, NPT1/4	882 [78.1]

% For M5 and -10-32UNF, tighten at the recommended torques for the fittings used.

3. Attaching fittings to piping blocks [F18Z(G)-PM(P)]

To attach fittings to the female thread type piping block of the F18 series, remove the piping block portion (the triangular-shaped block portion), screw the fittings into the 1(P) and 3, 5(R) ports while holding the piping block by applying a wrench to its metal portion. The tightening torque for the mounting (two M3 screws) of the piping block after the fittings have been attached should be 49.0 N \cdot cm [4.3 in \cdot]bf].

Dual use fittings (With dual use fitting blocks)

The F series dual use fitting blocks employ dual use fittings for different tube sizes, which can connect tubes of 2 different outer diameters.

Attaching and removing tubes

When connecting tubes, insert an appropriate size tube until it contacts the tube stopper, and then lightly pull it to check the connection.

For tube removal, push the tube against the tube stopper, then for large tube sizes, push on the release ring and at the same time pull the tube out. For small tube sizes, push on the outer ring by pressing the release ring and simultaneously pull the tube out (see Fig. 13).




Figure 13

Usable tubes

Either a nylon or urethane tube can be used.

Use tubes with an outer diameter tolerance within \pm 0.1 mm [0.004 in.] of the nominal diameter, and ensure the ovalness (difference between the large diameter and small diameter) is 0.2 mm [0.008 in.] or less. (Using a Koganei tube is recommended.)


Cautions: 1. Do not use extra-soft tubes since their pull-out strength is significantly reduced.

- Only use tubes without scratches on their outer surfaces. If a scratch occurs during repeated use, cut off the scratched portion.
- 3. Do not bend the tube excessively near the fittings. The minimum bending radii for nylon tubes are shown in the table below.
- When attaching or removing tubes, always stop the air supply. In addition, always confirm that air has been completely exhausted from the manifold.

		unu [nu]
Tube size	Minimum bending radius	
φ4	20 [0.8]	
φ6	30 [1.2]	
φ8	50 [2.0]	
φ 10	80 [3.1]	

mm [in]

F10 and F15 Series Disassembly Diagram of Split Manifold Non-Plug-in Type

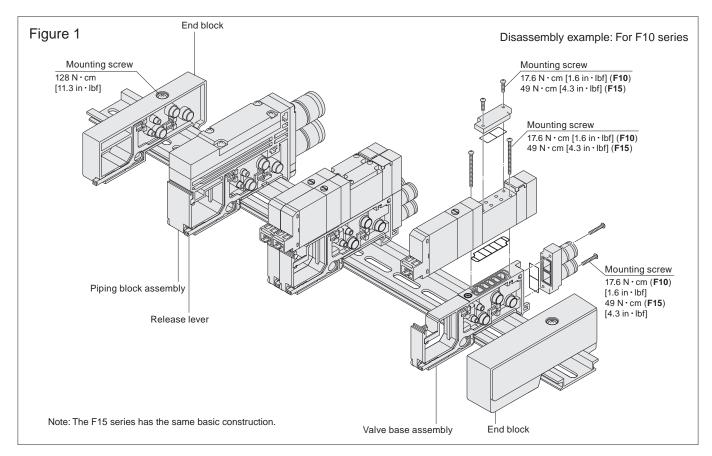

Manifold Unit Adding Procedure (F10 and F15 Series Non-Plug-in Type)

Adding a valve base unit


Use the valve base assembly for adding valve base units.

- 1 Loosen the mounting screw on the end block until it can slide (see Fig. 1).
 - Note: For the F15 series, loosen the mounting screws on both the left and right end blocks (2 screws each).
- ② Press the release lever on the valve base assembly where the new unit is to be added, and disconnect the link between the bases.
- (3) Mount the valve base assembly to be added on the DIN rail as shown in Fig. 2.
- ④ Return the release lever of the valve base assembly disassembled in step ② to its normal position, as shown in Fig. 3. In addition, set the release lever for the valve assembly being added to the same position, then press the bases together until they connect and click into place.
- (5) Press the bases together from both sides to ensure that there is no gap between them, and then tighten the end block mounting screws, and install the units in place on the DIN rail (see Fig. 5). Tightening torque: 128 N·cm [11.3 in·lbf]
 - Notes:1. Always follow the steps shown in Fig.4 when tightening the end block mounting screws for the F15 series.
 - 2. Confirm that the DIN rail mounting hooks secure the DIN rail (see Fig. 5).


[Caution]

- Always cut off the power and air supply before working. In addition, always confirm that air has been completely exhausted from the manifold.
- Care should be exercised to prevent the gasket from becoming caught or lost.
- Before supplying air to the manifold, always confirm that the bases are connected, the end block mounting screws are tightened, etc. Supplying air when either of the end blocks is not secured to the DIN rail could result in air leaks or in separation of manifold bases.
- When there are a large number of valves simultaneously delivering air to the secondary side, or when there are a large number of valves overall, we recommend using 2 air supplies and exhausts (on each side).

Adding units to the piping block assembly should be performed in the same way as adding units of the valve base assembly.

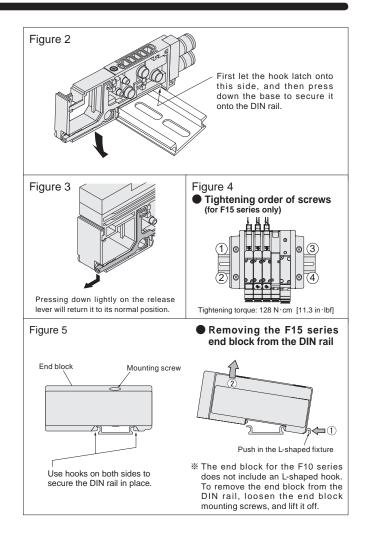

F18 Series Disassembly Diagram of Split Manifold Non-Plug-in Type

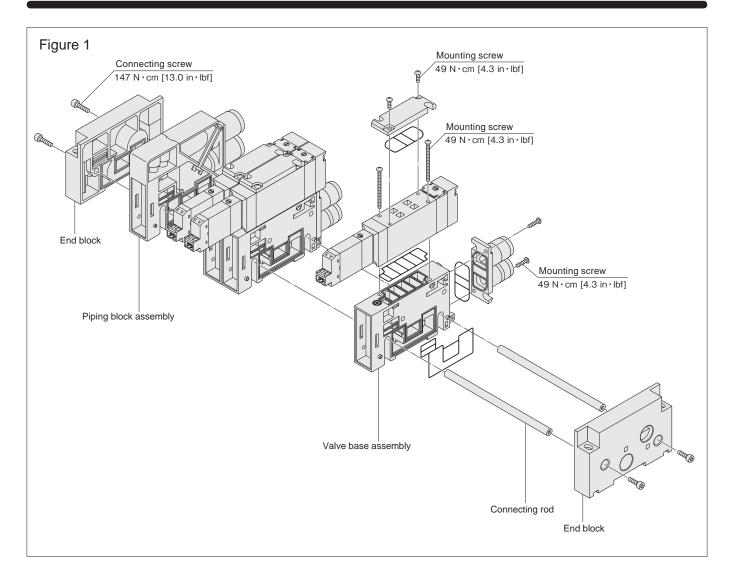

Manifold Unit Adding Procedure (F18 Series Non-Plug-in Type)

Adding a valve base unit

Use the valve base assembly and unit-adding connecting rod to add valve base units.


- ① Remove the connecting screws on the end block and separate the end block from the manifold (see Fig. 1).
- ② Install the connecting rods to be added, open up the spaces where the units are being added, position the gaskets onto the valve base assemblies being added, and fit the units on the connecting rods from above. At this time, securely mount the units so that no gap is left between the added valve base assemblies and the upper surface of the connecting rods.
- ③ Install gaskets onto the end blocks removed in step ①, and retighten the connecting screws. At this time, use a hexagon bar wrench to hold the connecting screws on the opposite side in place so as to prevent the screws from slipping while securing them into place. Tightening torque: 147 N ⋅ cm [13.0 in ⋅ lbf]

[Caution]

- Always cut off power and air supply before working. In addition, always confirm that air has been completely exhausted from the manifold.
- Care should be exercised to prevent the gasket from becoming caught or lost.
- Before supplying air to the manifold, always confirm that the bases are securely connected, the end block connecting screws on both sides are tightened, etc. Supplying air when either of the end blocks is not secured to the DIN rail could result in air leaks or in separation of manifold bases.
- When there are a large number of valves simultaneously delivering air to the secondary side, or when there are a large number of valves overall, we recommend using 2 air supplies and exhausts (on each side).

Adding units to the piping block assembly should be performed in the same way as adding units to the valve base assembly.

F10 and F15 Series Disassembly Diagram of Split Manifold Plug-in Type

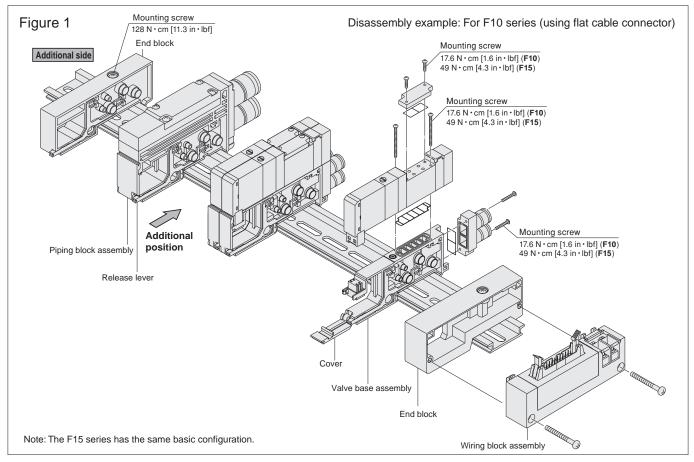


Manifold Unit Adding Procedure (F10 and F15 Series Plug-in Type)

Adding a valve base unit

Use the valve base assembly for adding valve base units.

- 1 Loosen the mounting screw on the end block until it can slide (see Fig. 1).
 - Note: For the F15 series, loosen the mounting screws on both the left and right end blocks (2 screws each).
- ② Add units on the additional side (with the solenoid on top and its right) shown in Fig. 1. To split up at additional unit locations, push the piping base assembly's release lever, and release the connections between the bases.
- (3) Mount the valve base assembly to be added on the DIN rail as shown in Fig. 2.
- ④ Return the release lever of the piping block assembly disassembled in step ② to its normal position, as shown in Fig. 3. Set the release levers on the additional valve bases in the same position, and press all the bases together until they click into place, while watching to ensure that the lead wires are not caught by the cover.
- (5) Press the bases together from both sides to ensure that there is no gap between them, and then tighten the end block mounting screws, and install the units in place on the DIN rail (see Fig. 5). Tightening torque: 128 N·cm [11.3 in·lbf]
 - Notes: 1. Always follow the steps shown in Fig. 4 when tightening the end block mounting screws for the F15 series.
 - 2. Confirm that the DIN rail mounting hooks secure the DIN rail (see Fig. 5).

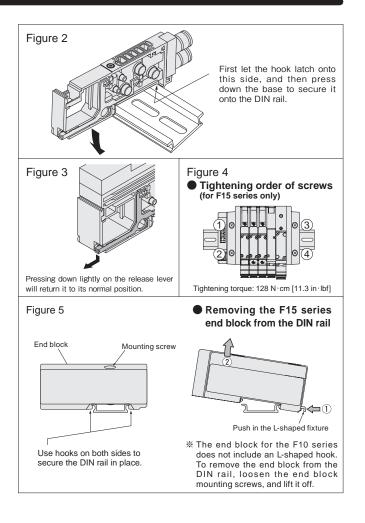

Wiring Procedure

- Use a flatblade screwdriver to open all of the covers (see Fig. 1). Loosen the mounting screws of the valve next to the valve base to be added, remove the valve, and remove the plug-in connector (see Fig. 6).
- ② The end terminal lead wire (short red wire) is inserted into the pin insert section (No.3) of the plug-in connector that was removed in step ① (see Fig. 7).

(When shipping, end terminal lead wire is inserted into the plug-in connector of the end unit valve.) Remove this end terminal lead wire, and insert it into the insert section (No.3) of the plug-in connector for the valve base assembly to be added. Next, insert the common wire (red) of this plug-in connector into the insert section (No.3) of the removed plug-in connector.

Note: When inserting the lead wire, confirm that the short bar of the plugin connector's common wire insert section has been attached.


- ③ Install each of the wired plug-in connectors in step ② to the valve base, and mount the valve.
- ④ Remove the wiring block mounting screws and place the connector bracket in the position shown in Fig. 8, then connect the lead wire (white) of the added valve base after confirming the pin locations. (For details, see the "Detailed diagram of wiring block internal connections" on p.34, 35)
- (5) Return the connector bracket to its original position, tighten the wiring block mounting screws in place, and then install the cover while exercising caution that the lead wires are not trapped by the cover.


[Caution]

- Always cut off the power and air supply before working. In addition, always confirm that air has been completely exhausted from the manifold.
- When removing lead wires from the plug-in connector, use a tool with a fine tip (such as a small screwdriver) to press lightly on the contact hook from a hole on the side of the plug-in connector, and pull out the lead wire. When re-inserting the lead wire to the connector, spread the contact hooks so that they face outward, and then insert the lead wire into the plug-in connector. At this time, pull the lead wire lightly to confirm that it is securely inserted.
- Always connect the end terminal lead wires (see Fig. 7).
- Care should be exercised to prevent the gasket from becoming caught or lost.
- Before supplying air to the manifold, always confirm that the bases are connected, the end block mounting screws are tightened, etc. Supplying air when either of the end blocks is not securing the DIN rail could result in air leaks or in separation of manifold bases.
- Caution should be exercised as the number of valve units that can be added is limited in the manifold, by the wiring specifications and wiring connection types, etc. For details, see the "Table for maximum number of valve units by wiring specification," on p.66.
- When there are a large number of valves simultaneously delivering air to the secondary side, or when there are a large number of valves overall, we recommend using 2 air supplies and exhausts (on each side).

Adding units to the piping block assembly should be performed in the same way as adding units to the valve base assembly. In addition, when the wiring block and piping block are mounted sideby-side, always mount the wiring block on the outside of the piping block, for structural reasons.

Valve tightening torque		torque N·cm [in·
	Series	Torque
	F10	17.6 [1.6]
	F15	49.0 [4.3]

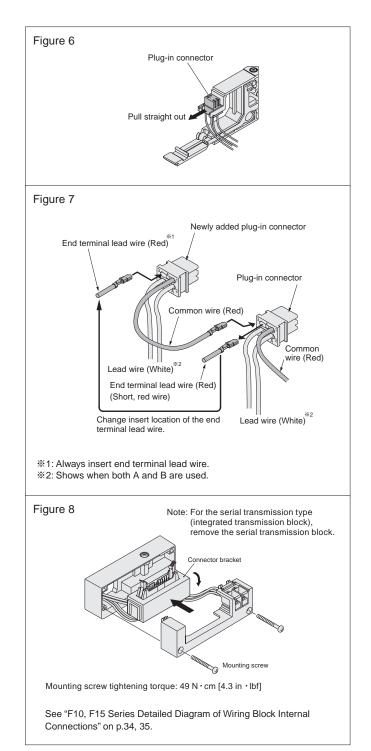

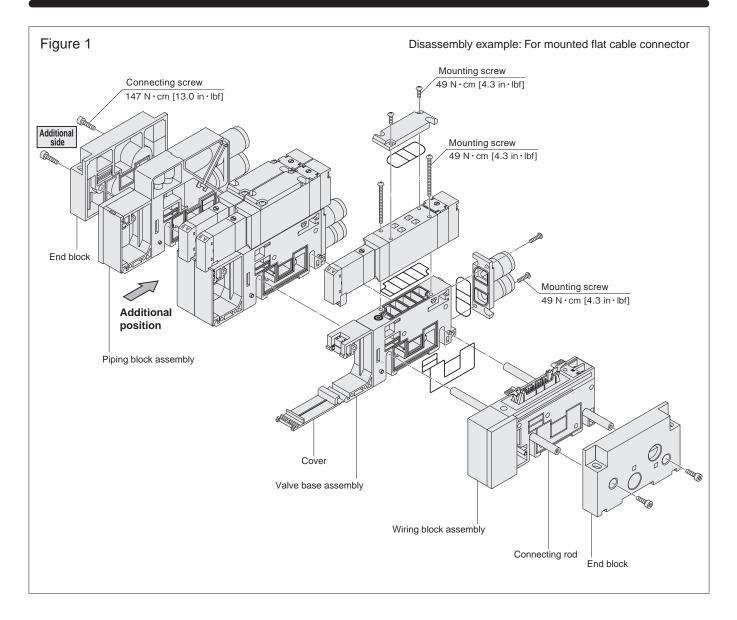

Manifold Unit Adding Procedure (F18 Series Plug-in Type)

Adding a valve base unit

Use the valve base assembly for adding valve base units.

- 1 Remove the connecting screws on the additional side end block and separate the end block from the manifold (see Fig. 1).
- ② Install the connecting rods to be added, open up spaces where the units are being added, position the gaskets onto the valve base assemblies being added, and fit the units on the connecting rods from above. At this time, securely mount the units so that no gap is left between the added valve base assemblies and the upper surface of the connecting rods.
- ③ Install gaskets onto the end blocks removed in step ①, and retighten the connecting screws. At this time, use a hexagon bar wrench to hold the connecting screws on the opposite side in place so as to prevent the screws from slipping while securing them into place. Tightening torque: 147 N ⋅ cm [13.0 in ⋅ lbf]

Wiring Procedure

- Use a flatblade screwdriver to open all of the covers (see Fig. 1). Loosen the mounting screws of the valve next to the valve base to be added, remove the valve, and remove the plug-in connector (see Fig. 2).
- ② The end terminal lead wire (short red wire) is inserted into the pin insert section (No.3) of the removed plug-in connector that was removed in step ① (see Fig. 3).

(When shipping, end terminal lead wire is inserted into the plug-in connector of the end unit valve.) Remove this end terminal lead wire, and insert it into the insert section (No.3) of the plug-in connector for the valve base assembly to be added. Next, insert the common wire (red) of this plug-in connector into the insert section (No.3) of the removed plug-in connector.

Note: When inserting the lead wire, confirm that the short bar of the plugin connector's common wire insert section has been attached.

- ③ Install each of the wired plug-in connectors in step ② to the valve base, and mount the valve.
- ④ Remove the wiring block mounting screws and place the connector bracket in the position shown in Fig. 4, then connect the lead wire (white) of the added valve base after confirming the pin locations (For details, see the "Detailed diagram of wiring block internal connections" on p.36, 37).
- (5) Return the connector bracket to its original position, tighten the wiring block mounting screws in place, and then install the cover while exercising caution that the lead wires are not trapped by the cover.

[Caution]


- Always cut off the power and air supply before working. In addition, always confirm that air has been completely exhausted from the manifold.
- When removing lead wires from the plug-in connector, use a tool with a fine tip (such as a small screwdriver) to press lightly on the contact hook from a hole on the side of the plug-in connector, and pull out the lead wire. When re-inserting the lead wire to the connector, spread the contact hooks so that they face outward, and then insert the lead wire into the plug-in connector. At this time, pull the lead wire lightly to confirm that it is securely inserted.
- Always connect the end terminal lead wire (see Fig. 3).
- Care should be exercised to prevent the gasket from becoming caught or lost.
- Before supplying air to the manifold, always confirm that the bases are connected, the end block connecting screws on both sides are tightened, etc.


Supplying air when either of the end blocks is not securing the DIN rail could result in air leaks or in separation of manifold bases.

- Caution should be exercised as the number of valve units that can be added is limited in the manifold, by the wiring specifications and wiring connection types, etc. For details, see the "Table for maximum number of valve units by wiring specification," on p.84.
- When there are a large number of valves simultaneously delivering air to the secondary side, or when there are a large number of valves overall, we recommend using 2 air supplies and exhausts (on each side).


Adding units to the piping block assembly should be performed in the same way as adding units to the valve base assembly. In addition, when the wiring block and piping block are mounted sideby-side, always mount the wiring block on the outside of the piping block, for structural reasons.


Valve tightening	torque N·cm [in·lbf]
Series	torque
F18	49.0 [4.3]

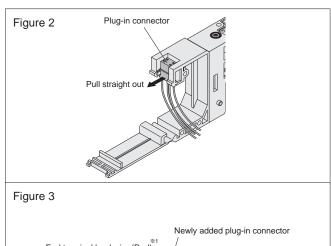






%1: Always insert end terminal lead wire.%2: Shows when both A and B are used.

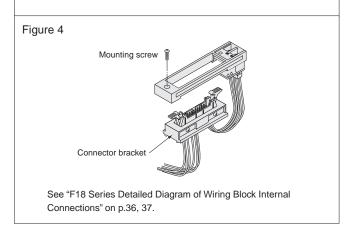


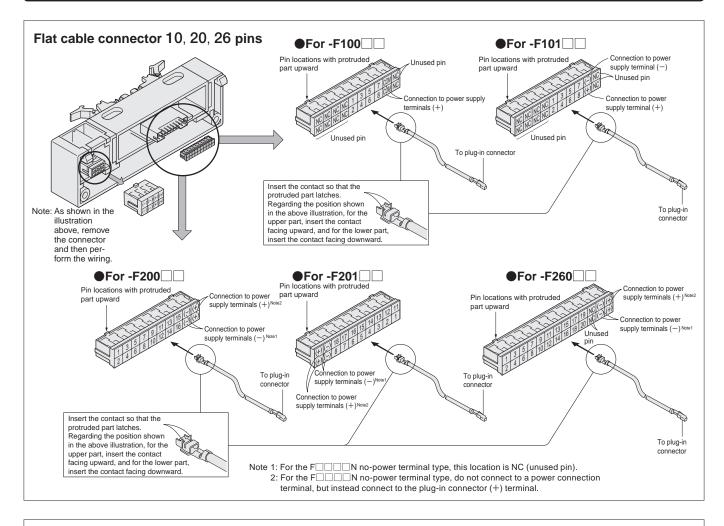


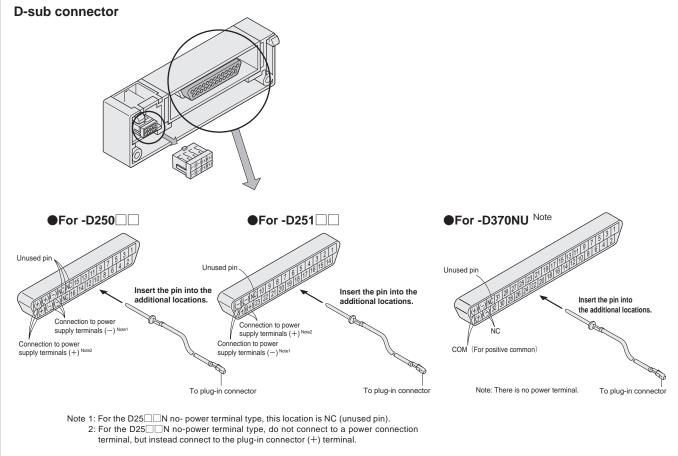

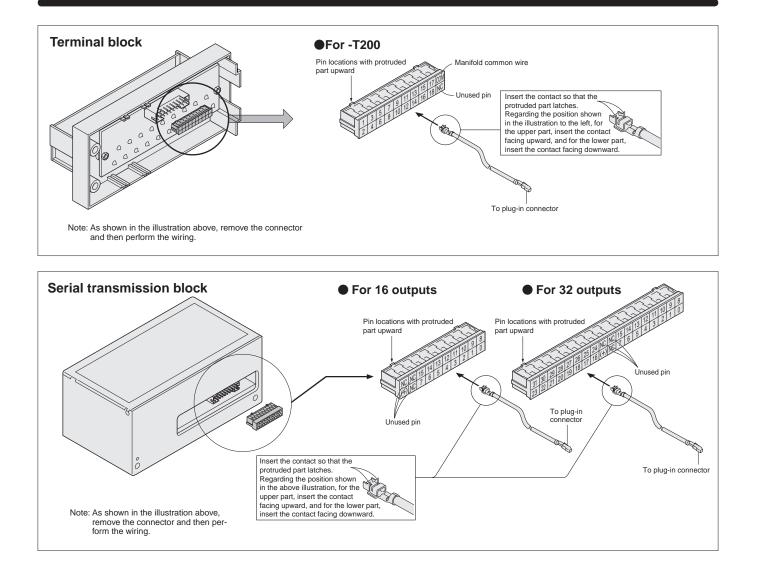

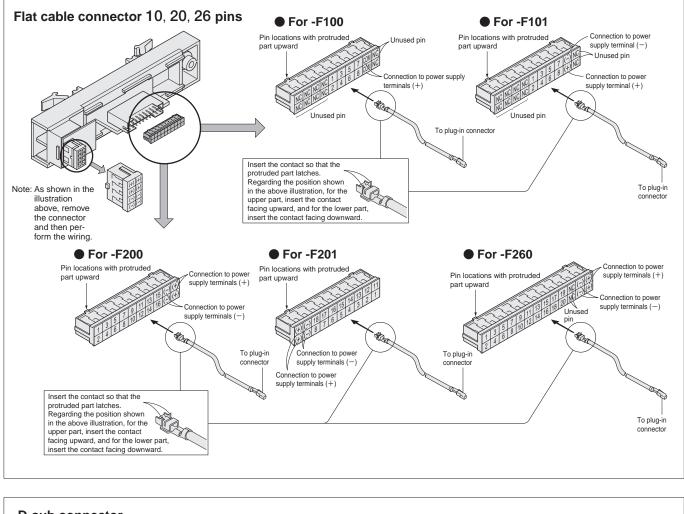

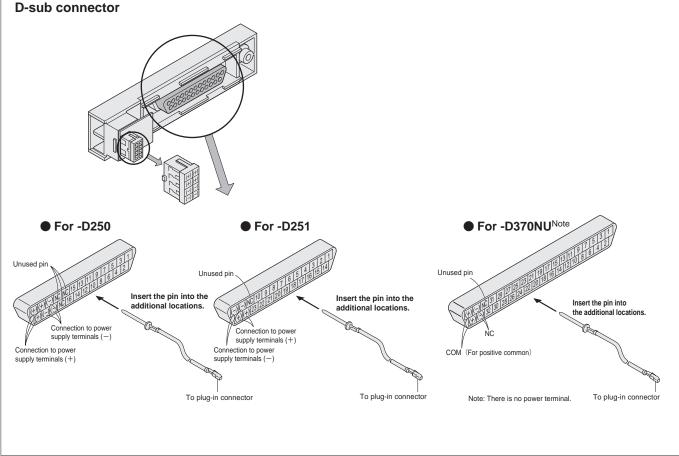

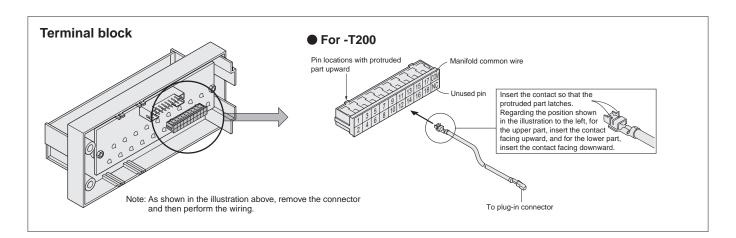


Product Configurations for the F Series Serial Transmission Compatible Manifolds

When ordering the serial transmission compatible manifold, note that the product configurations vary between the F10 and F15 series, and the F18 series.

■ For F10 and F15 series

Models compatible with integrated transmission block


- For Omron CompoBus/S
- For CC-Link
- For DeviceNet
- For CompoNet
- For EtherCAT

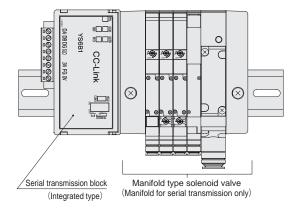

■ For F18 series

Models compatible with integrated transmission block


- For Omron CompoBus/S
- For CompoNet
- For CC-Link



Models for stand-alone transmission block

The manifold body and serial transmission block are connected with a flat cable.


• For Omron B7A Link Terminal

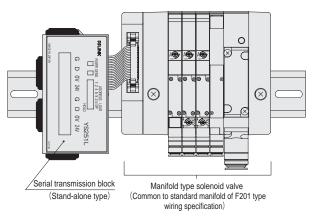

Models for stand-alone transmission block The manifold body and serial transmission block are

connected with a flat cable.

For Omron B7A Link Terminal

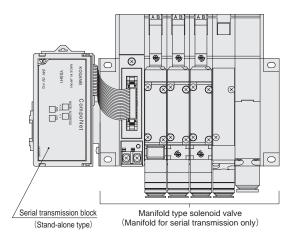

F10, F15 Series Specifications of Serial Transmission Compatible Manifolds

General Specifications

Voltage	24VDC ±10%
Operating temperature range	5~50°C [41~122°F]
Vibration resistance	49.0 m/s ² [5G]
Shock resistance	98.1 m/s ² [10G]

• For details about specifications, see each user's manual (see below)

F10, F15 Series Serial Transmission Block, Terminal Block (LED) Part Names

For OMRON B7A Link Terminal


For OMRON CompoBus/S

Transmission block specification: -31 (standard type), -32 (high-speed type) Transmission block specification: -A1 (16 outputs)

Dip switches for various settings

For CC-Link

Transmission block specification: -B1 (16 outputs) Dip switches for various settings



LED indicator

Indicator	Description
PW	 Lights up when power is turned on
L RUN	 Lights up when normal data is received from master station
SD	 Lights up during sending data
RD	 Lights up during receiving data
L ERR.	 Lights up during transmission errors, and shuts off when time is over Lights up due to station number setting error or transmission speed setting error

Remarks

- *Conforms to CC-Link.


 Number of outputs per block
 16 solenoids (transmission block specification: -B1) *Since the block occupies 1 station, if remote I/O stations

are entirely composed of the blocks, a maximum of 64 units can be connected to 1 master station

Related materials: User's manual, document No.BK-HV041

For CompoNet

Transmission block specification: -H1 (16 outputs)



LED indicator

Indicator	State	Color	Description
	Lights up	Green	 Normal state
MS	Lights up	Red	Serious breakdown
IVIS	Flashing	Red	Minor breakdown
	Shuts off	-	Power OFF/In preparation
NS	Lights up	Green	Online/Access state
	Flashing	Green	Online/No-access state
	Lights up	Red	Serious communication fault
	Flashing	Red	 Minor communication fault
	Shuts off	-	Power OFF/In preparation

Remarks

*Conforms to CompoNet.

- Number of outputs per block
- 16 solenoids (transmission block specification: -H1)
- Related materials: User's manual, document No.BK-HV043
- %The communication connector is sold by Omron Corporation. Direct your inquiries to Omron.

LED indicator Indicator Description

Output selecting switch in faulty operation

PWB	•Lights up when power is turned on
	•Lights up when power is turned on
ERR	•Lights up during faulty transmission

Remarks

OFF HOLD

• 0	on	ne	ect	ior	n me	etho	d:	1 to	1	
										T

(Transmission block spec.)	Standard type (-31)	High-speed type (-32)
Transmission delay time	Max. 31 ms	Max. 5 ms
Transmission distance	Max. 500 m [1640 ft]	Max. 100 m [328 ft]

%For details of B7A Link Terminal, see the OMRON catalog, user's manual, etc.
 Number of outputs per block


Maximum of 16 solenoids Error output specifications Output type: NPN open collector

Rated load voltage: 24VDC

Output current: Sink current MAX. 40 mA Related materials: User's manual, document No. BK-HV038

For CC-Link

Transmission block specification: -B3 (32 outputs) Transmission speed setting switch Station number setting switches



DB DG SLD

LED Indic	ator
Indicator	Description
PW	 Lights up when power is turned on
L RUN	•Lights up when normal data is received from master station
SD	 Lights up during sending data
RD	 Lights up during receiving data
L ERR.	•Lights up during transmission errors, and shuts off when time is over Lights up due to station number setting error or transmission speed setting error


Remarks

38

*Conforms to CC-Link.

KOGANEI

- Number of outputs per block 32 solenoids (transmission block specification: -B3)
- Since the block occupies 1 station, if remote I/O stations are entirely composed of the blocks, a maximum of 64 units can be connected to 1 master station
- Related materials: User's manual, document No.BK-HV041



LED indicator

	ator		
Indicator	State	Color	Description
PWR	Lights up	Croon	 During power supply
PWR	Shuts off	Green	 Power not supplied
COMM	Lights up	Yellow	During normal communication
COIVIIVI	Shuts off		Communication fault, or standby
EBB	Lights up	Ded	Communication fault occurred
CUR	Shuts off	Red	During normal communication, or standby

Remarks


*For details of CompoBus/S, see the OMRON catalog, user's manual, etc.

Number of outputs per block

- 16 solenoids (transmission block specification: -A1)
- Related materials: User's manual, document No.BK-HV040

For DeviceNet

Transmission block specification: -D1 (16 outputs), -D3 (32 outputs) Dip switches for various settings



LED indicator

	ator		9 = 0
Indicator	State	Color	Description
	Lights up	Green	 Normal state
	Flashing	Green	 No setting state
MS	Lights up	Red	 Serious breakdown
	Flashing	Reu	 Minor breakdown
	Shuts off	_	 No power supply
NS	Lights up	Green	Communication connection completed
	Flashing	Green	No communication connection
	Lights up	Red	 Serious communication fault
	Flashing	Reu	 Minor communication fault
	Shuts off	_	 No power supply

Remarks


*Conforms to DeviceNet.

Number of outputs per block

- A maximum of 16 solenoids
- (transmission block specification: -D1)
- A maximum of 32 solenoids
 - (transmission block specification: -D3)
 - Related materials: User's manual, document No. BK-HV042

EtherCAT Compliant

Transmission block specifications: -K1 (16 outputs), -K3 (32 outputs)

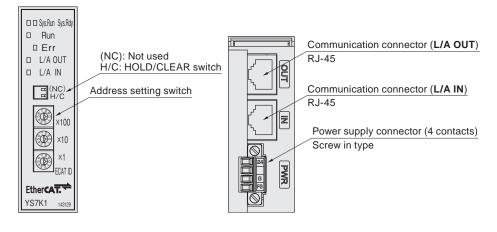

LED indicator

Indicator	State	Color	Description	
	Lit/Not lit	Green/yellow	 Transmission block operation normal 	
Sys.Run/Sys.Rdy	Flashing/flashing	Green/yellow	Transmission block initialization	
Sys.Run/Sys.Ruy	Not lit/lit or flashing	Green/yellow	Transmission block error	
	Not lit/Not lit	Green/yellow	Transmission block power OFF	
	Off	Green	• INIT	
Run	Flashing (blinking)	Green	PRE-OPERATIONAL	
Run	Flashing (single flash)	Green	SAFE-OPERATIONAL	
	Lighted	Green	OPERATIONAL	
	Off	Red	No error	
Err	Flashing (blinking)	Red	Invalid setting	Remarks
EII	Flashing (single flash)	Red	Unrequested change in status	*EtherCAT compliant.
	Flashing (double flash)	Red	Communication disconnect	1
	Lighted	Green	Normal communication	Number of outputs for this block
L/A OUT L/A IN	Flashing	Green	EtherCAT frame sending/receiving	Number of solenoids for -K1 is 16 and for -K3 is 32.
EA IN	Off	Green	Not connected	•F10 and F15 series are supported

Remarks

* EtherCAT. is a registered trademark for patented technology licensed from Beckhoff Automation GmbH of Germany.


•See the separate user's manual No. BK-HV044 for details about specifications and handling.

•We recommend category 5 (100BASE-TX) or higher twisted paired cables (CAT 5e STP) for communication cables.

•You can download the ESI (EtherCAT Slave Information) file from our web site.

EtherNet/IP Compliant

Transmission block specifications: -M1 (16 outputs), -M3 (32 outputs)

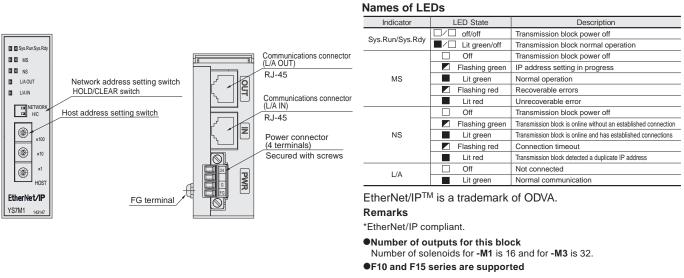

- •See the separate user's manual No. BK-HV045 for details about specifications and handling.
- •We recommend (CAT 5e STP) shielded twisted pair cables that are at least category 5 (100BASE-TX) for communication cables.

•The EDS (electronic data sheet) files can be downloaded from our homepage.

For specifications and handling details, see the above-listed user's manuals (Document No. BK-HV038, BK-HV040 - BK-HV045).

General Specifications

Voltage	24VDC ±10%
Operating temperature range	5~50°C [41~122°F]
Vibration resistance	49.0 m/s² [5G]
Shock resistance	98.1 m/s ² [10G]

• For details about specifications, see each user's manual (see below).

F18 Series Serial Transmission Block, Terminal Block (LED) Part Names

LED indicator Indicator

PWR

COMM

ERR

Remarks

user's manual, etc.

State

Lights up

Shuts off

Lights up


Shuts off

Lights up

Shuts off

Number of outputs per block

For OMRON B7A Link Terminal



LED indicator

Indicator	Description
PWR	•Lights up when power is turned on
ERR	•Lights up during faulty transmission

Remarks

	Connection	method:	1	to	1
--	------------	---------	---	----	---

(Transmission block spec.)	Standard type (-31)	High-speed type (-32)			
Transmission delay time	Max. 31 ms	Max. 5 ms			
Transmission distance	Max. 500 m [1640 ft.]	Max. 100 m [328 ft.]			
*For details of B7A Link Terminal, see the OMRON					

catalog, user's manual, etc.


Number of outputs per block Maximum of 16 solenoids

Error output specifications Output type: NPN open collector Rated load voltage: 24VDC Output current: Šink current MAX. 40 mA

• Related materials: User's manual, document No. BK-HV038

•For CompoNet

Transmission block specification: -H1 (16 outputs) Node address setting switches From left $\times 10$, $\times 1$



LED indicator

Indicator	State	Color	Description	
	Lights up	Green	 Normal state 	
MS	Lights up	Red	 Serious breakdown 	
IVIS	Flashing	Red	Minor breakdown	
	Shuts off	-	 Power OFF/In preparation 	
	Lights up	Green	 Online/Access state 	
	Flashing	Green	 Online/No-access state 	
NS	Lights up	Red	 Serious communication fault 	
	Flashing	Red	 Minor communication fault 	
	Shuts off	-	Power OFF/In preparation	

Remarks

*Conforms to CompoNet.

Number of outputs per block

16 solenoids (transmission block specification: -H1)


Related materials: User's manual, document No.BK-HV043

% The communication connector is sold by Omron Corporation. Direct your inquiries to Omron.

For specifications and handling details, see the above-listed user's manuals (Document No. BK-HV038, BK-HV040, BK-HV041, BK-HV043).

For OMRON CompoBus/S

Transmission block specification: -31 (standard type), -32 (high-speed type) Transmission block specification: -A1 (16 outputs)



Color

Green

Yellow

Red

%For details of CompoBus/S, see the OMRON catalog,

16 solenoids (transmission block specification: -A1)

Related materials: User's manual, document No.BK-HV040

Description

 Communication fault, or standby Communication fault occurred


· During normal communication, or standby

During power supply

 Power not supplied • During normal communication

For CC-Link

Transmission block specification: -B1 (16 outputs) Transmission speed setting switch Station number setting switches



LED indicato

LED Indicator			
Indicator	Description		
PW	 Lights up when power is turned on 		
L RUN	•Lights up when normal data is received from master station		
SD	•Lights up during sending data		
RD	•Lights up during receiving data		
L ERR.	 Lights up during transmission errors, and shuts off when time is over Lights up due to station number setting error or transmission speed setting error 		

Remarks

*Conforms to CC-Link.

Number of outputs per block


16 solenoids (transmission block specification: -B1) Since the block occupies 1 station, if remote I/O stations are entirely composed of the blocks, a maximum of 64 units can be connected to 1 master station.

• Related materials: User's manual, document No.BK-HV041

F Series Order Codes

The solenoid valves F series order codes are classified into the following 10 categories. For details on order codes, see the designated pages.	F10 Series F15 Series	F18 Series
T: Single valve unit	р. 44	p. 72
MA: Monoblock manifold A type (base piping type)	p. 46	p. 74
M F : Monoblock manifold F type (direct piping type)	p. 48	p. 76
MA: Monoblock manifold A type, wire-saving type (base piping type)	p. 50	
M F: Monoblock manifold F type, wire-saving type (direct piping type)	p. 52	
M AP: PC board manifold A type (base piping type)	p. 54	
M FP: PC board manifold F type (direct piping type)	p. 58	
M N: Split manifold non-plug-in type	р. 60	p. 78
M P: Split manifold plug-in type	p. 64	p. 82
MS: Serial transmission compatible manifold	p. 68	p. 86

F10, F15 Series Single Valve Unit Order Codes

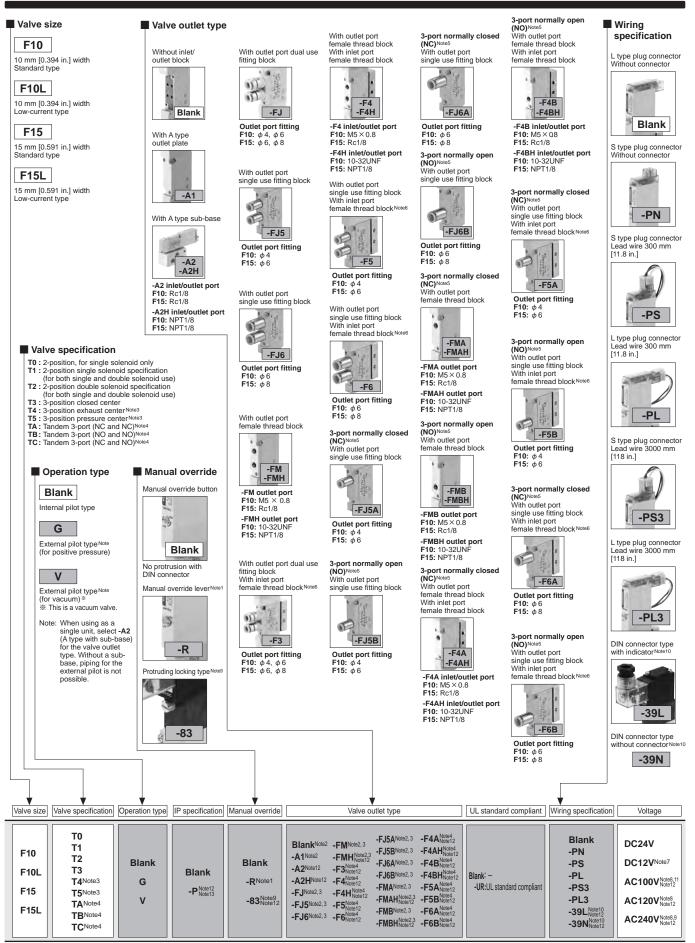

Notes: 1. When the valve specification is T1 or T2, the manual override lever is placed only on the A side. This is not available with -39

2 Two manifold mounting screws are included.

3. Not available in the vacuum valves.

Not available in external pilot type and vacuum valves. Only for valve specification **T0**, **T1**, and **T2**. 5.

Thread size for the inlet port female thread block is F10: M5 × 0.8, F15: Rc1/8. 6.

7. Not available in low-current type.

 8. Not available in low-current type and tandem 3-port valves.
 9. Only for wiring specification -39 .
 10. Only for F15 series and not available for valve specification T1, TA, TB, and TC. In addition, the valve is used only as a double solenoid for **T2**. 11. Not available with DIN connectors.


12. Not available in UR.

13. IP65 compliant protective construction to protect against intrusion of dust and water from outside.

Remark: Negative common specifications are also available as made to order products (add


-129W to the end of order code). For details, consult us.

J5A, J6A: Fitting block

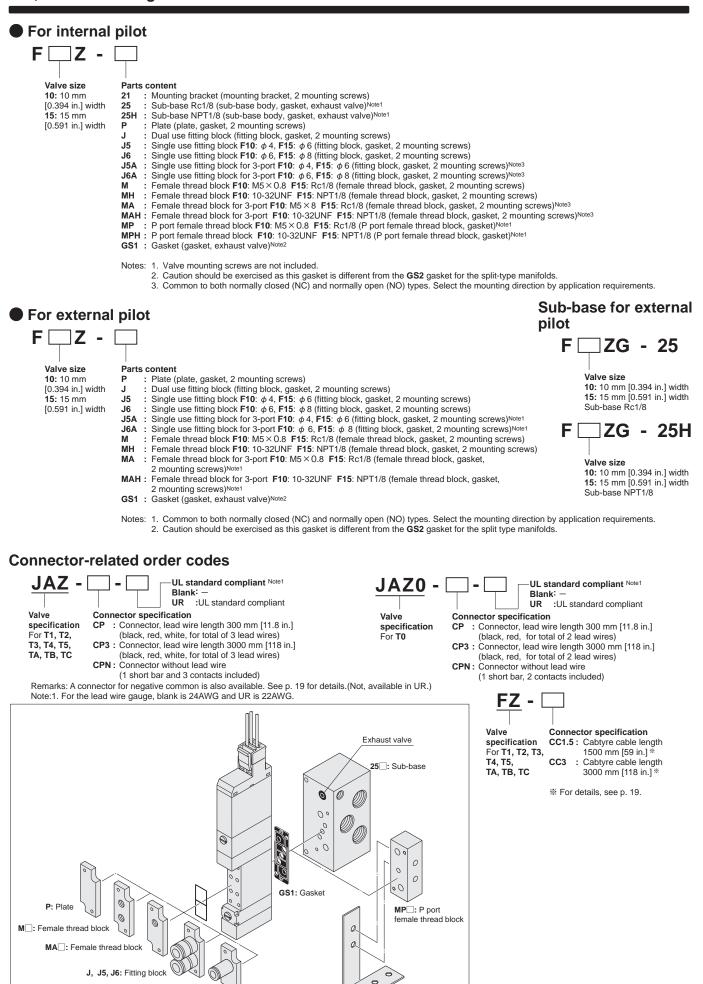

21: Mounting bracket

F10, F15 Series Monoblock Manifold A Type (Base Piping Type) Order Codes

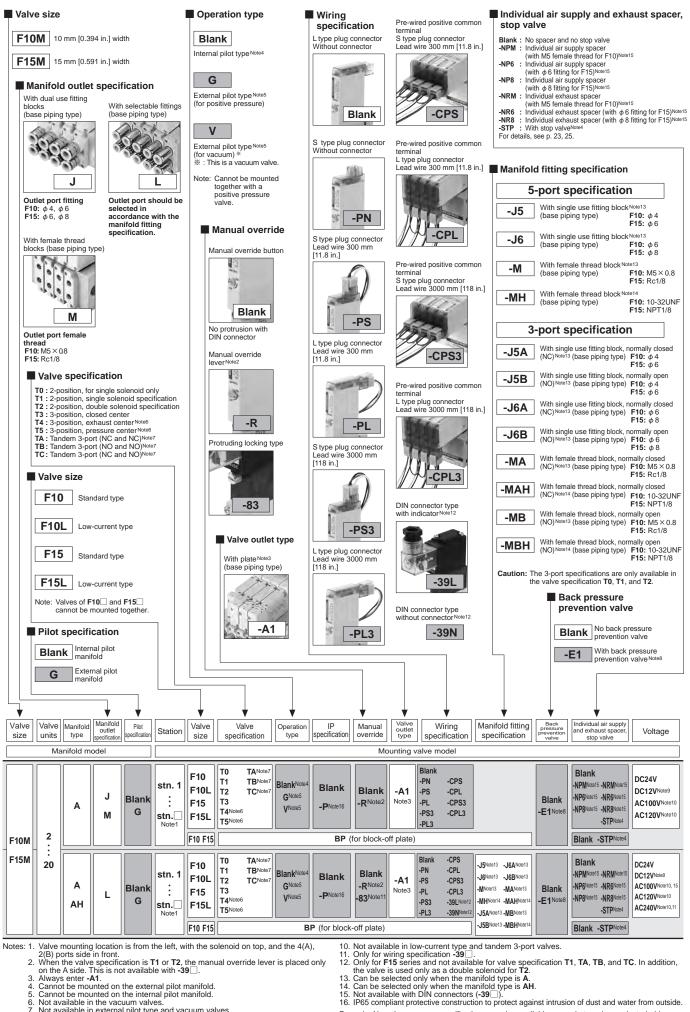


Cannot be mounted on the external pilot manifold.

- Cannot be mounted on the external pilot manifold.
 Cannot be mounted on the internal pilot manifold.
 Not available in the vacuum valves.
 Not available with the individual exhaust spacer and vacuum valve.
 Not available in low-current type.

-129W to the ends of the valve and manifold model order codes). For details, consult us.

Remark: Negative common specifications are also available as made to order products (add

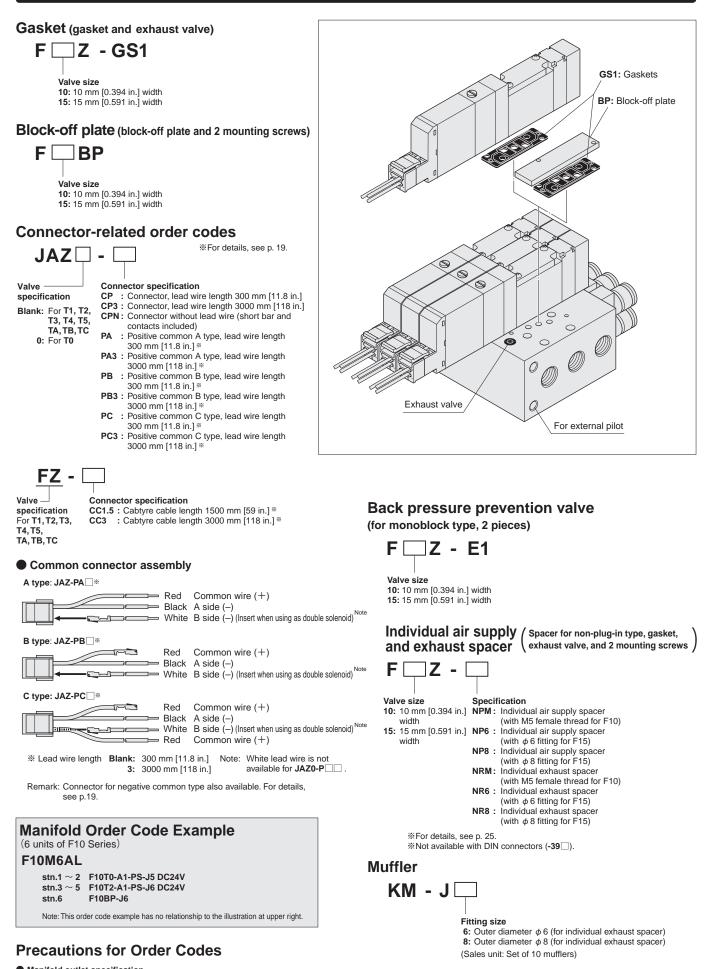


Manifold outlet specification Select from among "dual use fitting blocks", "with female thread blocks" or "with selectable fittings." For repair or replacement, purchase the single valve unit additional parts, F □ Z-J (dual use fitting block), F □ Z-J □ (single use fitting block), or F □ Z-M □ (female thread block), on p. 45.

Place orders from "Single Valve Unit Order Codes" on p. 44. Note, however, that the only available valve outlet type is A1. In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.

ORDER CODES

F10, F15 Series Monoblock Manifold F Type (Direct Piping Type) Order Codes

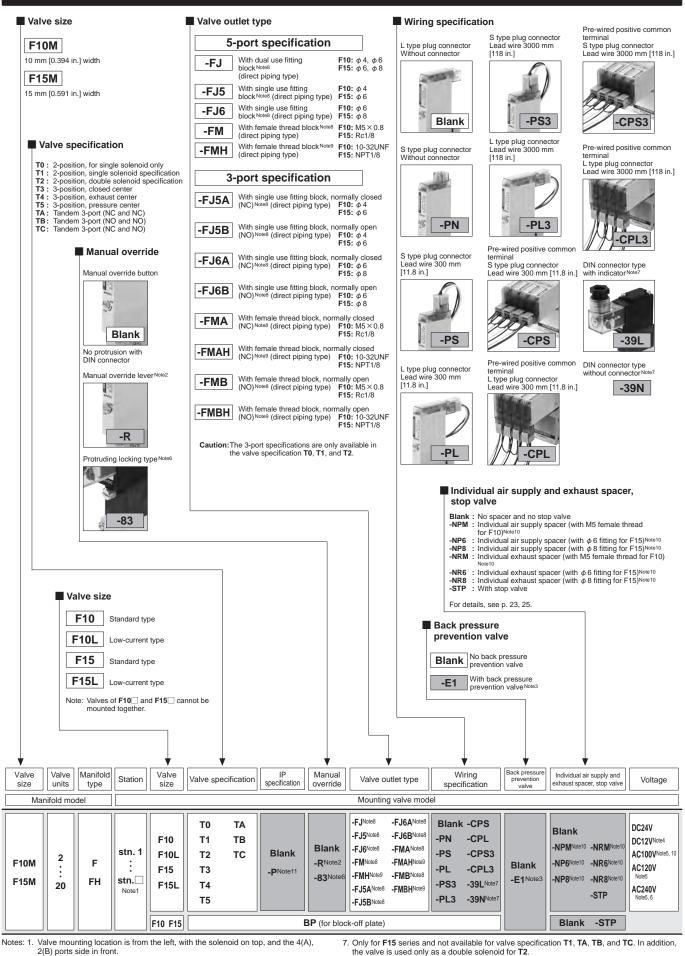

Valve mounting location is from the left, with the solenoid on top, and the 4(A) 2(B) ports side in front.

When the valve specification is T1 or T2, the manual override lever is placed only 2. on the A side. This is not available with -39

3. Not available with the individual exhaust spacer.


4. Not available in low-current type.

Not available in low-current type and tandem 3-port valves.
 Only for wiring specification -39 .

- 8. Can be selected only when the manifold type is F
- 9. Can be selected only when the manifold type is FH.
 10. Not available with DIN connectors (-39⁻).

IP65 compliant protective construction to protect against intrusion of dust and water from outside. Remarks: 1. The external pilot type valve cannot be mounted on the F type manifold.
 Negative common specifications are also available as made to order products (add


-129W to the ends of the valve and manifold model order codes). For details, consult us

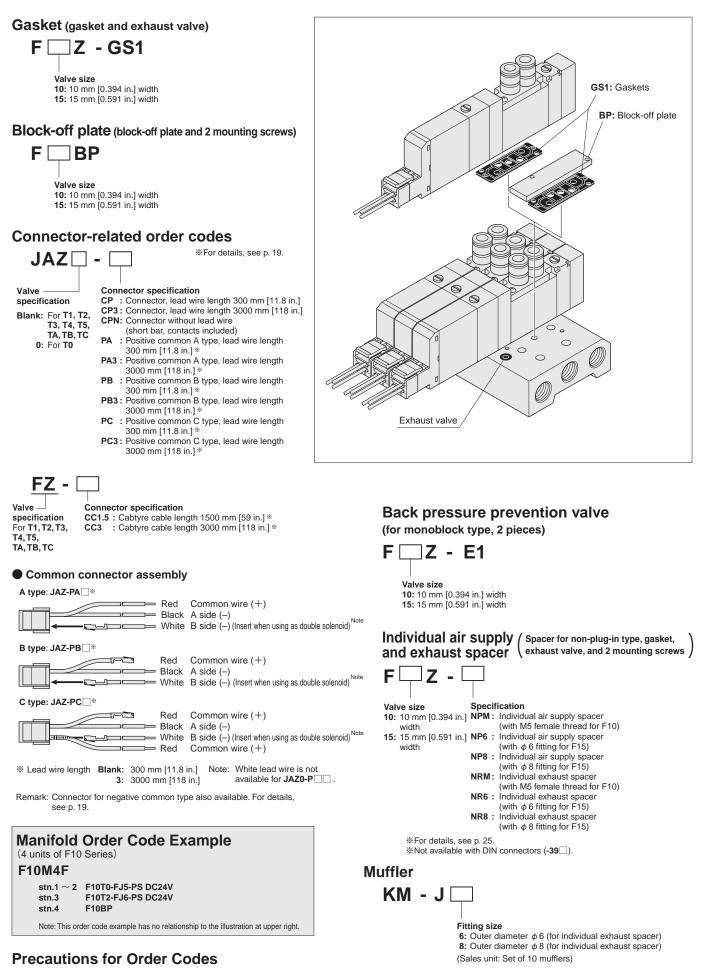

Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 44. Select from valve outlet types -FJ, -FJ5, -FJ6, -FM _, -FJ5B, -FJ6A, -FJ6B, -FMA _, or -FMB _. In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.

F10, F15 Series Monoblock Manifold A Type, Wire-Saving Type (Base Piping Type) Order Codes

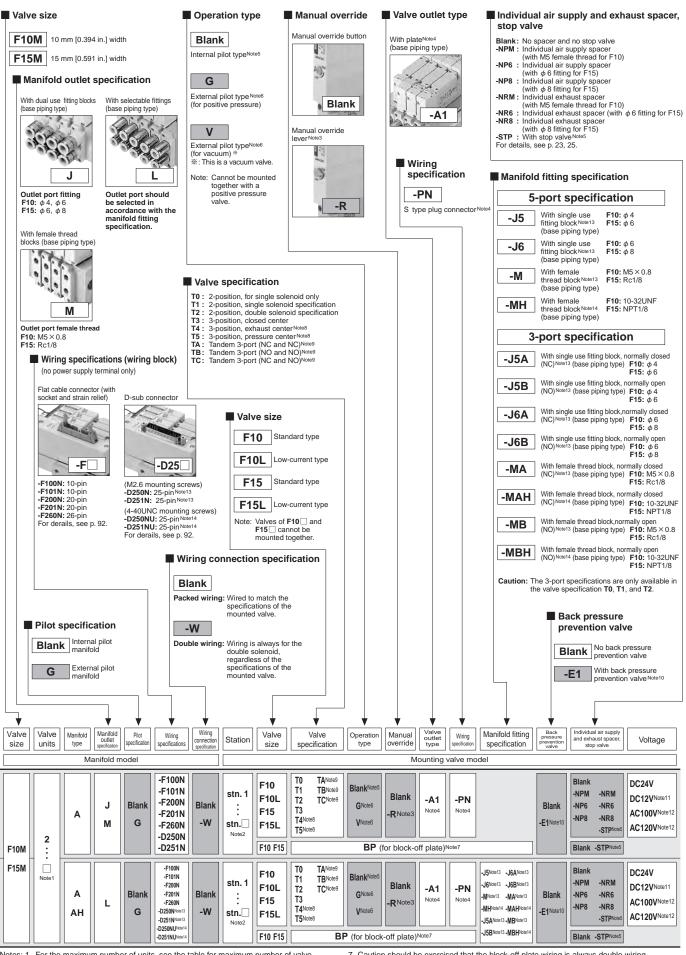

Notes: 1. For the maximum number of units, see the table for maximum number of valve units by wiring specification, on p. 51. 2. Valve mounting location is from the left, with the solenoid on top, and the 4(A),

2(B) ports side in front. 3. When the valve specification is T1 or T2, the manual override lever is placed only

on the A side

Always enter -A1 and -PN. Δ

Cannot be mounted on the external pilot manifold. 5.

6. Cannot be mounted on the internal pilot manifold.

50


Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For single wiring, see p. 51. 8. Not available in the vacuum valves.

Not available in external pilot type and vacuum valves.
 Not available with the individual exhaust spacer and vacuum valve.

11. Not available in low-current type.

12. Not available in low-current type and tandem 3-port valves. In addition, only available when the wiring specification is a D-sub connector. 13. Can be selected only when the manifold type is **A**.

14. Can be selected only when the manifold type is AH

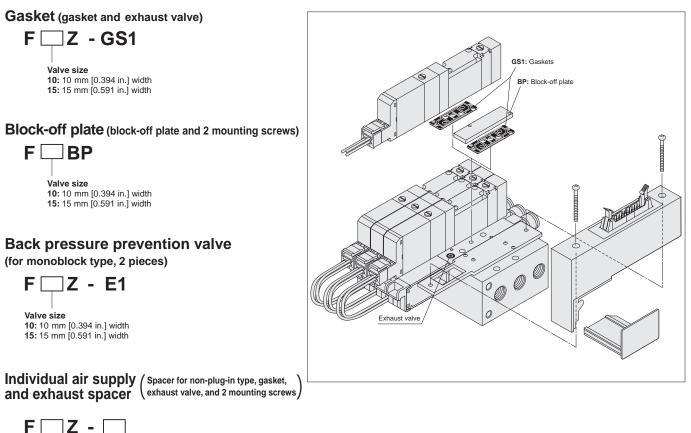


F 🗔 Z -

Valve size Specification NPM: Individual air supply spacer (with M5 female thread for F10) 10: 10 mm [0.394 in.] width NP6 : Individual air supply spacer (with ϕ 6 fitting for F15) 15: 15 mm **NP8** : Individual air supply spacer (with ϕ 8 fitting for F15) [0.591 in.] width NRM: Individual exhaust spacer (with M5 female thread for F10) **NR6** : Individual exhaust spacer (with ϕ 6 fitting for F15) **NR8** : Individual exhaust spacer (with ϕ 8 fitting for F15)

*For details, see p. 25.

Muffler



Fitting size

6: Outer diameter ϕ 6 (for individual exhaust spacer) 8: Outer diameter ϕ 8 (for individual exhaust spacer) (Sales unit: Set of 10 mufflers)

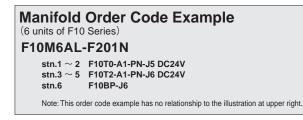


Table for maximum number of valve units by wiring specification

		Maximum number of units		
	Wiring connection specification			
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)	
F100N Flat cable (10P)	8	Varies depending on the number of mounted single solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less.	4 units	
F101N Flat cable (10P)	8		4 units	
F200N Flat cable (20P)	16		8 units	
F201N Flat cable (20P)	16		8 units	
F260N Flat cable (26P)	20		10 units	
D250N D-sub connector (25P)	16		8 units	
D251N D-sub connector (25P)	20		10 units	

Precautions for Order Codes

Manifold outlet specification

F Z-J (dual use fitting blocks", "with female thread blocks" or "with selectable fittings." For repair or replacement, purchase the single valve unit additional parts, Orders for valves only


- Place orders from "Single Valve Unit Order Codes" on p. 44. Note, however, that the only available valve outlet type is A1.
- Wiring connection specification Blank (packed wiring): Wired to match the specifications of the mounted valve.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us,

F10, F15 Series Monoblock Manifold F Type, Wire-Saving Type (Direct Piping Type) Order Codes

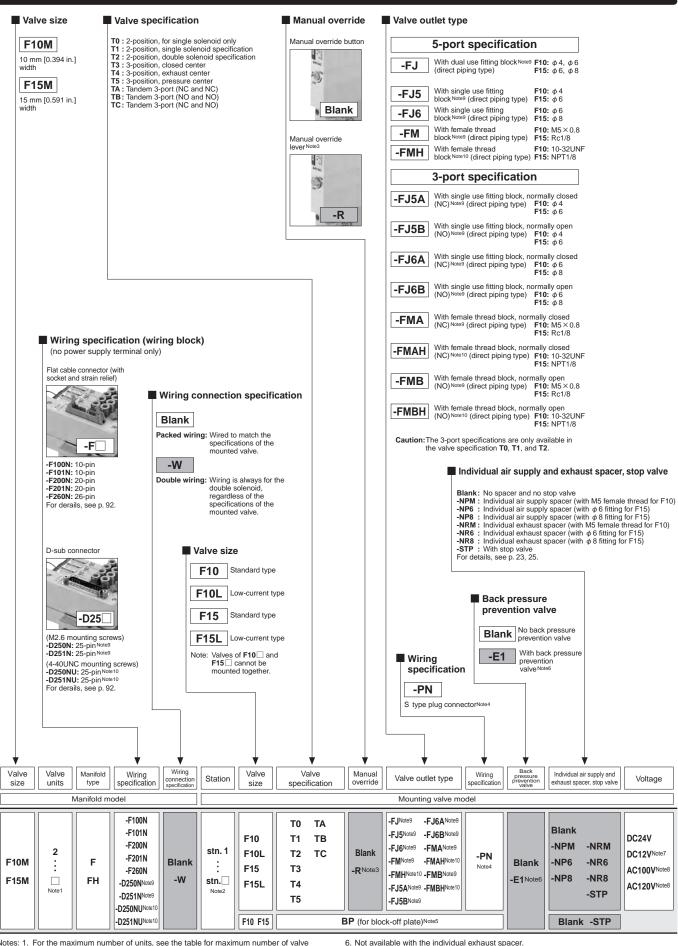

Notes: 1. For the maximum number of units, see the table for maximum number of valve

units by wiring specification, on p. 53. 2. Valve mounting location is from the left, with the solenoid on top, and the 4(A),

2(B) ports side in front.3. When the valve specification is T1 or T2, the manual override lever is placed only on the A side

Always enter -PN.

5. Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For single wiring, see p. 53.

Not available in low-current type.


8. Not available in low-current type and tandem 3-port valves. In addition, only available


when the wiring specification is a D-sub connector 9. Can be selected only when the manifold type is **F**.

10. Can be selected only when the manifold type is FH.

Remark: The external pilot type valve cannot be mounted on the F type manifold.

F10, F15 Series Monoblock Manifold F Type, Wire-Saving Type Additional Parts Order Codes

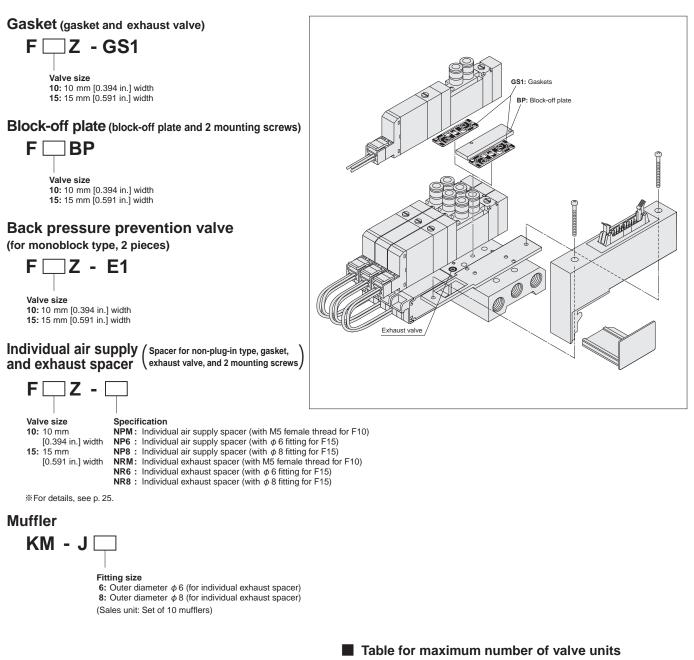



Precautions for Order Codes

Orders for valves only

- Place orders from "Single Valve Unit Order Codes" on p. 44. Select from valve outlet types -FJ, -FJ5, -FJ6, -FM□, -FJ5A, -FJ5B, -FJ6A, -FJ6B, -FMA□, or -FMB□.
- Wiring connection specification Blank (packed wiring): Wired to match the specifications of the mounted valve.
- -W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.


Caution

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us.

by wiring specification


		Maximum number of units		
		Wiring connection specification		
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)	
F100N Flat cable (10P)	8	Varies depending on	4 units	
F101N Flat cable (10P)	8	the number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less.	4 units	
F200N Flat cable (20P)	16		8 units	
F201N Flat cable (20P)	16		8 units	
F260N Flat cable (26P)	20		10 units	
D250N D-sub connector (25P)	16		8 units	
D251N D-sub connector (25P)	20		10 units	

F10, F15 Series PC Board Manifold A Type (Base Piping Type) Order Codes

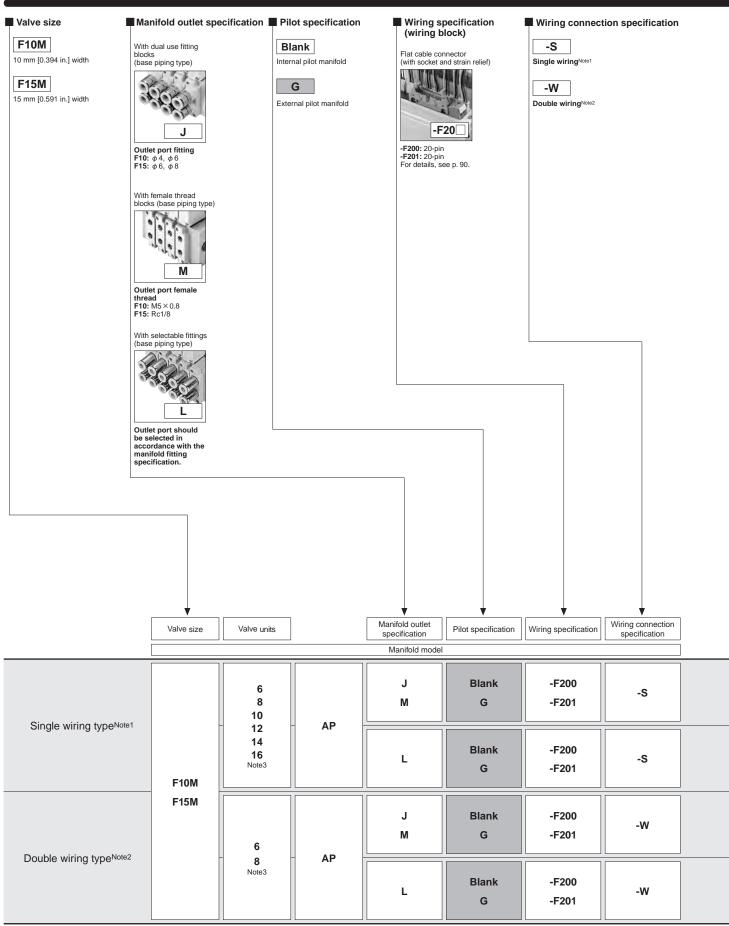

Notes: 1. Wiring is for the single solenoid only. Note that this is not the same as packed wiring. The mounting valves are limited to single solenoid only (**T0**, **T1** specifications). Therefore, even if the **T1** specification valve is switched over to a double solenoid, no power will be applied to the B side solenoid.

Wirnig is always for the double solenoid, regardless of the specifications of the mounted valves.
 In terms of wiring connection specifications, the number of units for single wiring is 6-16 (even numbers only) and for double wiring is 6 or 8.

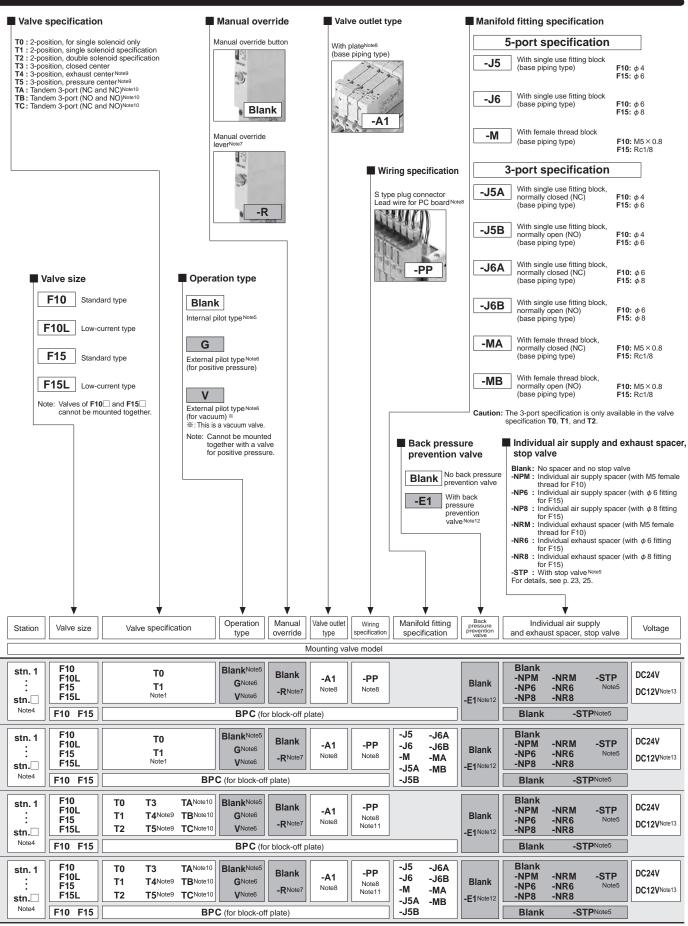

4. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front Notes:

Cannot be mounted on the external pilot manifold. 5

6

Cannot be mounted on the internal pilot manifold. When the valve specification is **T1** or **T2**, the manual override lever is placed only on the A side. 7.

8. Always enter -A1 and -PP.


Not available in the vacuum valves.

Not available in external pilot type and vacuum valves.
 The lead wire on the solenoid B side (white) is not available in valve specification T0.

Not available with the individual exhaust spacer and vacuum valve.
 Not available in low-current type.

ORDER CODES

KOGANEI 55

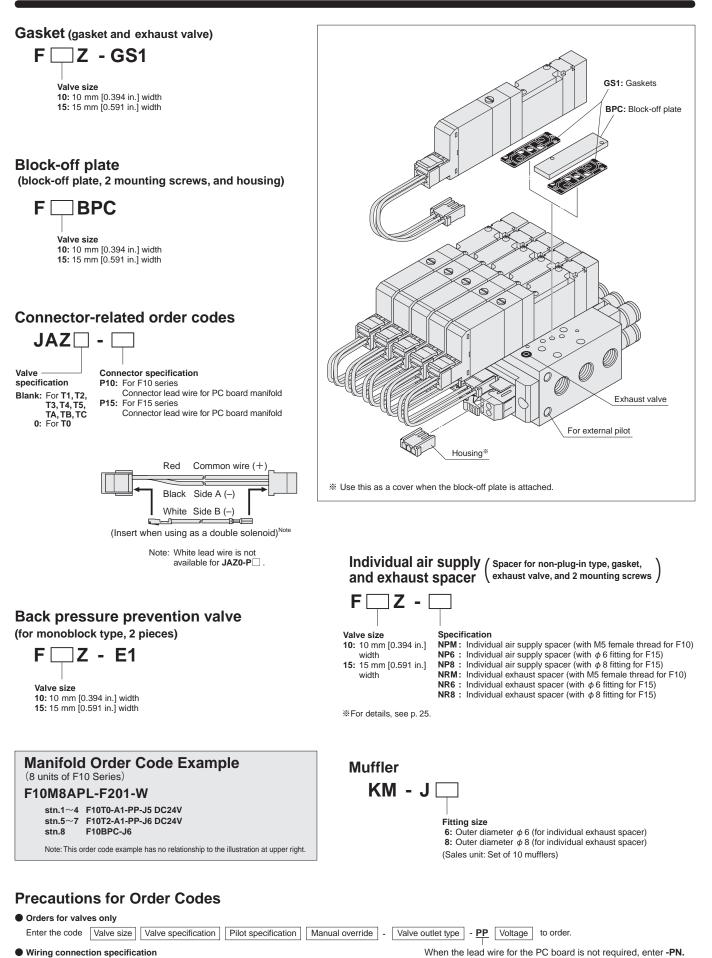


• Wiring connection specification

-S (single wiring): Wiring for single solenoid only.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

F10, F15 Series PC Board Manifold F Type (Direct Piping Type) Order Codes

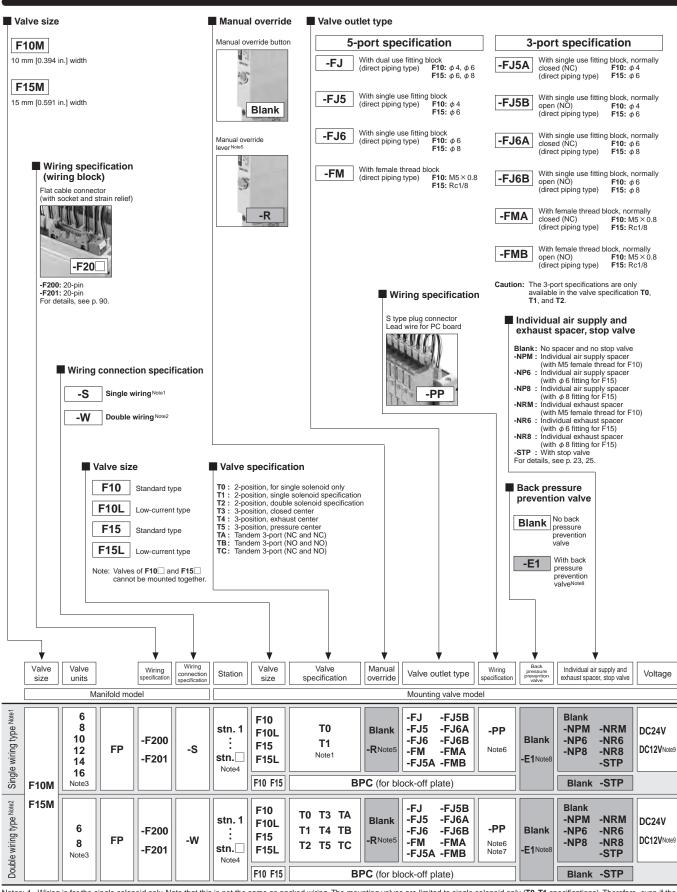

Wiring is for the single solenoid only. Note that this is not the same as packed wiring. The mounting valves are limited to single solenoid only (**T0, T1** specifications). Therefore, even if the **T1** specification valve is switched over to a double solenoid, no power will be applied to the B side solenoid. Notes: 1.

2

Wiring is always for the double solenoid, regardless of the specifications of the mounted valve. In terms of wiring connection specifications, the number of units for single wiring is 6-16 (even numbers only) and for double wiring is 6 or 8 3.


Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front. When the valve specification is T1 or T2, the manual override lever is placed only on the A side. 4 5.

6. Always enter -PP

The lead wire on the solenoid B side (white) is not available in valve specification TO


Not available with the individual exhaust spacer 8

9. Not available in low-current type.

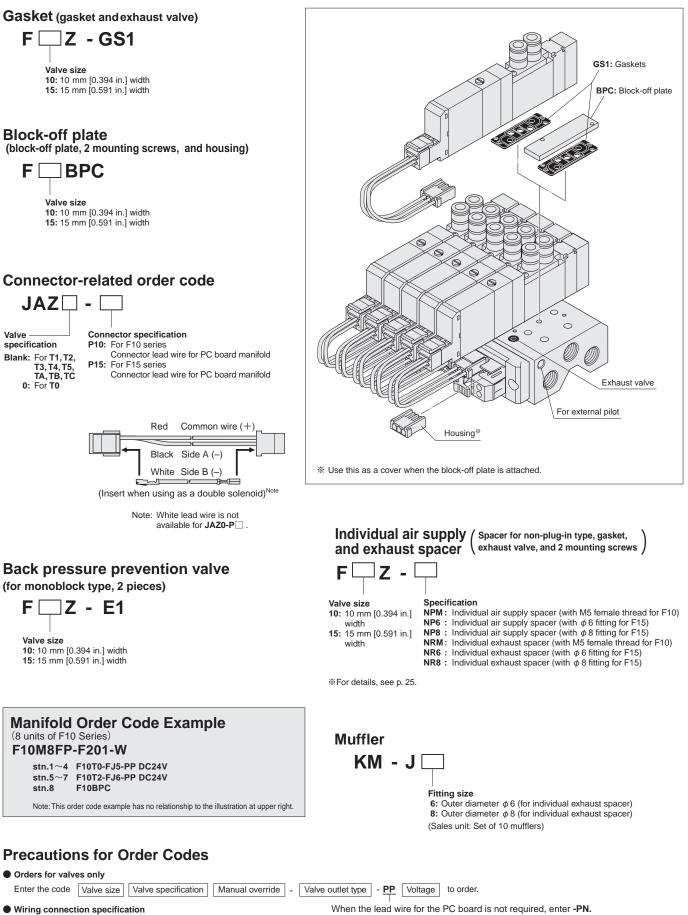


-S (single wiring): Wiring for single solenoid only. -W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

F10, F15 Series Split Manifold Non-Plug-in Type Order Codes

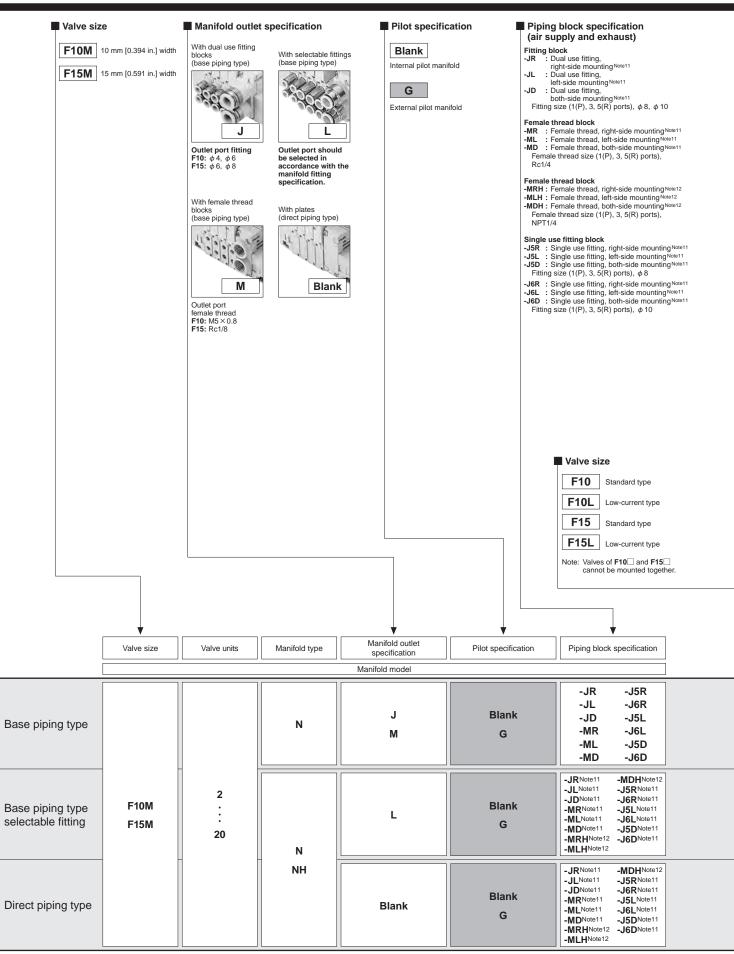

Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

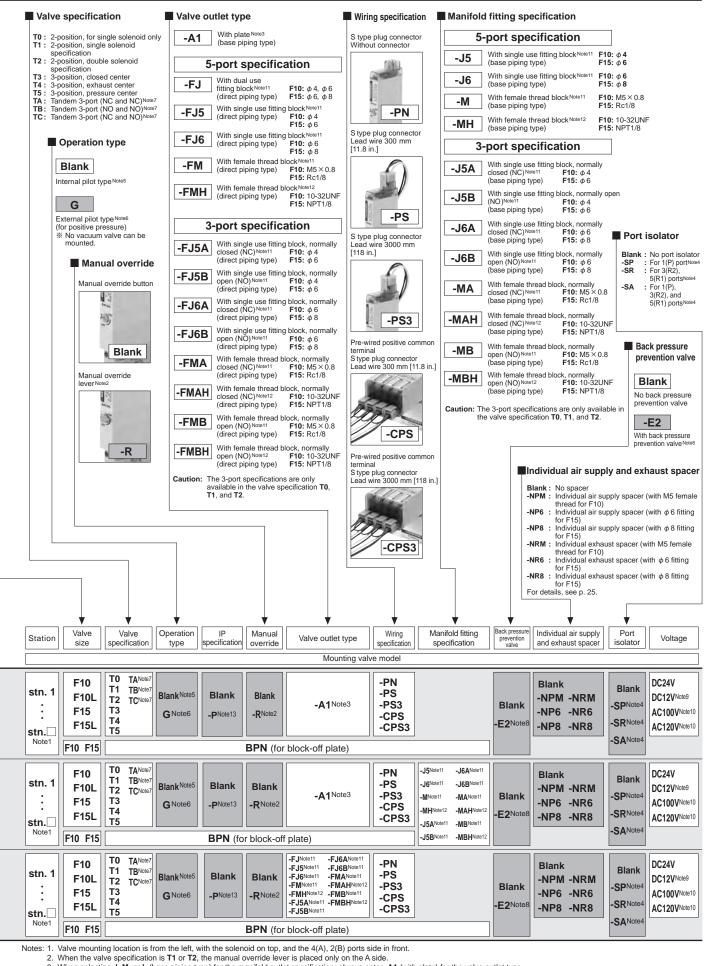

3

13. IP65 compliant protective construction to protect against intrusion of dust and water from outside.

Cannot be mounted on the external pilot manifold.


6. Cannot be mounted on the internal pilot manifold.

7. Not available in external pilot type.

Not available with the individual exhaust spacer. Not available in low-current type. 8


10. Not available in low-current type and tandem 3-port valves.


When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and 4. -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.). 5 Can be selected only when the manifold type is N.
 Can be selected only when the manifold type is NH.

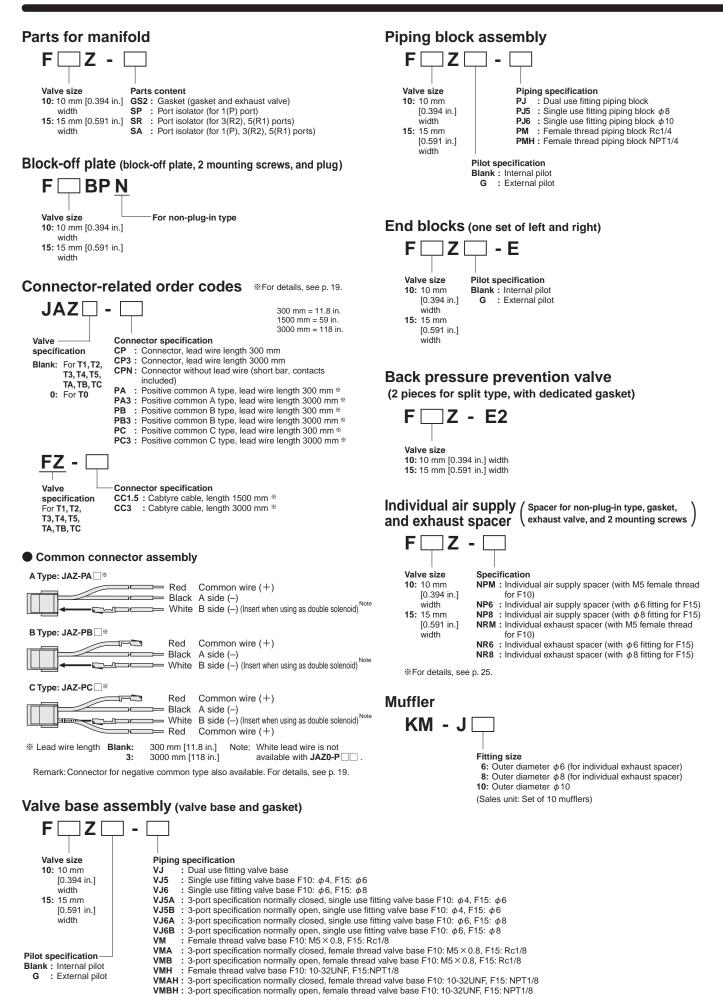

VP

: Valve base plate

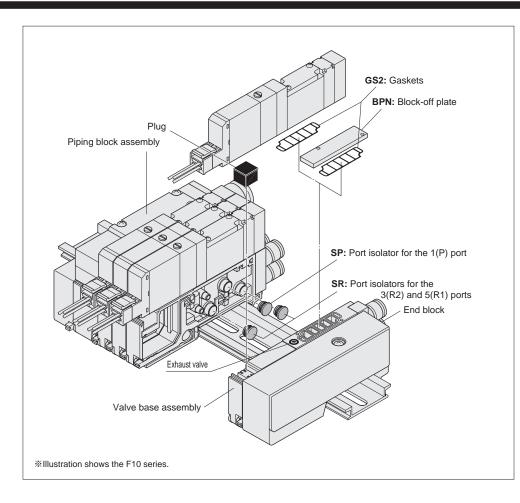




Precautions for Order Codes

Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 44. However, Blank, A2, F3, F4, F5, F6, F4A, F4B, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. And for the wiring specification, Blank, PL, and PL3 cannot be selected. In addition, for common terminal wiring connections, separately order the common connector assemblies listed on the previous page.


F10, F15 Series Split Manifold Plug-in Type Order Codes

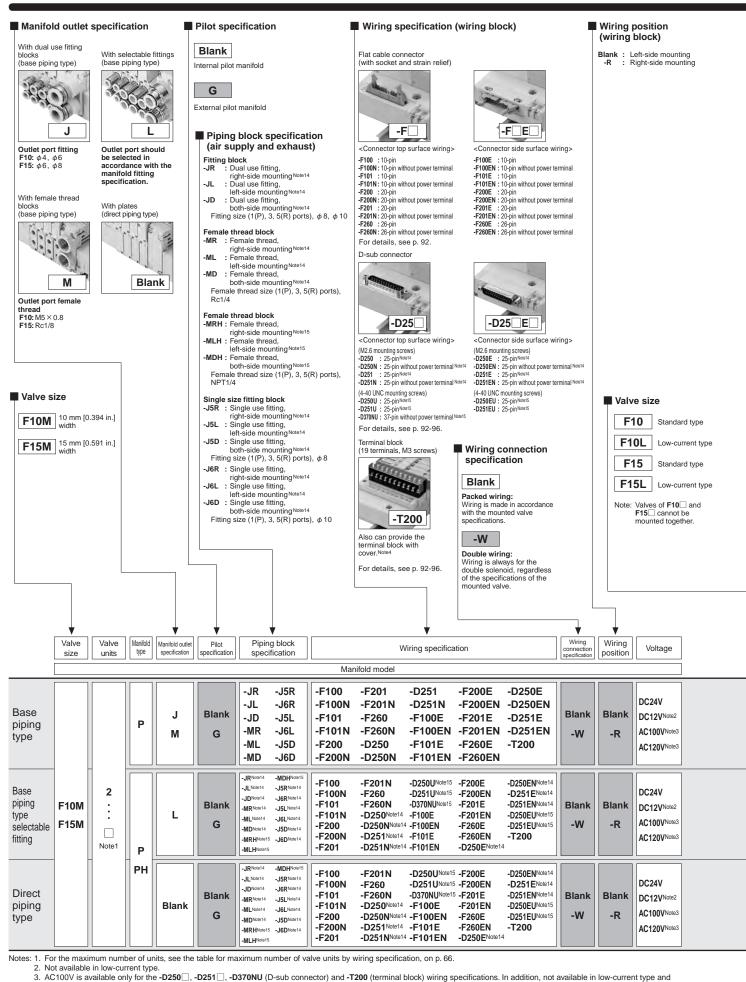

4. The terminal block with cover is also available as a made to order product (add -139W to the end of the manifold model order code). For details, consult us

Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

tandem 3-port valves.

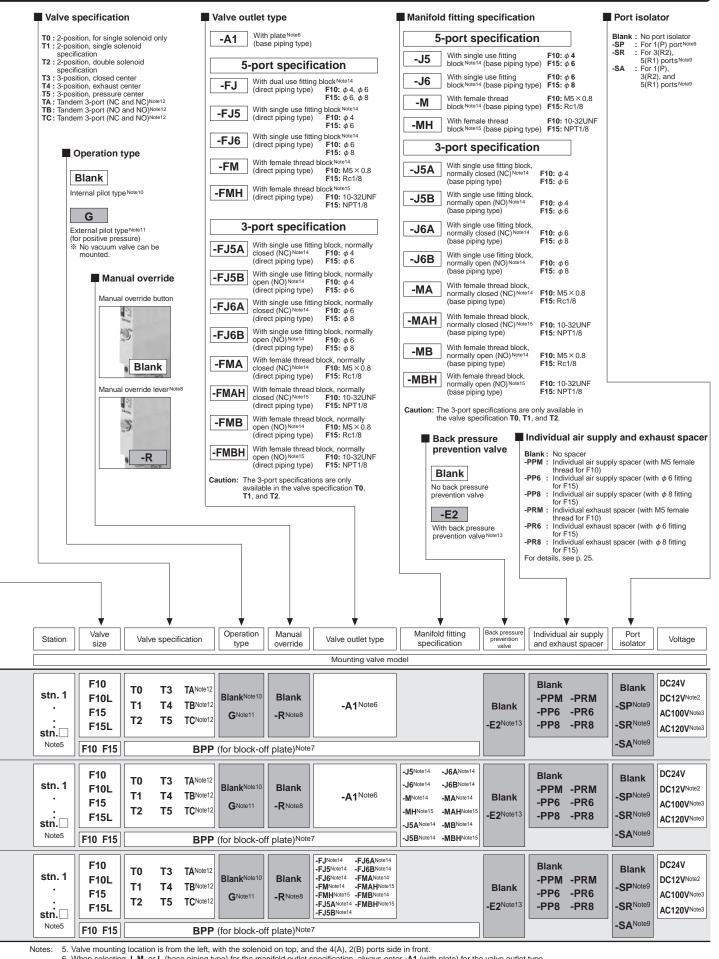

6. When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.


Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For wiring for 7. a single solenoid, see p. 67.

 8. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
 9. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).

Cannot be mounted on the external pilot manifold. Cannot be mounted on the internal pilot manifold. 10

11.

- 12. Not available in external pilot type.
- 13. Not available with the individual exhaust spacer 14. Can be selected only when the manifold type is P
- 15. Can be selected only when the manifold type is PH.

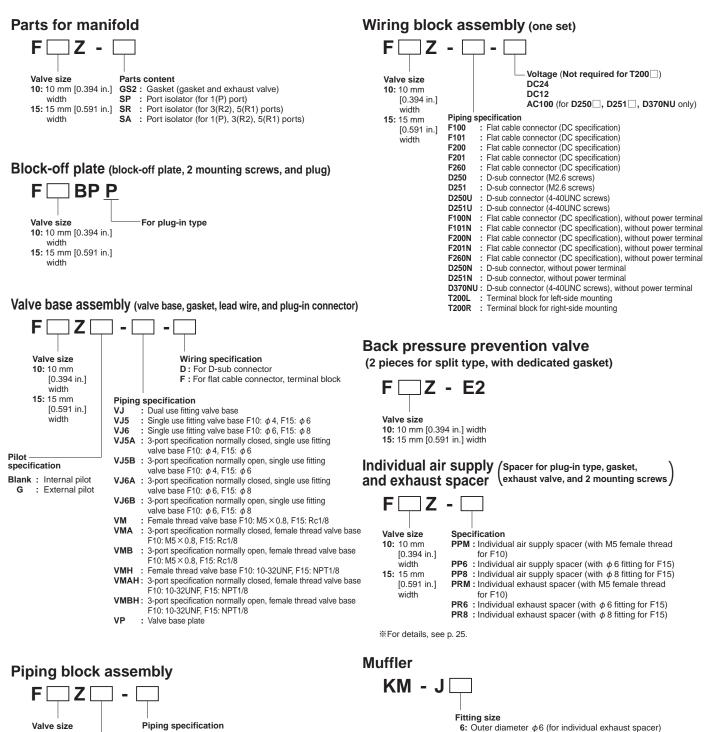

 Value Size
 Pip if specification

 10: 10 mm
 PJ
 Dual use fitting piping block

 [0.394 in.]
 PJ5
 Single use fitting piping block φ 10

 width
 PJ6
 Single use fitting piping block k φ 10

 15: 15 mm
 PM
 Female thread piping block NPT1/4

 [0.591 in.]
 PMH
 Female thread piping block NPT1/4

 width
 PIot specification
 Blank

Blank : Internal pilot G : External pilot

End blocks (one set of left and right)





Table for maximum number of valve units by wiring specification


Outer diameter φ10

(Sales unit: Set of 10 mufflers)

		Maximum number of units	
		Wiring connection specification	
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
F100 Flat cable (10P)	8	Varies depending on	4 units
F101 Flat cable (10P)	8	the number of mounted single solenoids, double solenoids, and block-off plates. The number of controlled solenoids should be designated as the maximum number of outputs or less. D370NU is a maximum of 20 units.	4 units
F200 Flat cable (20P)	16		8 units
F201 Flat cable (20P)	16		8 units
F260 Flat cable (26P)	20		10 units
D250 D-sub connector (25P)	16		8 units
D251 D-sub connector (25P)	20		10 units
D370NU D-sub connector (37P)	32		16 units
T200 Terminal block (19 terminals)	18		9 units

8: Outer diameter ϕ 8 (for individual exhaust spacer)

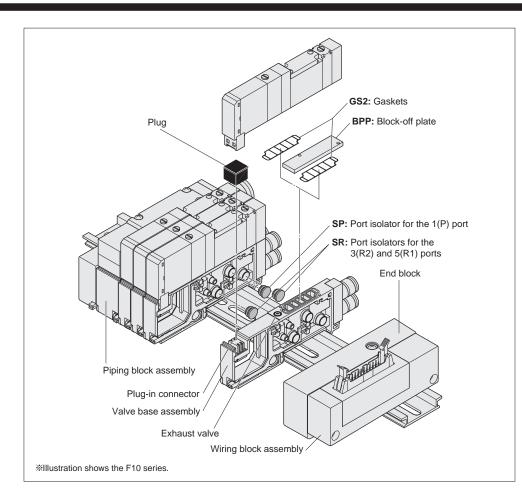



Precautions for Order Codes

Orders for valves only

Place orders from "Single Valve Unit Order Codes" on p. 44. However, Blank, A2, F3, F4, F5, F6, F4A, F4B, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection.


Wiring connection specification Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add **-1W** to the end of the block-off plate order code in the case. For details, consult us.


F10, F15 Series Serial Transmission Compatible Manifold Order Codes

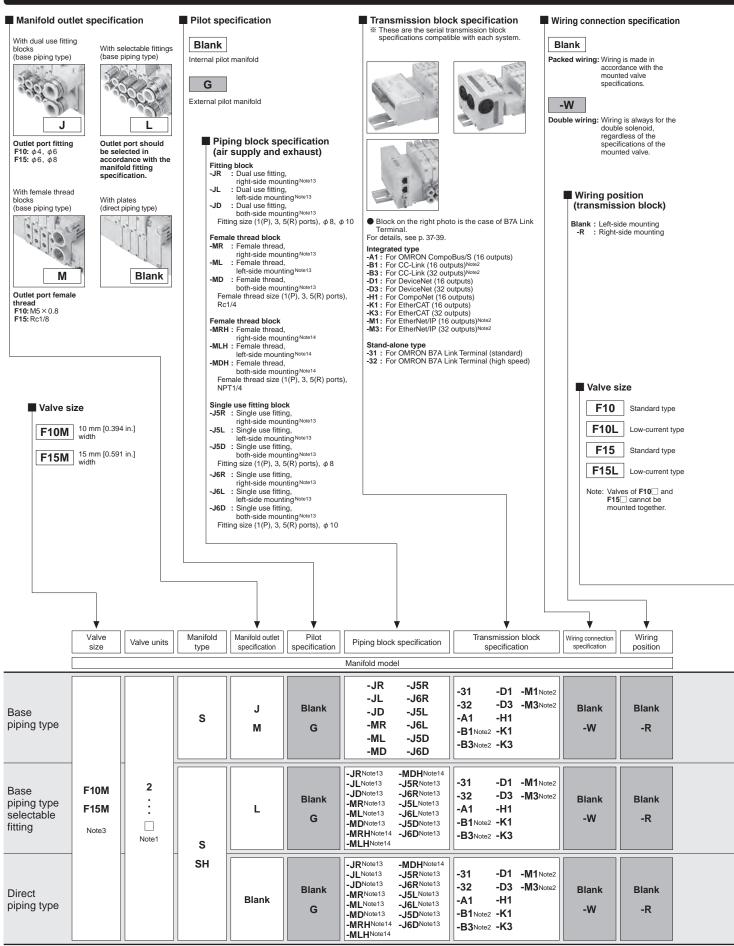

Notes: 1. To determine the maximum number of units, see the table for maximum number of valve units by transmission block specification, on p. 70.

Notes: 2. CE marking compliant.

Notes: 3. Contact our nearest sales office for information about the F18 series.

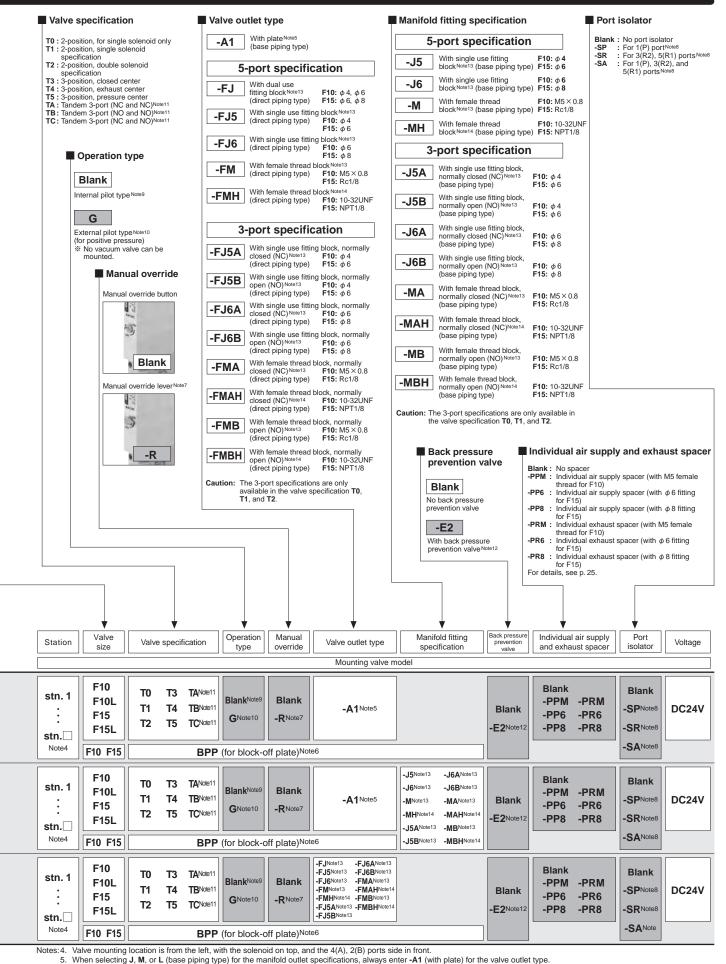

When selecting J, M, or L (base piping type) for the manifold outlet specifications, always enter -A1 (with plate) for the valve outlet type. The wiring on the block off plate uses double wiring (2 control points allocated) regardless of the wiring specifications. However, we can provide block off plates with a -1W suffix on 6. the model number for the block off plate wired for connecting single solenoids. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.


8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.)


Cannot be mounted on the external pilot manifold.

- 10. Cannot be mounted on the internal pilot manifold. 11. Not available in external pilot type.
- 12. Not available with the individual exhaust spacer


Can be selected only when the manifold type is S.
 Can be selected only when the manifold type is SH.

ORDER CODES

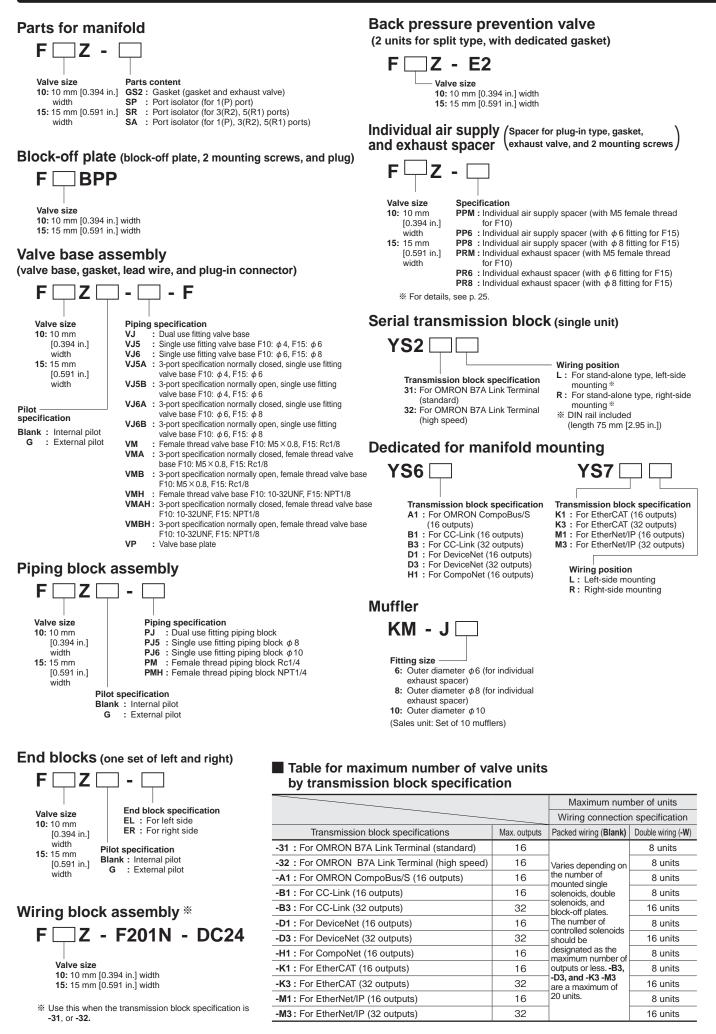

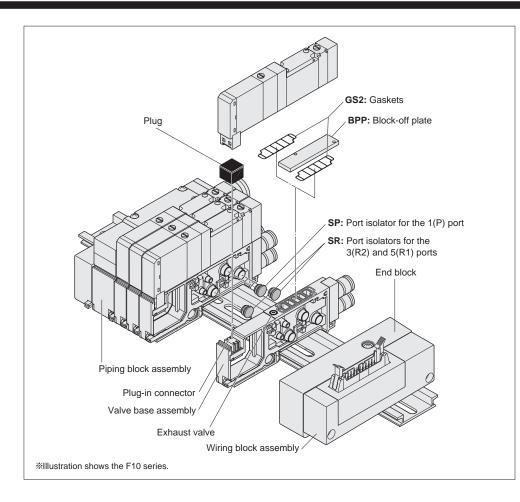





Precautions for Order Codes

• Orders for valves only Place orders from "Single Valve Unit Order Codes" on p. 44. However, Blank, A2, F3, F4, F5, F6, F4A, F4B, F5A, F5B, F6A, and F6B cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection


Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.
 W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us.

F18 Series Single Valve Unit Order Codes

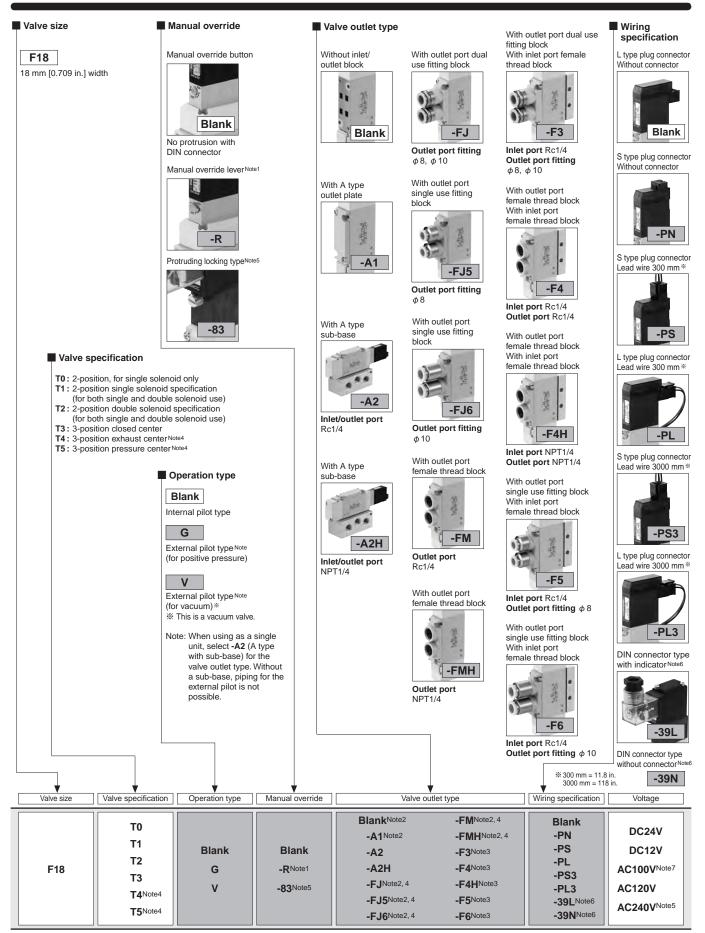

Notes: 1. When the valve specification is **T1** or **T2**, the manual override lever is placed only on the A side. This is not available with $-39\square$.

2. Two manifold mounting screws are included.

"With inlet port female thread block" is compatible with the internal pilot type valve only.

4. Not available in the vacuum valves.

5. Only for wiring specification -39 .

Not available for valve specification T1. In addition, the valve is used only as a double solenoid for T2.

7. Not available with DIN connectors.

Remark: Negative common specifications are also available as made to order products (add -129W to the end of order code). For details, consult us.

For internal pilot F18 Z -

Parts content

- 21 : Mounting bracket (mounting bracket, 2 mounting screws)
 25 : Sub-base Rc1/4 (sub-base body gasket exhaust valve)
- 25 : Sub-base Rc1/4 (sub-base body, gasket, exhaust valve)^{Note1} 25H : Sub-base NPT1/4 (sub-base body, gasket, exhaust valve)^{Note1}
- Plate (plate, gasket, 2 mounting screws)
- : Dual use fitting block (fitting block, gasket, 2 mounting screws)
- J5 : Single use fitting block ϕ 8 (fitting block, gasket, 2 mounting screws)
- J6 : Single use fitting block ϕ 10 (fitting block, gasket, 2 mounting screws)
- M : Female thread block Rc1/4 (female thread block, gasket, 2 mounting screws)
- MH : Female thread block NPT1/4 (female thread block, gasket, 2 mounting screws)
- MP : P port female thread block Rc1/4 (P port female thread block, gasket)Note1
- MPH: P port female thread block NPT1/4 (P port female thread block, gasket)Note1
- GS1 : Gasket (gasket, exhaust valve)Note2
- Notes: 1. Valve mounting screws are not included.
 - 2. Caution should be exercised as this gasket is different from the GS2 gasket for the split-type manifolds.

● For external pilot F18 Z -

Parts content

- P : Plate (plate, gasket, 2 mounting screws)
- J : Dual use fitting block (fitting block, gasket, 2 mounting screws)
- J5 : Single use fitting block ϕ 8 (fitting block, gasket, 2 mounting screws)
- J6 : Single use fitting block ϕ 10 (fitting block, gasket, 2 mounting screws)
- M : Female thread block Rc1/4 (female thread block, gasket, 2 mounting screws)
- MH : Female thread block NPT1/4 (female thread block, gasket, 2 mounting screws)
- GS1 : Gasket (gasket, exhaust valve)Note

Note: Caution should be exercised as this gasket is different from the GS2 gasket for the split type manifolds.

Sub-base for external pilot

- F18 ZG 25 (Sub-base Rc1/4)
- F18 ZG 25H (Sub-base NPT1/4)

Connector-related order codes

 FZ Connector specification

 specification
 CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, white, for total of 3 lead wires)

 For T1, T2,
 CP3 : Connector, lead wire length 3000 mm [118 in.] (black, red, white, for total of 3 lead wires)

 CLN :
 Connector without lead wire (1 short bar and 3 contacts included)

 CC1.5 :
 Cabtyre cable length 1500 mm [59 in.] *

 CC3 :
 Cabtyre cable length 3000 mm [118 in.] *

%For details, see p. 19.




Valve Co

specification For **T0**

Connector specification

CP : Connector, lead wire length 300 mm [11.8 in.] (black, red, for total of 2 lead wires) CP3 : Connector, lead wire length 3000 mm [118 in.] (black, red, for total of 2 lead wires) CLN : Connector without lead wire (1 short bar, 2 contacts included)

F18 Series Monoblock Manifold A Type (Base Piping Type) Order Codes

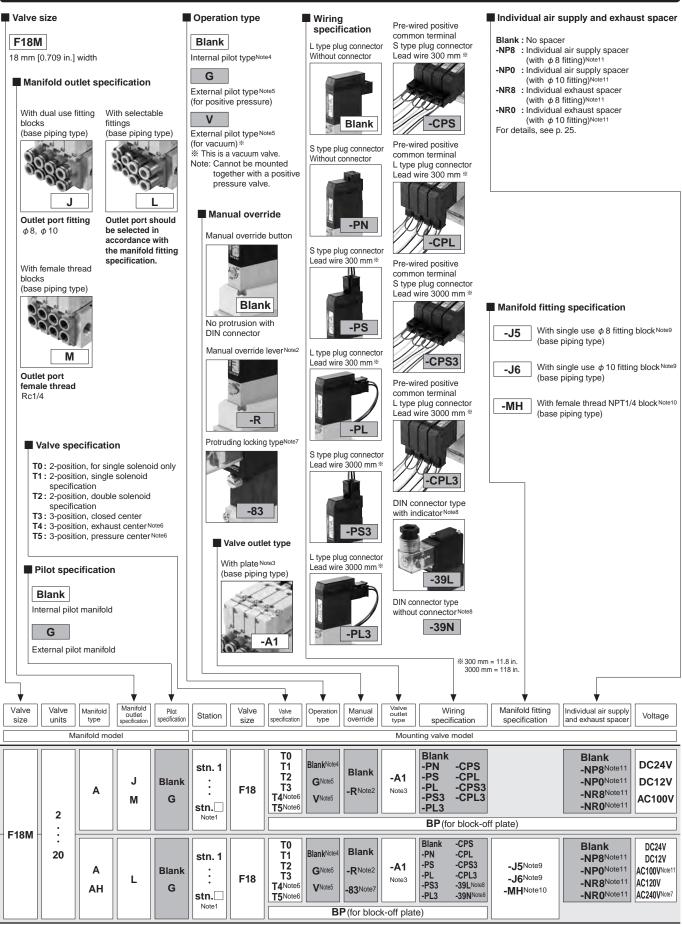

Notes: 1. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

- 2. When the valve specification is T1 or T2, the manual override lever is placed only on the A side. This is not available with -39
- 3. Always enter -A1.

4. Cannot be mounted on the external pilot manifold. 5. Cannot be mounted on the internal pilot manifold.

Not available in the vacuum valves. 6. Only for wiring specification -39

Not available for valve specification T1. In addition, the valve is used only as a 8. double solenoid for T2.

- 9
- Can be selected only when the manifold type is $\ensuremath{\textbf{A}}$
- 10. Can be selected only when the manifold type is AH.

11. Not available with DIN connectors (-39

Remark: Negative common specifications are also available as made to order products (add

-129W to the ends of the valve and manifold model order codes). For details, consult us.

Gasket (gasket and exhaust valve)

F18 Z - GS1

F18 BP

Individual air supply (Spacer for non-plug-in type, gasket, and exhaust spacer (exhaust valve, and 2 mounting screws)

Specification

- **NP8** : Individual air supply spacer (with ϕ 8 fitting)
- **NP0**: Individual air supply spacer (with ϕ 10 fitting)
- **NR8**: Individual exhaust spacer (with ϕ 8 fitting)
- **NR0**: Individual exhaust spacer (with ϕ 10 fitting)

*For details, see p. 25.
*Not available with DIN connectors (-39⁻).

Muffler


Fitting size

8: Outer diameter ϕ 8 (for individual exhaust spacer) 10: Outer diameter ϕ 10 (for individual exhaust spacer) (Sales unit: Set of 10 mufflers)



Connector-related order codes

Block-off plate (block-off plate and 2 mounting screws)

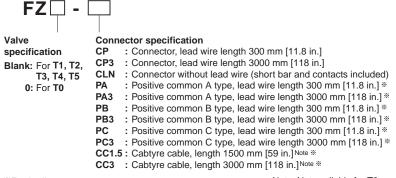

%For details, see p. 19

Note: Not available for T0

Common connector assembly

A type: FZ-PA *
Red Common wire (+) Black A side (-) White B side (-) (Insert when using as double solenoid) ^{Note}
B type: FZ-PB* Red Common wire (+) Black A side (-) White B side (-) (Insert when using as double solenoid) ^{Note}
C type: FZ-PC□*
Red Common wire (+) Black A side (-) White B side (-) (Insert when using as double solenoid) ^{Note} Red Common wire (+)
 % Lead wire length Blank: 300 mm [11.8 in.] Note: White lead wire is not 3: 3000 mm [118 in.] available for FZ0-P .

Manifold Order Code Example

(6 units of F18 Series)

F18M6AL

stn.1~2 F18T0-A1-PS-J5 DC24V stn.3~5 F18T2-A1-PS-J6 DC24V stn.6 F18BP-J6


Precautions for Order Codes

Manifold outlet specification

Select from among "dual use fitting blocks", "with female thread blocks" or "with selectable fittings." For repair or replacement, purchase the single valve unit additional parts, F18Z-J (dual use fitting block), F18Z-J (single use fitting block), or F18Z-M (female thread block), on p. 73.

Place orders from "F18 Series Single Valve Unit Order Codes" on p. 72. Note, however, that the only available valve outlet type is A1. In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.

F18 Series Monoblock Manifold F Type (Direct Piping Type) Order Codes

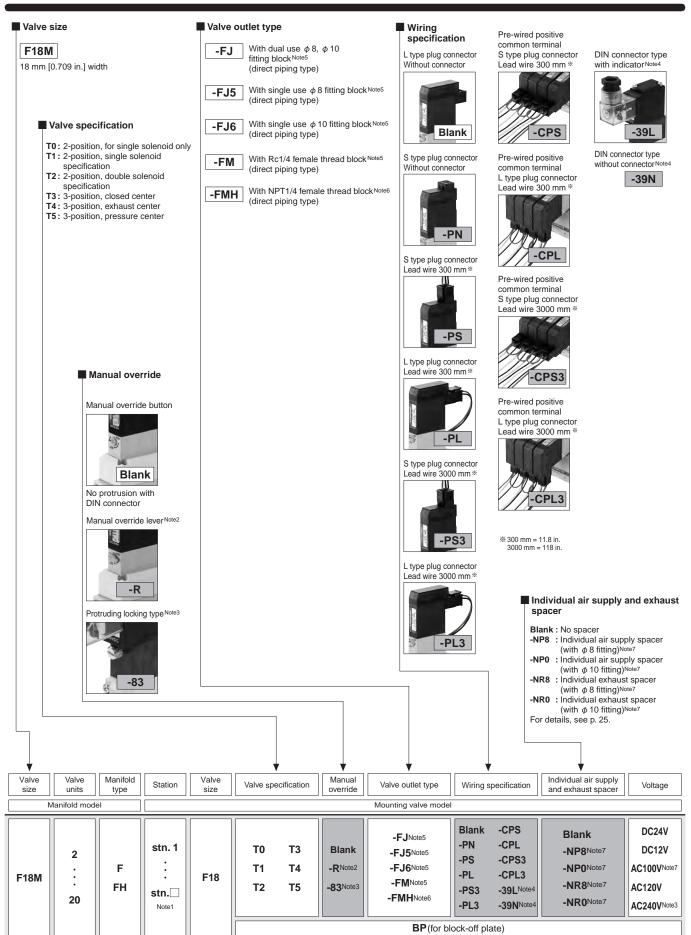

Notes: 1. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

2. When the valve specification is T1 or T2, the manual override lever is placed only on the A side. This is not available with -39 .

3. Only for wiring specification -39

76 KOGANEI

4. Not available for valve specification T1. In addition, the valve is used only as a double solenoid for T2.

- Can be selected only when the manifold type is F.
 Can be selected only when the manifold type is FH.
- 7. Not available with DIN connectors (-39).
- Remarks: 1. The external pilot valve cannot be mounted on the F type manifold.

2. Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us. Gasket (gasket and exhaust valve)

F18 Z - GS1

Individual air supply (Spacer for non-plug-in type, gasket, and exhaust spacer (exhaust valve, and 2 mounting screws)

Specification

- **NP8**: Individual air supply spacer (with ϕ 8 fitting)
- **NP0**: Individual air supply spacer (with ϕ 10 fitting)
- **NR8**: Individual exhaust spacer (with ϕ 8 fitting)
- **NR0**: Individual exhaust spacer (with ϕ 10 fitting)

Block-off plate (block-off plate and 2 mounting screws)

F18 BP

%For details, see p. 25. *Not available with DIN connectors (-39.).

Muffler

Fitting size

8: Outer diameter ϕ 8 (for individual exhaust spacer) **10:** Outer diameter ϕ 10 (for individual exhaust spacer) (Sales unit: Set of 10 mufflers)


ORDER CODES

Connector-related order codes

FZ 🖵 - L		
Valve	Conne	ector specification
specification	СР	: Connector, lead wire length 300 mm [11.8 in.]
Blank: For T1, T2,	CP3	: Connector, lead wire length 3000 mm [118 in.]
T3, T4, T5	CLN	: Connector without lead wire (short bar and contacts included)
0: For T0	PA	: Positive common A type, lead wire length 300 mm [11.8 in.] *
0.10110	PA3	: Positive common A type, lead wire length 3000 mm [118 in.] *
	PB	: Positive common B type, lead wire length 300 mm [11.8 in.] *
	PB3	: Positive common B type, lead wire length 3000 mm [118 in.] *
	PC	: Positive common C type, lead wire length 300 mm [11.8 in.] *
	PC3	: Positive common C type, lead wire length 3000 mm [118 in.] *
	CC1.5	: Cabtyre cable, length 1500 mm [59 in.] ^{Note}
	CC3	: Cabtyre cable, length 3000 mm [118 in.]Note **
%For details, see p. 19.		Note: Not available for T0

*For details, see p. 19.

Common connector assembly

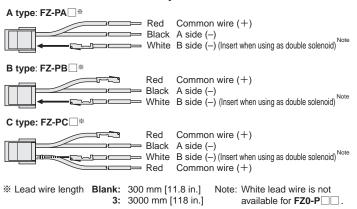

Manifold Order Code Example

(4 units of F18 Series)

F18M4F


- stn.1~2 F18T0-FJ5-PS DC24V
- stn.3 F18T2-FJ6-PS DC24V
- stn.4 F18BP

Precautions for Order Codes


Orders for valves only

Place orders from "F18 Series Single Valve Unit Order Codes" on p. 72. Select from valve outlet types -FJ, -FJ5, -FJ6, or -FM . In addition, for common terminal wiring connections, order the common connector assemblies listed above separately.

F18 Series Split Manifold Non-Plug-in Type Order Codes

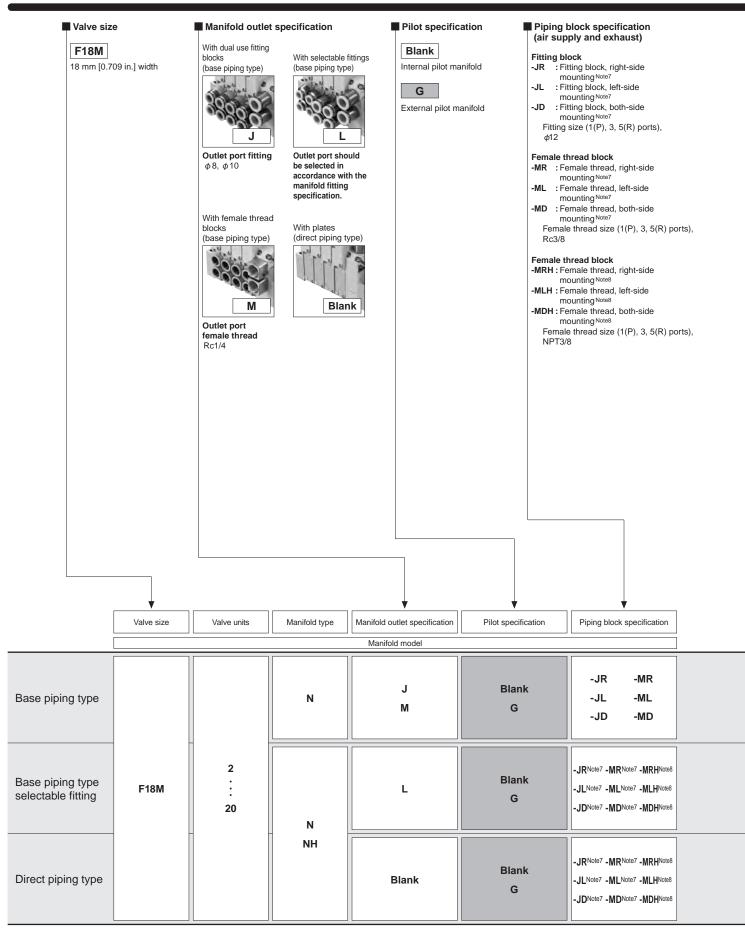

Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

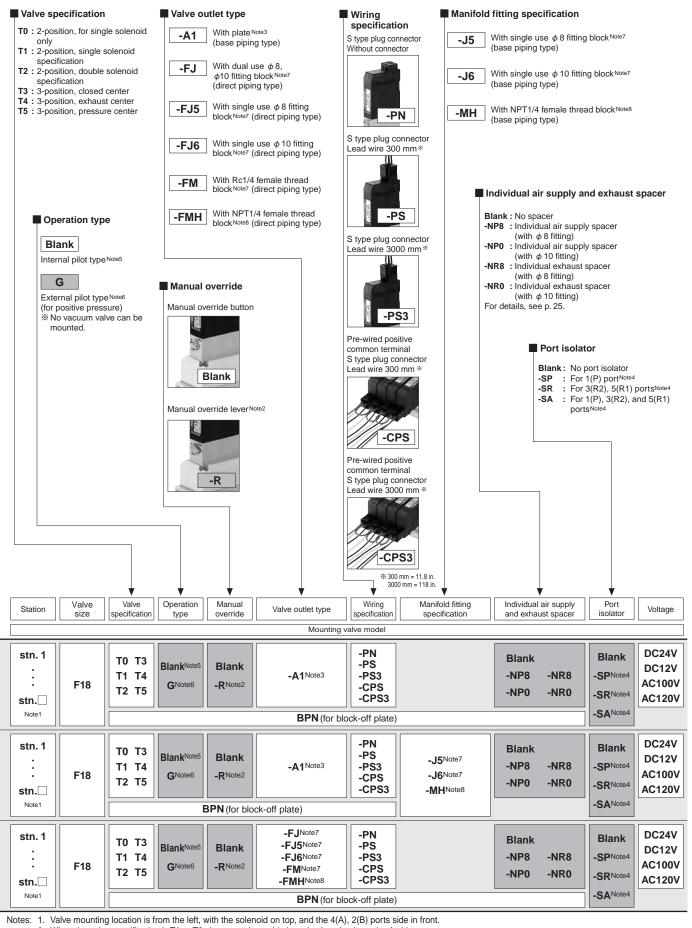

2. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

3. When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.


Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its 4. immediate left (the next smaller stn. No.).

Cannot be mounted on the external pilot manifold. 5.


Cannot be mounted on the internal pilot manifold. 6.

Can be selected only when the manifold type is N

8. Can be selected only when the manifold type is NH.

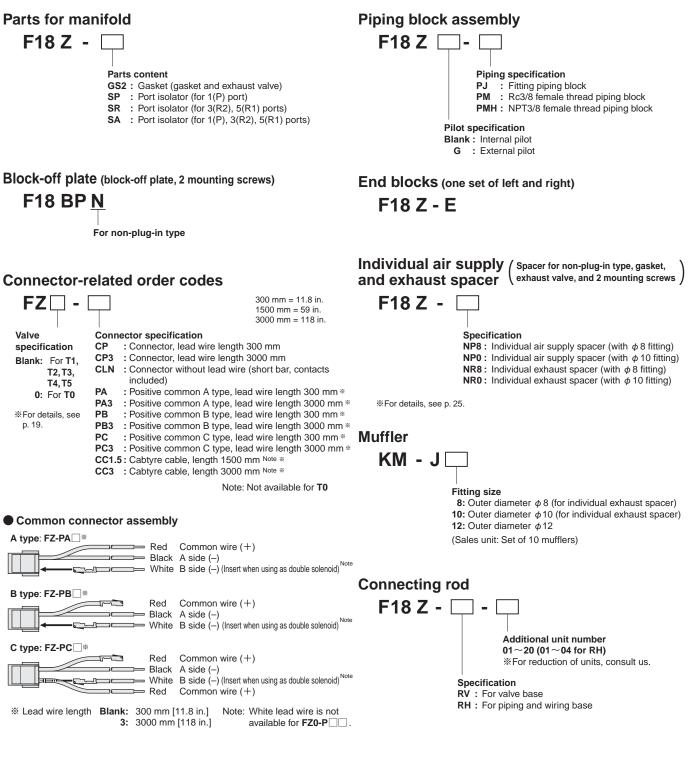

Valve base assembly (valve base and gasket)



Piping specification

- VJ : Dual use fitting valve base
- **VJ5** : Single use ϕ 8 fitting valve base
- **VJ6** : Single use ϕ 10 fitting valve base
- VM : Rc1/4 female thread valve base
- VMH : NPT1/4 female thread valve base
- VP : Valve base plate

Manifold Order Code Example (4 units of F18 Series)

F18M4NL-JR

stn.1~2 F18T0-A1-PS-J5 DC24V stn.3 F18T2-A1-PS-J6 DC24V stn.4 F18BPN-J6

Precautions for Order Codes

Orders for valves only


Place orders from "F18 Series Single Valve Unit Order Codes" on p. 72. However, **Blank**, **A2**, **F3**, **F4**, **F5**, and **F6**, cannot be selected for the valve outlet type. And for the wiring specification, **Blank**, **PL**, and **PL3** cannot be selected. In addition, for common terminal wiring connections, separately order the common connector assemblies listed on the left.

F18 Series Split Manifold Plug-in Type Order Codes

Manifold outlet spe	ecification	Pilot spec	cification		Wiring spec	cification (wiring	block)	Wiring connecti	on specification
	With selectable fittings (base piping type)	Blank Internal pilo G External pilo			Flat cable conr (with socket an		1	rr sj -W Double wiring: V	ccordance with the iounted valve pecifications. /iring is always for
φ8, φ10 I	Outlet port should be selected in accordance with the manifold fitting specification.	(air s	ng block spe supply and e g block		-F100 : 10-pin -F101 : 10-pin -F200 : 20-pin -F201 : 20-pin -F260 : 26-pin			s re s	e double olenoid, gardless of the pecifications of the mounted valve.
	Yith plates direct piping type) Item (Internet internet i	-JR -JL -JD Fitt \$41 -MR -MR -ML -MD Fermal -MRH -MCH -MCH Fer	Fitting block, mounting Note : Fitting block, mounting Note : Fitting block, mounting Note : Fitting block, mounting Note : Female threat mounting Note : Female threat mounting Note : Female threat sits), Rc3/8 Ie thread bloc : Female threat mounting Note : Female threat : Female threat : Female threat : Female threat : Female threat mounting Note : Female threat mounting Note : Female threat mounting Note	 left-side left-side both-side 3, 5(R) ports), ck ad, right-side ad, left-side tad, both-side ck (1(P), 3, 5(R)) ck ad, right-side ad, left-side ad, left-side ad, left-side ad, left-side ad, left-side ad, both-side 	For details, see D-sub connect -D25 (M2.6 mountin screws) -D250 : 25- -D251 : 25- (4-40UNC mou screws) -D250U : 25- -D251U : 25- -D370NU : 37- -D370NU	rerminal b (19 termin screws)	als, M3	-R : F	block)
Valve	size Valve units	Manifold	Manifold outlet	Pilot	Piping block	Wiring specificatio	▼ Wiring connecti	ion Wiring	Voltage
Valve		type	specification	specification	specification anifold model	wining specification	specification	position	vollage
ase ping type		Р	J M	Blank G	-JR -MR -JL -ML -JD -MD	-F100 -D250 -F101 -D250 -F200 -T200 -F201 -F260	1 Blank	Blank -R	DC24V DC12V AC100V ^{Note2} AC120V ^{Note2}
ase ping type electable ting	M	P	L	Blank G	JR Note11 -MDNote11 JL Note11 -MRHNote12 JDNote11 -MLHNote12 MRNote11 -MDHNote12 MRNote11 -MDHNote12 MLNote11 -MDHNote12	-F100 -D251Note -F101 -D250UNote -F200 -D251UNote -F201 -D370NUNa -F260 -T200 -D250Note11	12 Blank	Blank -R	DC24V DC12V AC100V ^{Note2} AC120V ^{Note2}
irect ping type		PH	Blank	Blank G	JRNote11 -MDNote11 JLNote11 -MRHNote12 JDNote11 -MLHNote12 MRNote11 -MDHNote12 MRNote11 -MDHNote12 MRNote11 -MDHNote12	-F100 -D251Note -F101 -D250UNde -F200 -D251UNde -F201 -D370NUNd -F260 -T200 -D250Note11	12 Blank	Blank -R	DC24V DC12V AC100VNote2 AC120VNote2

Notes: 1. For the maximum number of units, see the table for maximum number of valve units by wiring specification, on p. 84.
2. AC100V, AC120V is available only for the -D250 , -D251 , -D370NU (D-sub connector) and -T200 (terminal block) wiring specifications.
3. The terminal block with cover is also available as a made to order product (add -139W to the end of the manifold model order code). For details, consult us.

Remark: Negative common specifications are also available as made to order products (add -129W to the ends of the valve and manifold model order codes). For details, consult us.

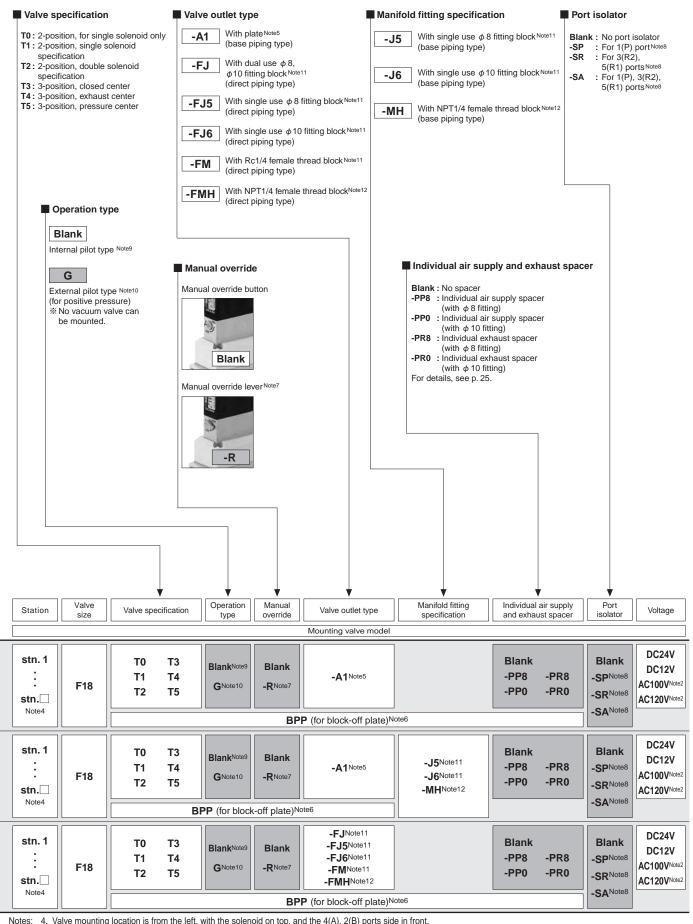

4. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

5. When selecting J, M, or L (base piping type) for the manifold outlet specification, always enter -A1 (with plate) for the valve outlet type.

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For 6.

wiring for a single solenoid, see p. 85. 7. When the valve specification is **T1** or **T2**, the manual override lever is placed only on the A side.

8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate

left (the next smaller stn. No.).

9. Cannot be mounted on the external pilot manifold. 10. Cannot be mounted on the internal pilot manifold.

11. Can be selected only when the manifold type is P. 12. Can be selected only when the manifold type is PH.

Parts for manifold

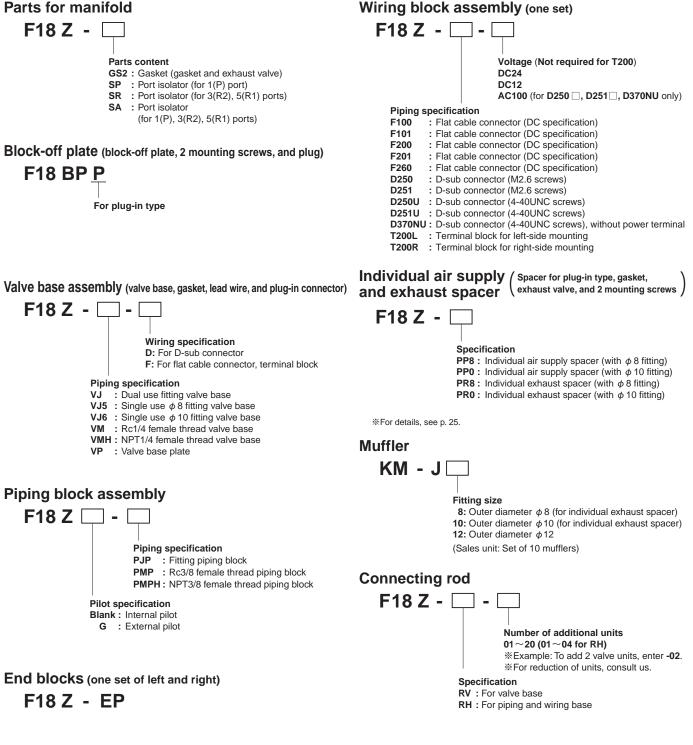


Table for maximum number of valve units by wiring specification

		Maximum num	ber of units		
	Wiring connection specification				
Wiring specification	Max. outputs	Packed wiring (Blank)	Double wiring (-W)		
F100 Flat cable (10P)	8	Varies depending on	4 units		
F101 Flat cable (10P)	8	the number of mounted	4 units		
F200 Flat cable (20P)	16	single solenoids, double solenoids, and	8 units		
F201 Flat cable (20P)	16	block-off plates. The	8 units		
F260 Flat cable (26P)	20	number of controlled solenoids should be	10 units		
D250 D-sub connector (25P)	16	designated as the	8 units		
D251 D-sub connector (25P)	20	maximum number of outputs or less.	10 units		
D370NU D-sub connector (37P)	32	D370NU is a maximum	16 units		
T200 Terminal block (19 terminals)	18	of 20 units.	9 units		

ORDER CODES

Manifold Order Code Example (12 units of F18 Series)

F18M12PL-JR-F201 DC24V

stn.1~8 F18T0-A1-J5 DC24V

stn.9~11 F18T2-A1-J6 DC24V stn.12 F18BPP-J6

Precautions for Order Codes

Orders for valves only

Place orders from "F18 Series Single Valve Unit Order Codes" on p. 72. However, **Blank**, A2, **F3**, F4, **F5**, and F6 cannot be selected for the valve outlet type. For the wiring specification, **Blank** is the only selection.

• Wiring connection specification


Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution


Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us.

F18 Series Serial Transmission Compatible Manifold Order Codes

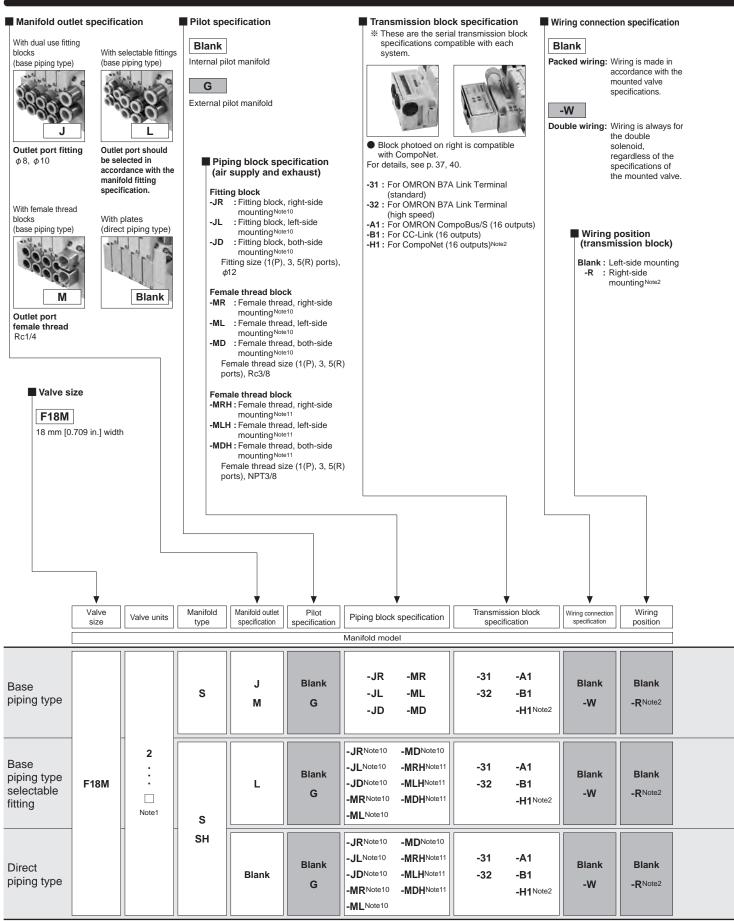

Notes: 1. To determine the maximum number of units, see the table for maximum number of valve units by transmission block specification, on p. 88.

2. The -H1 (for CompoNet (16 outputs)) transmission block is mountable on the left side only.

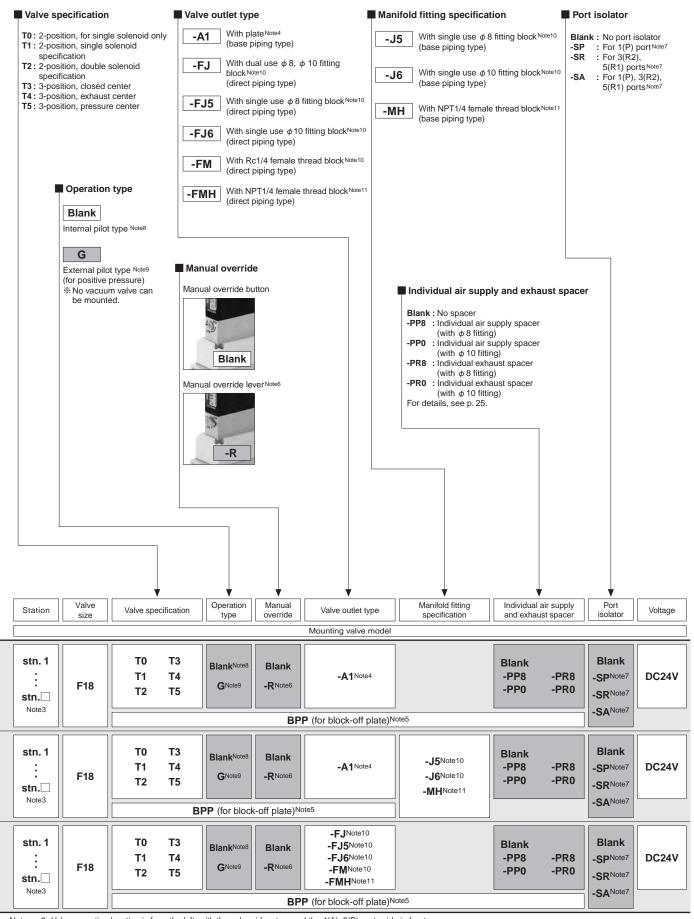

Notes: 3. Valve mounting location is from the left, with the solenoid on top, and the 4(A), 2(B) ports side in front.

4. When selecting J, M, or L (base piping type) for the manifold outlet specifications, always enter -A1 (with plate) for the valve outlet type.

5. Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 stn.), regardless of the wiring connection specification. For wiring for a single solenoid, see p. 88.

6. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

7. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).

Cannot be mounted on the external pilot manifold.

9. Cannot be mounted on the internal pilot manifold.

11. Can be selected only when the manifold type is SH.

^{10.} Can be selected only when the manifold type is S.

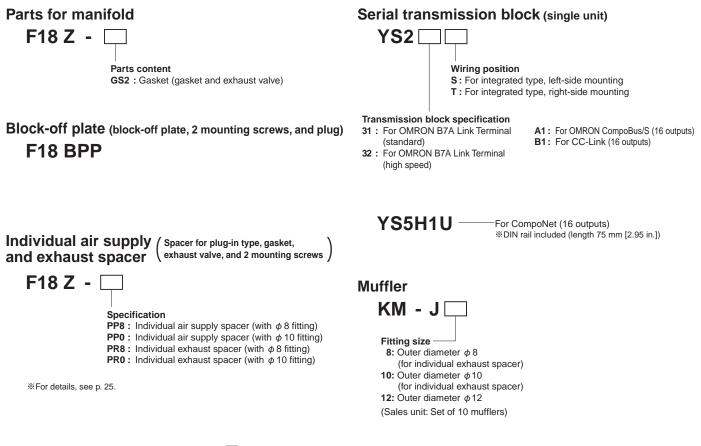


Table for maximum number of valve units by transmission block specification

		Maximum number o	of units
		Wiring connection spe	cification
Transmission block specifications	Max. outputs	Packed wiring (Blank)	Double wiring (-W)
-31 : For OMRON B7A Link Terminal (standard)	16	Varies depending on the number of mounted single	8 units
-32 : For OMRON B7A Link Terminal (high speed)	16	solenoids, double solenoids,	8 units
-A1 : For OMRON CompoBus/S (16 outputs)	16	and block-off plates. The number of controlled	8 units
-B1 : For CC-Link (16 outputs)	16	solenoids should be	8 units
-H1 : For CompoNet (16 outputs)	16	designated as the maximum number of outputs or less.	8 units

Manifold Order Code Example

(8 units of F18 Series)

F18M8SL-JR-B1-W

- stn.1~5 F18T0-A1-J5 DC24V
- stn.6~7 F18T2-A1-J6 DC24V
- stn.8 F18BPP-J6

Precautions for Order Codes

Orders for valves only

Place orders from "F18 Series Single Valve Unit Order Codes" on p. 72. However, Blank, A2 , F3, F4 , F5, and F6, cannot be selected for the valve outlet type. For the wiring specification, Blank is the only selection.

Wiring connection specification

Blank (packed wiring): Wiring is made in accordance with the mounted valve specifications.

-W (double wiring): Wiring is always for the double solenoid, regardless of the specifications of the mounted valve.

Caution

Caution should be exercised that the block-off plate wiring is always double wiring (allocated 2 control pins at 1 str.), regardless of the wiring connection specification. The block-off plate wiring can be made as wiring for a single solenoid. Add -1W to the end of the block-off plate order code in the case. For details, consult us.

Flat cable connector (20-pin)


• -F200 (Maximum number of control pins: 16)

										Trian	gle ma ▽	ark
						-						
L	1	9	17		13		9	7	5	3	1	
I	2	20	18	16	14	12	10	8	6	4	2	

$1 \sim 16$: Control pins 17, 18 : (-) pins (Short-circuited inside)

- 19, 20 : (+) pins (Short-circuited inside)
- •-F201 (Maximum number of control pins: 16) Triangle mark

_										∇	
Г					-						-
	11	12	13	14	15	16	17	18	19	20	
	1	2	3	4	5	6	7	8	9	10	
L											



- $1 \sim 8$: Control pins
- 11 ~ 18 : Control pins

9, 19 : (-) pins (Short-circuited inside)

10, 20 : (+) pins (Short-circuited inside)

Caution : Connector pin numbers are assigned for the sake of convenience. Use the \bigtriangledown mark as the reference.


Remark : The -F201 corresponds to Koganei's pin locations for the PC wiring system (wire-saving unit). For details, see the Valves General Catalog.

Remark: Socket and strain relief for flat cable are included at shipping.

* For the relationship between the pin No. (terminal No.) and the corresponding solenoid, see p.91.

Detailed Diagram of Wiring System

Positive common

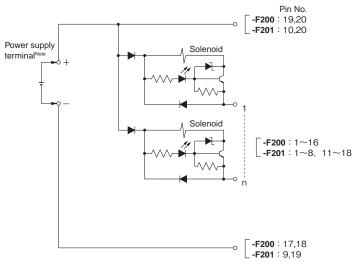

Note: For connecting a power line to the PC board manifold power terminal, see the "PC Board Manifold" precautions on p.21.


Remark: The internal circuit is of the standard type. For details of the low-current type, see p.20, 21.

Pin No. and Corresponding Solenoid (For PC Board Manifold A Type and F Type)

The examples below show the relationship between the PC board manifold pin No. and the corresponding solenoid. All the mounting examples show cases of the maximum number of control pins used.


Flat cable connector (20-pin)

In the case of wiring specification -F200 (Maximum number of control pins: 16)

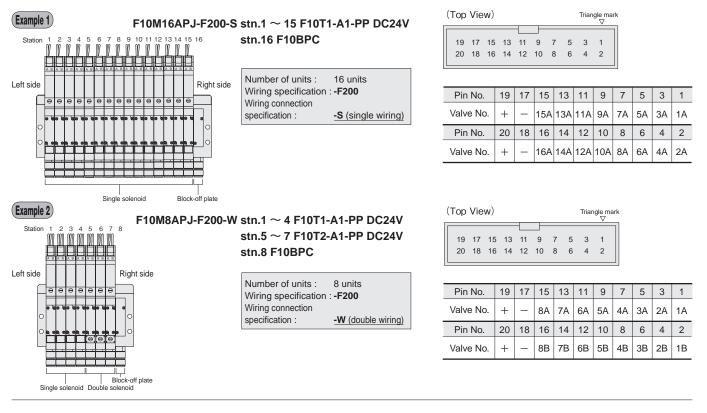


Flat cable connector (20-pin)

In the case of wiring specification -F201 (Maximum number of control pins: 16)

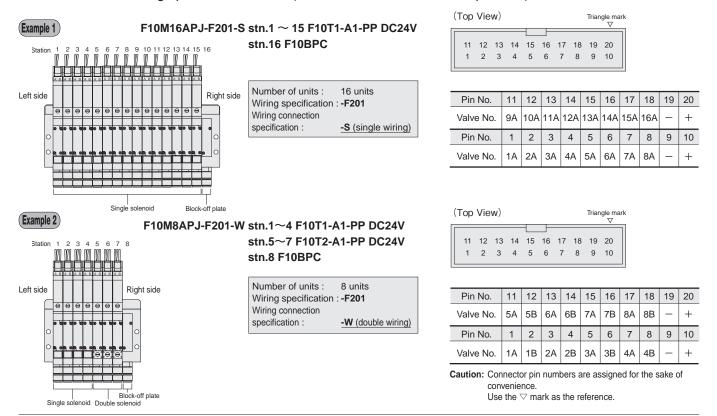

Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid. 2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.

For Monoblock Manifold A Type and F Type Wire-Saving Type, Split Manifold Plug-in Type

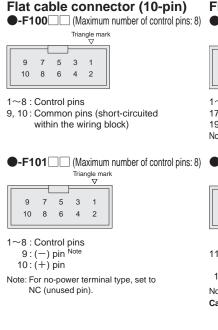

Flat cable connector (26-pin)


●-F260 (Maximum number of control pins: 20)

Triangle mark

_													∇
1						-L							
Π	25	23	21	19	17	15	13	11	9	7	5	3	1 2
Π	26	24	22	20	18	16	14	12	10	8	6	4	2

1~20 : Control pins

23, 24 : (-) pins (short-circuited within the wiring block)Note 25, 26 : (+) pins (short-circuited within the wiring block) Note: For no-power terminal type, set to NC (unused pin).







1~16 : Control pins

17, 18 : (-) pins (short-circuited within the wiring block)^{Note} 19, 20 : (+) pins (short-circuited within the wiring block) Note: For no-power terminal type, set to NC (unused pin).

Generation of control pins: 8)
 Generation (Maximum number of control pins: 16)

_									Trian	gle m ▽	ark
	11	12	13	14	-L 15	16	17	18	19	20	
	1	2	3	4	5	6	7	8	9	10	

1~8: Control pins

- 11~18: Control pins
- 9, 19: (-) pins (short-circuited within the wiring block)Note
- 10, 20: (+) pins (short-circuited within the wiring block)

Note: For no-power terminal type, set to NC (unused pin).

Caution: Connector pin numbers are assigned for the

sake of convenience. Use the \bigtriangledown mark as the reference.

Remark : The -F201 corresponds to Koganei's pin locations for the PC wiring system (wire-saving unit). For details, see the Valves General Catalog.

D-sub connector (25-pin)

D250
 (Maximum number of control pins: 16)



1~16: Control pins

20, 21, 22: (-) pins (short-circuited within the wiring block)Note 23, 24, 25: (+) pins (short-circuited within the wiring block) Note: For no-power terminal type, set to NC (unused pin).

Caution: The above pin numbers are assigned based on the solenoid valve wiring sequence for the sake of convenience.

They differ from the pin locations and pin numbers (marking) prescribed (JIS-X5101) for the Data Circuitterminating Equipment (DCE).

D251 Pin locations based on JIS (Maximum number of control pins: 20)



1~10, 14~23 : Control pins

12, 13: (-) pins (short-circuited within the wiring block)^{Note} 24, 25 : (+) pins (short-circuited within the wiring block) Note: For no-power terminal type, set to NC (unused pin).

D-sub connector (37-pin)

D370NU (Maximum number of control pins: 32)



1~32 : Control pin

36, 37 : Common pin (For positive common)

Caution: The above pin numbers are assigned based on the solenoid valve wiring sequence for the sake of convenience.

They differ from the pin locations and pin numbers (marking) prescribed (JIS-X5103) for the Data Circuit- terminating Equipment (DCE).

Terminal block type (19 terminals, M3 screws) T200 (Maximum number of control pins: 18)

	1	~	3	Ę	5		7	ç	9	1	1	1	3	1	5	1	7	СС	DM
_	2	2	4	ŀ	6	6	8	3	1	0	1	2	14	4	1	6	1	8	


1~18 : Control terminals

COM : Common terminal


Caution: Apply the tightening torque for the terminal screw (M3) to 49.0 N · cm [4.3 in · lbf] or less.

% For the relationship between the pin No.(terminal No.) and the corresponding solenoid, see p. 97-102.


Flat cable connector and D-sub connector (12VDC and 24VDC)

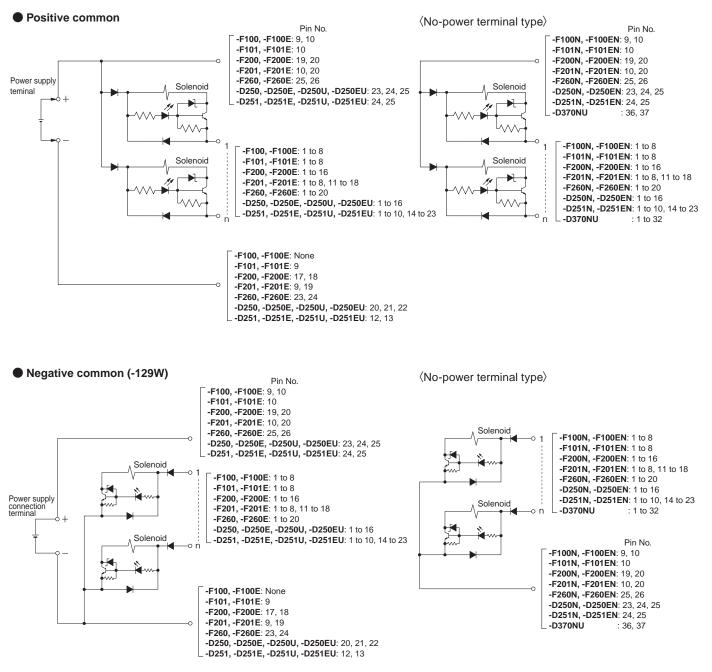


D-sub connector (For 100VAC and 120VAC specification)

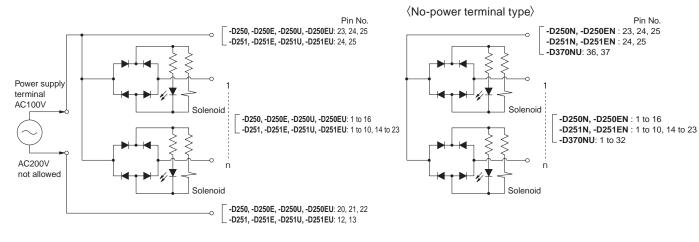


Terminal block (For 12VDC and 24VDC specifications)

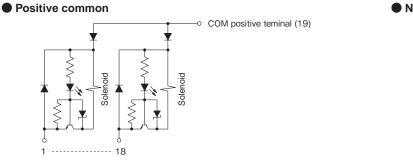






Terminal block (For 100VAC and 120VAC specification)





Remark: The internal circuit is of the standard type. For details of the low-current type, see p.20, 21.

Flat cable connector and D-sub connector (12VDC and 24VDC)

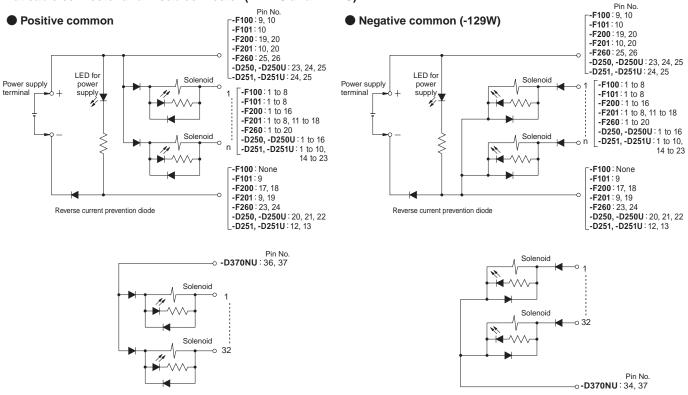


D-sub connector (For 100VAC and 120VAC specification)

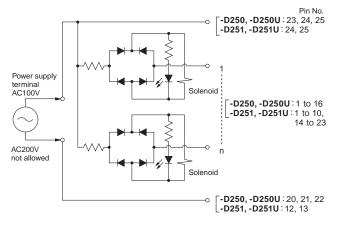




Terminal block (For 12VDC and 24VDC specifications)

Positive common








- COM negative terminal (19)


Terminal block (For 100VAC and 120VAC specification)



The examples below show the relationship between the split manifold pin No. (terminal No.) and the corresponding solenoid. This is the same for monoblock manifold A type wire-saving type, and monoblock manifold F type wire-saving type. All the mounting examples show cases of the maximum number of control pins used.


Flat cable connector (10-pin)

In the case of wiring specification -F100 (Maximum number of control pins: 8)

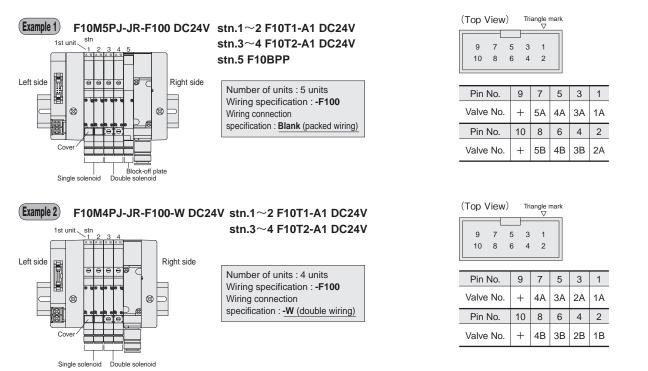

Flat cable connector (10-pin)

In the case of wiring specification -F101 [...] (Maximum number of control pins: 8)

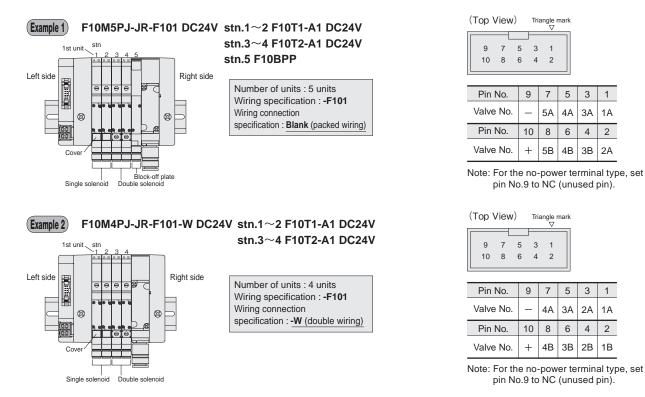

Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.

- 2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front. 3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.
- 4. Caution should be exercised that the block-off plate is always double wiring (allocated 2 control pins to 1 unit), regardless of the wiring connection specifications.
- 5. Connector pin numbers are assigned for the sake of convenience. Use the \bigtriangledown mark as the reference.

1

1A

2

2A

1

1A

2


1B

Pin No. (Terminal No.) and Corresponding Solenoid (For Monoblock Manifold A Type and F Type)

The examples below show the relationship between the split manifold pin No. (terminal No.) and the corresponding solenoid. This is the same for monoblock manifold A type wire-saving type, and monoblock manifold F type wire-saving type. All the mounting examples show cases of the maximum number of control pins used.


Flat cable connector (20-pin)

● In the case of wiring specification **-F200** (Maximum number of control pins: 16)

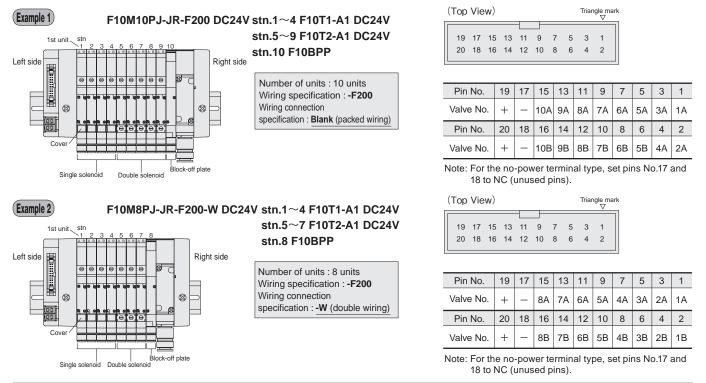

Flat cable connector (20-pin)

● In the case of wiring specification **-F201** (Maximum number of control pins: 16)

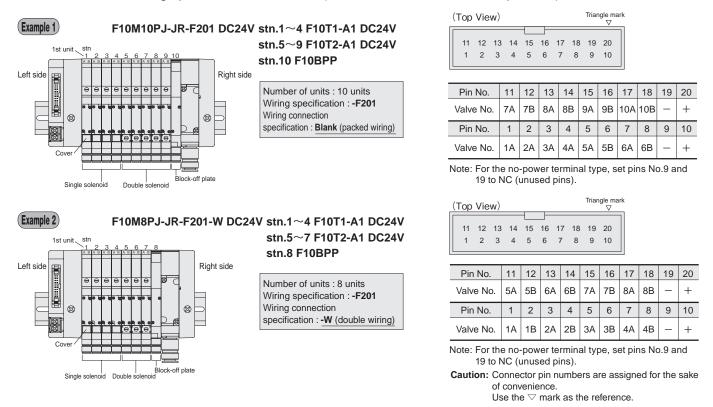

Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.


2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.

- 3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.
- Caution should be exercised that the block-off plate is always double wiring (allocated 2 control pins to 1 unit), regardless of the wiring connection specifications.
- 5. Connector pin numbers are assigned for the sake of convenience. Use the \bigtriangledown mark as the reference.

The examples below show the relationship between the split manifold pin No. (terminal No.) and the corresponding solenoid. This is the same for monoblock manifold A type wire-saving type, and monoblock manifold F type wire-saving type. All the mounting examples show cases of the maximum number of control pins used.

Flat cable connector (26-pin)

● In the case of wiring specification **-F260** (Maximum number of control pins: 20)

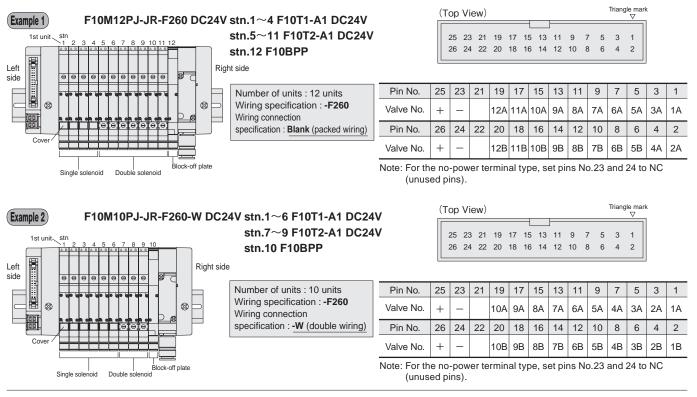

Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.

2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.


3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.

4. Caution should be exercised that the block-off plate is always double wiring (allocated 2 control pins to 1 unit), regardless of the wiring connection specifications.

5. Connector pin numbers are assigned for the sake of convenience. Use the \bigtriangledown mark as the reference.

Pin No. (Terminal No.) and Corresponding Solenoid (For Monoblock Manifold A Type and F Type Wire-Saving Type, Split Manifold Plug-in Type)

The examples below show the relationship between the split manifold pin No. (terminal No.) and the corresponding solenoid. This is the same for monoblock manifold A type wire-saving type, and monoblock manifold F type wire-saving type. All the mounting examples show cases of the maximum number of control pins used.

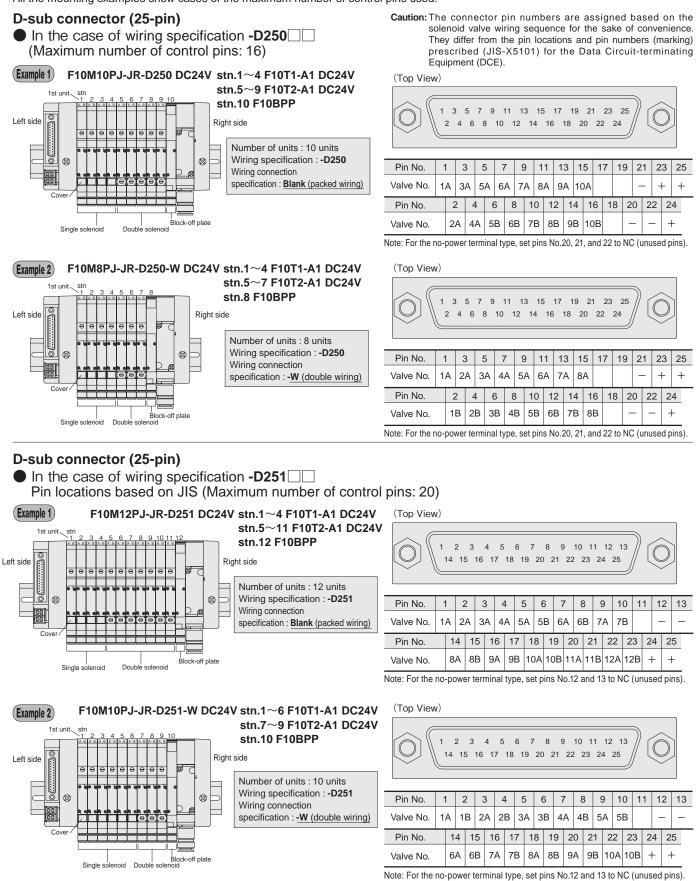


Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.

- 2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.
- 3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.

4. Caution should be exercised that the block-off plate is always double wiring (allocated 2 control pins to 1 unit), regardless of the wiring connection specifications.

Pin No. (Terminal No.) and Corresponding Solenoid (For Split Manifold Plug-in Type)

The examples below show the relationship between the split manifold pin numbers and the corresponding solenoids. All the mounting examples show cases of the maximum number of control pins used.

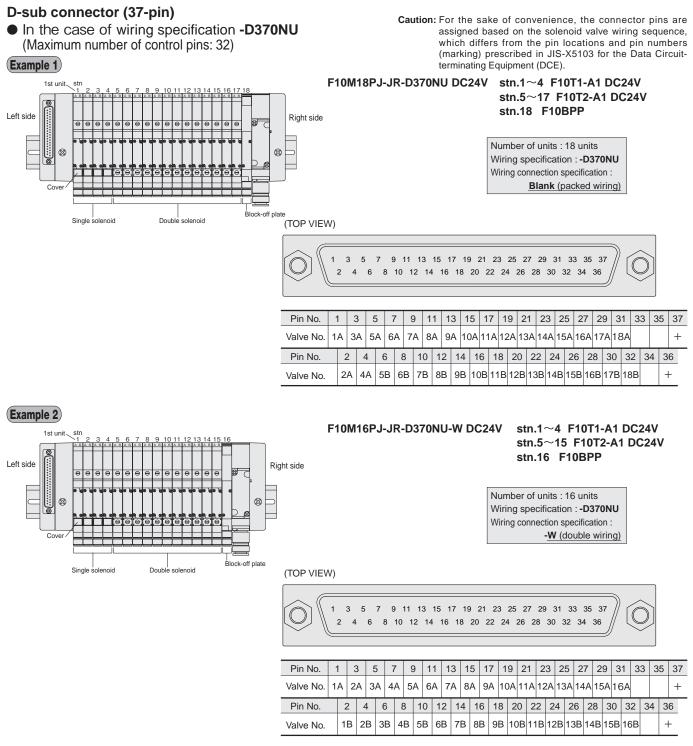

Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.

- 2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.
- 3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.


4. Caution should be exercised that the block-off plate is always double wiring (allocated 2 control pins to 1 unit), regardless of the wiring connection specifications.

Pin No. (Terminal No.) and Corresponding Solenoid (For Split Manifold Plug-in Type)

The examples below show the relationship between the split manifold terminal No. and the corresponding solenoid. All the mounting examples show cases of the maximum number of control pins used.

Terminal block type (19 terminals, M3 screws)

In the case of wiring specification -T200 (Maximum number of control pins: 18)

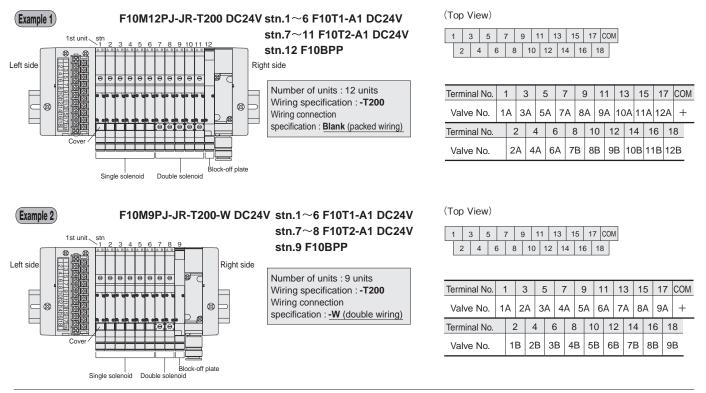

Notes: 1. The valve No.1A, 1B, 2A, 2B... numerals show the stn. numbers in order, while the letters A and B show the A and B sides of the solenoid.


2. The stn. numbers are counted from the left, 1, 2..., with the solenoid on top and the valve in front.


3. When selecting wiring connection specification -W, all wiring becomes double wiring, regardless of valve specifications.

4. Caution should be exercised that the block-off plate is always double wiring (allocated 2 control terminals to 1 unit), regardless of the wiring connection specifications.

F Series Cable Assembly by Wiring Specification

A dedicated cable assembly is provided for each wiring specification.

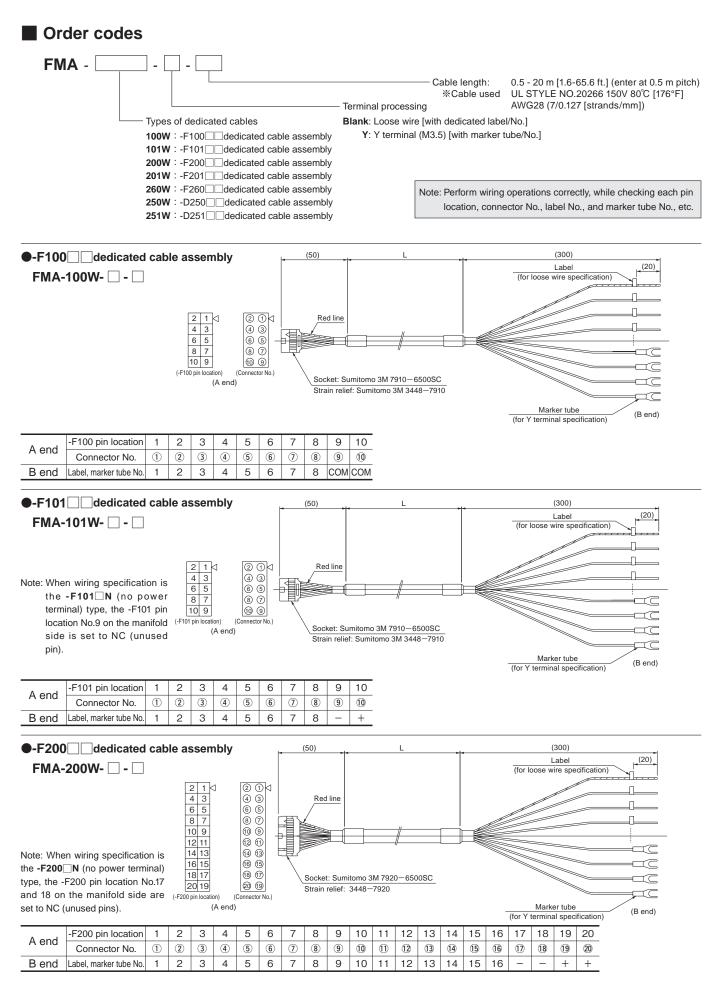


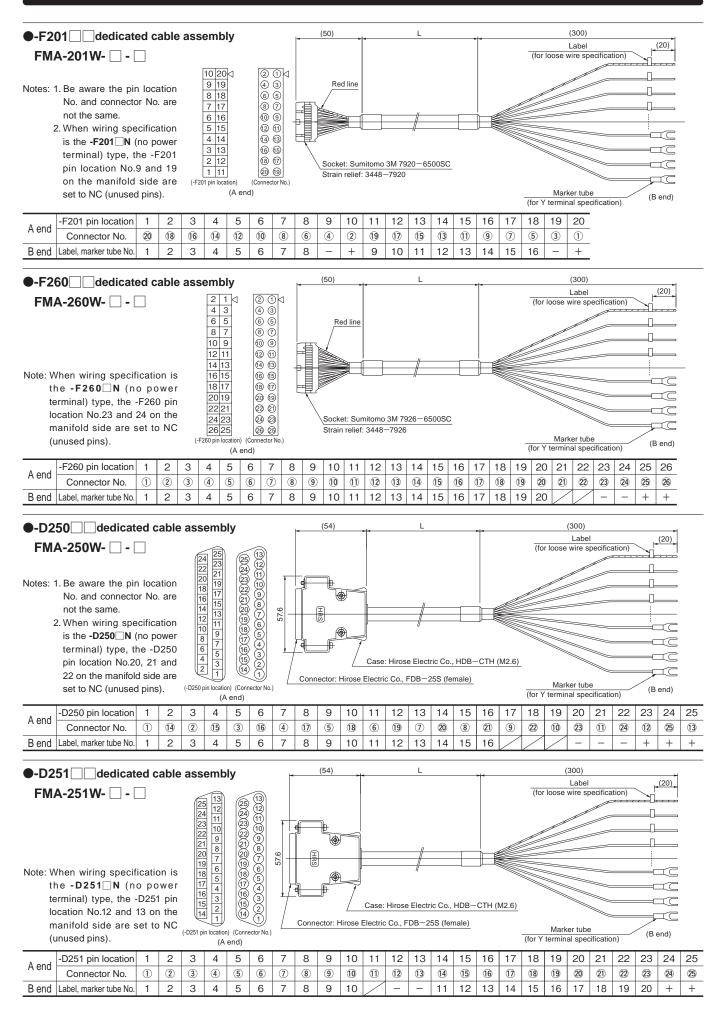

SOLENOID VALVES F10 series

Contents

Specifications ————	106
Dimensions of Single Valve Unit	111
Dimensions of Monoblock Manifold	114
Dimensions of Monoblock Manifold, Wire-saving Type	117
Dimensions of PC Board Manifold	119
Dimensions of Split Manifold Non-plug-in Type	120
Dimensions of Split Manifold Plug-in Type	122
Dimensions of Serial Transmission Compatible Manifold —	131

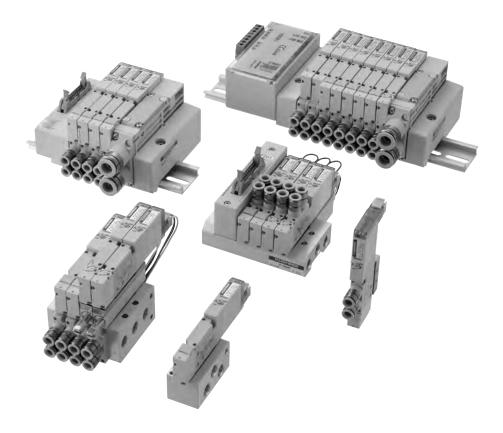

F10 SERIES Specifications

Specifications

Basic Models and Valve Functions

Basic model	F10T0	F10⊡T1 F10⊡T2	F10□T3 F10□T4 F10□T5	F10□TA F10□TB F10□TC
Number of positions	2 pos	itions	3 positions	4 positions
Number of ports		5		Tandem 3-port
Valve function	Single solenoid only	Both single and double solenoid use	Closed center, Exhaust center, Pressure center	NC/NC, NO/NO, NC/NO

Remark: For the optional specifications and order codes, see p.44-71.

Specifications

Item		Basic model	F10□T0 F10□T1 F10□T2	F10□T3 F10□T4 F10□T5	F10□TA F10□TB F10□TC	F10 T0G F10T1G F10T2G	F10 T3G F10 _ _T4G F10 _ _T5G	F10□T0V F10□T1V F10□T2V	F10□T3V		
Media			Air								
Operatio	on type		Internal pilot type			External pilot type (for positive pressure)		External pilot type (for vacuum)			
Flow rate	Sonic conductance C dm3/(s · bar) Note1		0.97	0.93	0.75	0.97	0.93	0.97	0.93		
characteristics	Effective area *	Note2 mm ² (Cv)	4.8 (0.27)	4.6 (0.25)	3.7 (0.21)	4.8 [0.27]	4.6 (0.25)	4.8 [0.27]	4.6 [0.25]		
Port size	Note3		M5×0.8, 10-32UNF, dual use fitting for ϕ 4 and ϕ 6, Rc1/8, NPT1/8								
Lubricati	ion		Not required								
Operating pressure range		Main valve	0.2~0.7 MPa [29~102 psi.]			0~0.7 MPa [0^	~102 psi.] ^{Note4}	-100 kPa~0.15 MPa [-29.53 in.Hg~22 psi.]			
		External pilot				0.2~0.7 MPa [29~102 psi.] Note4		0.2~0.7 MPa [29~102 psi.]			
Proof pressure MPa [psi.]			1.05 [152]								
Response time Note5 ON/OFF MS		12VDC, 24VDC	15/15(20) or below	15/20 (25) or below	15/20 (25) or below	15/15 (20) or below	15/20 (25) or below	15/15 (20) or below	15/20 (25) or below		
		100VAC	15/15 or below	15/20 or below		15/15 or below	15/20 or below	15/15 or below	15/20 or below		
Maximur	m operating f	requency Hz	5								
Minimum t	time to energize	for self holding Note6 ms	50			50		50			
Operating temperature range (atmosphere and media) °C [°F]			5~50 [41~122]								
Shock resistance m/s ² [G]			294.2 [30]								
Mounting direction			Any								

Notes: 1. For details, see the flow rate characteristics on p.108. 2. The effective area is a calculated value, and not a measured value.

3. For details, see the port size on p.107.

4. When the main valve pressure is 0.2~0.7 MPa [29~102 psi.], set the external pilot pressure to the main valve pressure or higher, and 0.7 MPa [102 psi.] or less.

Remark: Specification values are based on Koganei test standards.

Notes: 5. Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center. Values in parentheses () are for low-current type.

6. When used as a double solenoid valve. Excludes T0.

Solenoid Specifications


Rated voltage		12VDC	24VDC (Standard type)	24VDC (Low-current type)	100VAC		120VAC			
Voltage range	v	10.8~13.2 (12±10%)	21.6~26.4 (24±10%)	21.6~26.4 (24±10%)	90~110 (100±10%)		108~132 (120±10%)			
Rated frequency	Hz	_	_	—	50	60	50	60		
Current (when rated voltage is applied) mA (when rated voltage is applied) mA (r.m.s)		17	_	8		8.3			
Power consumption	Imption W		0.4	—	0.8 VA		1 VA			
은 Current Starting			_	17			—			
(when rated voltage is applied) Holding	mA	—		4.2	_	_				
Current (when rated voltage is applied) Holding Power consumption Starting Holding Starting time (standard)	W			0.4			—			
Holding	W	—	—	0.1						
Starting time (standard)	ms	_	—	70	-	-	-	_		
Allowable leakage current	mA	2.0	1.0	1.0	1.0		1.0			
Type of insulation		Туре В								
Insulation resistance Note1	MΩ	Over 100								
Color of LED indicator Note2		14(SA) : Red, 12(SB) : Green								
Surge suppression (as standard)		Surge absorp	tion transistor	Flywheel diode	Bridge diode					

Notes: 1. Value at 500VDC megger.

2. The color of the **T0** indicator is red only.

Remark: Specification values are based on Koganei test standards.

How to obtain cylinder speed Maximum operating speed mm/s 1200 Cylinder stroke 1000 Maximum operating speed 800 φ20 [0.787 in.] φ25 [0.984 in.] φ32 [1.260 in.] φ40 [1.575 in.] φ40 600 400 t1 t2 t3 Time φ50 [1.969 in.] 200 Cylinder stops Solenoid valve Cylinder starts Cushion impact energized C 60 10 20 30 40 50 70 Load ratio 1 mm/s = 0.0394 in./sec. **Measuring conditions Delay time** ●Air pressure : 0.5 MPa [73 psi.] s 1.0 0.9 Piping (outer diameter × inner diameter × length) : $\phi 6 \times \phi 4 \times 1000$ mm [39 in.] 0.8 0.7 ●Fitting: Quick fitting TS6-01 Delay time 0.6 0.5 0.4 0.3 0.2 Load •Load ratio= Cylinder theoretical thrust (%) φ50 [1.969 in.] φ32 [1.260 in.] ,φ40 [1.575 in.] φ25 [0.984 in.] φ20 [0.787 in.] Cylinder stroke : 150 mm [5.91 in.] Load 0.1 0 10 20 30 40 50 60 70 Load ratio 0.5 MPa [73 psi.] Note: Delay time may vary according to the cylinder stroke.



1 MPa = 145 psi., 1 ℓ /min = 0.0353 ft.³/min.

How to read the graph

When the supply pressure is 0.5 MPa [73 psi.] and flow rate is 240ℓ /min [8.47 ft.³/min.] (ANR), the valve outlet pressure becomes 0.4 MPa [58 psi.].

Port Size

Description/Piping specification PR X (P2) 4(A), 2(B) 1(P), 3(R2), 5(R1), 3, 5(R) With sub-base M5×0.8, 10-32UNF M5×0.8, 10-32UNF Rc1/8, NPT1/8 Rc1/8, NPT1/8 M5×0.8, 10-32UNF M5×0.8, 10-32UNF With female thread block Single unit With dual use fitting block Dual use fitting for $\phi 4$ and $\phi 6$ M5×0.8, 10-32UNF M5×0.8, 10-32UNF With single use fitting block $\phi 4 \text{ or } \phi 6$ Rc1/8, NPT1/8 M5×0.8, 10-32UNF Monoblock type with female thread block, and PC board type with female thread block M5×0.8, 10-32UNF M5×0.8, 10-32UNF Dual use fitting for $\phi 4$ and $\phi 6$ Rc1/8, NPT1/8 Monoblock type with fitting block, and PC board type with fitting block M5×0.8, 10-32UNF M5×0.8, 10-32UNF Manifold M5×0.8, 10-32UNF M5×0.8, 10-32UNF Rc1/8, NPT1/8 Monoblock type with single use fitting block, and PC board type with single use fitting block $\phi 4 \text{ or } \phi 6$ M5×0.8, 10-32UNF M5×0.8, 10-32UNF Rc1/4, NPT1/4 Split type with female thread block, and serial transmission type with female thread block Split type with fitting block, and serial transmission type with fitting block M5×0.8, 10-32UNF Dual use fitting for $\phi 4$ and $\phi 6$ Dual use fitting for $\phi 8$ and $\phi 10$ _ Split type with single use fitting block, and serial transmission type with single use fitting block M5×0.8, 10-32UNF φ4 or φ6 Single use fitting for ϕ 8 or ϕ 10 _

Flow Rate Characteristics

• When used as a single unit

	1(P)→2(B)	/1(P)→4(A)	2(B)→3(R2)	/4(A)→5(R1)
Basic model	Sonic conductance C dm ³ /(s·bar)	Critical pressure ratio b	Sonic conductance C dm ³ /(s·bar)	Critical pressure ratio b
F10 T0-A2				
F10 T1-A2	0.85	0.14	0.85	0.26
F10 T2-A2				
F10□T3-A2				
F10 T4-A2	0.82	0.13	0.82	0.29
F10 T5-A2				
F10 TA-A2				
F10 TB-A2	0.68	0.30	0.69	0.30
F10 TC-A2				
F10□T0-F3 F10□T1-F3	0.70	0.00	0.50	0.47
F10_T1-F3	0.73	0.29	0.58	0.47
F10 T3-F3				
F10 T4-F3	0.69	0.26	0.57	0.46
F10 T5-F3	0.00	0.20	0.01	0.10
F10 TA-F3				
F10 TB-F3	0.61	0.28	0.54	0.44
F10 TC-F3				
F10 T0-F4				
F10 T1-F4	0.54	0.39	0.53	0.37
F10 T2-F4				
F10 T3-F4				
F10 T4-F4	0.53	0.43	0.51	0.34
F10 T5-F4				
F10 TA-F4				
F10 TB-F4	0.50	0.32	0.50	0.30
F10 TC-F4				<u> </u>

	1(P)→2(B)	/1(P)→4(A)	2(B)→3(R2)/4(A)→5(R1)		
Basic model	Sonic conductance C	Critical pressure ratio	Sonic conductance C	Critical pressure ratio	
	dm ³ /(s•bar)	b	dm ³ /(s•bar)	b	
F10 T0-F5					
F10□T1-F5	0.57	0.39	0.54	0.38	
F10 T2-F5					
F10 T3-F5					
F10 T4-F5	0.57	0.41	0.54	0.40	
F10 T5-F5					
F10 TA-F5					
F10 TB-F5	0.53	0.33	0.51	0.31	
F10 TC-F5					
F10 T0-F6		0.47	0.56	0.42	
F10 T1-F6	0.64				
F10 T2-F6					
F10 T3-F6					
F10 T4-F6	0.61	0.42	0.56	0.40	
F10 T5-F6					
F10 TA-F6					
F10□TB-F6	0.57	0.34	0.52	0.40	
F10 TC-F6					

Note: For **-F4**, value assumes **TS6-M5M** is mounted on the piping port.

• When mounted on a manifold

	Manifold model	F10M□F(FP)		F10M	A(AP)	F10M	N(P)(S)
			2(B)→3(R2)/4(A)→5(R1)	1(P)→2(B)/1(P)→4(A)	2(B)→3(R2)/4(A)→5(R1)	1(P)→2(B)/1(P)→4(A)	2(B)→3(R2)/4(A)→5(R1)
Valve model		Sonic conductant	ce C dm ³ /(s·bar)	Sonic conductant	ce C dm ³ /(s•bar)	Sonic conductant	ce C dm³/(s•bar)
F10 T0							
F10 T1		0.84	0.82	0.75	0.76	0.97	0.93
F10 T2	Outlet port						
F10 T3	dual use fitting						
F10 T4	for ϕ 4 and ϕ 6	0.83	0.78	0.73	0.72	0.93	0.89
F10 T5	*These are the						
F10 TA	cases of ϕ 6.						
F10 TB		0.70	0.70	0.64	0.66	0.75	0.73
F10 T0							
F10 T1		0.66	0.72	0.63	0.69	0.72	0.79
F10 T2	_						
F10 T3	Outlet port						
F10 T4	ϕ 4 fitting	0.65	0.70	0.62	0.67	0.70	0.77
F10 T5	-						
		0.00	0.04	0.50	0.00	0.00	0.07
F10 TB F10 TC		0.60	0.64	0.56	0.62	0.63	0.67
F10_TC_							
F10_T1_		0.72	0.81	0.67	0.73	0.80	0.83
F10_T2_		0.72	0.01	0.07	0.75	0.80	0.03
F10_T3_	-						
F10_T4_	Outlet port ϕ 6 fitting	0.71	0.73	0.66	0.69	0.78	0.80
F10 T5		0.71	0.10	0.00	0.00	0.70	0.00
F10 TA	-						
F10 TB		0.64	0.66	0.58	0.63	0.68	0.69
F10 TC		0.0.	0.00			0.00	
	1			ly spacer or the indiv	1		

Notes: 1. When the individual air supply spacer or the individual air exhaust spacer, the back pressure prevention valve, or the stop valve is used, sonic conductance decreases by about 30%.2. For the flow rate characteristics of other outlet ports, consult us.

108 KOGANEI

Remark: Specification values are based on Koganei test standards.

Single Valve Unit Mass

Single Valve Unit Mass g [oz.]							
F10_T	F10_TA1	F10_TA2	F10_TFJ	F10_TFJ5	F10_TFJ6		
Outlet portion	Outlet portion	Outlet portion	Outlet portion With dual use	Outlet portion	Outlet portion		
None	With plate	With plate	fitting block	With $\phi 4$ fitting block	With ϕ 6 fitting block		
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion		
None	None	With A type sub-base	None	None	None		
44 [1.55]	47 [1.66]	116 [4.09]	55 [1.94]	57 [2.01]	60 [2.12]		

				g [oz.]
F10 T -FM	F10_TF3	F10_TF4	F10_TF5	F10□T□□-F6
Outlet portion	Outlet portion With dual use	Outlet portion	Outlet portion	Outlet portion
With female thread block	fitting block	With female thread block	With $\phi 4$ fitting block	With ϕ 6 fitting block
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion
None	With female thread block	With female thread block	With female thread block	With female thread block
51 [1.80]	62 [2.19]	58 [2.05]	64 [2.26]	67 [2.36]

Basic Type **F10** To is 10 g [0.35 oz.] less than the mass shown above.

Monoblock Manifold Mass (single valve unit included)

	Mass calculation of each unit					
Monoblock manifold	4(A), 2(B) ports outlet specifications					
	Female thread block	Dual use fitting block	ϕ 4 fitting block	ϕ 6 fitting block		
A type	(97×n)+79 [(3.42×n)+2.79]	(101×n)+79 [(3.56×n)+2.79]	(103×n)+79 [(3.63×n)+2.79]	(106×n)+79 [(3.74×n)+2.79]		
F type	(71×n)+57 [(2.50×n)+2.01]	(75×n)+57 [(2.65×n)+2.01]	(77×n)+57 [(2.72×n)+2.01]	(80×n)+57 [(2.82×n)+2.01]		

Additional mass (wire-saving type)				
Monoblock manifold	Wiring specification			
	-F100N, -F101N	-F200N, -F201N, -F260N	-D250N, -D251N	
A type	164+4n [5.78+0.14n]	166+4n [5.86+0.14n]	170+4n [6.00+0.14n]	
F type	112+4n [3.95+0.14n]	114+4n [4.02+0.14n]	118+4n [4.16+0.14n]	

Calculation example : F10M8AM

stn.1~stn.8 F10T1-A1-PS DC24V

(97×8)+79 = 855 g [30.16 oz.]

When mounting the block-off plate, subtract 50 g [1.76 oz] per unit from the above calculation result.

When mounting the F10 T0 specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

PC Board Manifold Mass (single valve unit included)

	Mass calculation of each unit					
PC board manifold	4(A), 2(B) ports outlet specifications				Circuit board and	
	Female thread block	Dual use fitting block	ϕ 4 fitting block	ϕ 6 fitting block	connector portion	
A type	(97×n)+79 [(3.42×n)+2.79]	(101×n)+79 [(3.56×n)+2.79]	(103×n)+79 [(3.63×n)+2.79]	(106×n)+79 [(3.74×n)+2.79]		
F type	(76×n)+83 [(2.68×n)+2.93]	(80×n)+83 [(2.82×n)+2.93]	(82×n)+83 [(2.89×n)+2.93]	(85×n)+83 [(3.00×n)+2.93]	$(2 \times n) + 29$ [(0.07 × n) + 1.02]	

Calculation example : F10M8APM-F201-W

stn.1~stn.8 F10T1-A1-PP DC24V

(97×8)+79+(2×8)+29=900 g [31.75 oz.]

When mounting the block-off plate, subtract 50 g [1.76 oz] per unit from the above calculation result.

When mounting the F10 T0 specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

g [oz.]

g [oz.]

g [oz.]

Mass of Split Manifold and Serial Transmission Compatible Manifold

Because the valve and manifold have the same output specifications, their mass is the same. The mass can only be changed by choosing a different type of inlet/ outlet block.

			g [oz.]			
	Additional mass					
	Piping block specification					
Female thread block Dual use fitting block ϕ 8 fitting block ϕ 10 fitting block						
111 [3.92]	125 [4.41]	149 [5.26]	159 [5.61]			

Calculation example : F10M8N-MR

stn.1~stn.8 F10T1-A1-PS DC24V

(75×8)+120+111=831 g [29.31 oz.]

When mounting the block-off plate, subtract 50 g [1.76 oz] per unit from the above calculation result.

When mounting the F10 T0 specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

Mass of Split Manifold Plug-in Type/Serial Transmission Compatible Manifold (single valve unit included) g [oz.]

Diversity to a	Mass calculation of each unit					
Plug-in type	4(A), 2(B) ports outlet specifications					
Serial transmission	Female thread block	Dual use fitting block	ϕ 4 fitting block	ϕ 6 fitting block		
compatible manifold	(79×n)+120 [(2.79×n)+4.23]	(83×n)+120 [(2.93×n)+4.23]	(85×n)+120 [(3.00×n)+4.23]	(88×n)+120 [(3.10×n)+4.23]		

			g [oz.]		
Additional mass					
	Piping block specification				
Female thread block	Female thread block Dual use fitting block ϕ 8 fitting block ϕ 10 fitting block				
111 [3.92]	125 [4.41]	149 [5.26]	159 [5.61]		

g [oz.]

~ [~ 7]

Additional mass				
Wiring block specification				
-F100 , -F101 -F200 , -F201 , -F260 - D250 , -D251 - D370NU -T200				-T200
32 [1.13]	34 [1.20]	39 [1.38]	72 [2.54]	110 [3.88]

			g [oz.]		
Additional mass					
Serial transmission block specification					
Stand-alone type	Integrated type	EtherCAT	EtherNet/IP		
231 [8.15]	138 [4.87]	100 [3.53]	110 [3.88]		

Calculation example : F10M8PM-MR-F201 DC24V

stn.1~stn.8 F10T1-A1 DC24V

(79×8)+120+111+34=897 g [31.64 oz.]


When mounting the block-off plate, subtract 50 g [1.76 oz] per unit from the above calculation result.

When mounting the F10 T0 specification valve, subtract 10 g [0.35 oz.] per unit from the above calculation result.

F10T Valve specifications -F3-PS

With outlet port dual use fitting block With inlet port female thread block S type plug connector

* For T0 Type dimensions, see page 112.

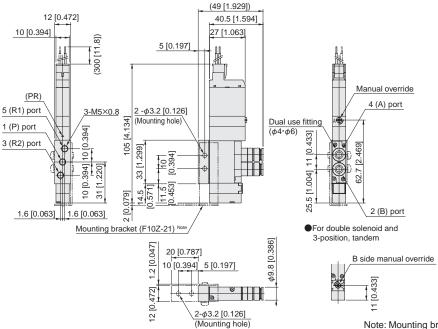


Note: Mounting brackets are additional parts (options).

F10TValve specifications-F4-PSF10TValve specifications-F4H-PS


With outlet port female thread block With inlet port female thread block S type plug connector

* For T0 Type dimensions, see page 112.

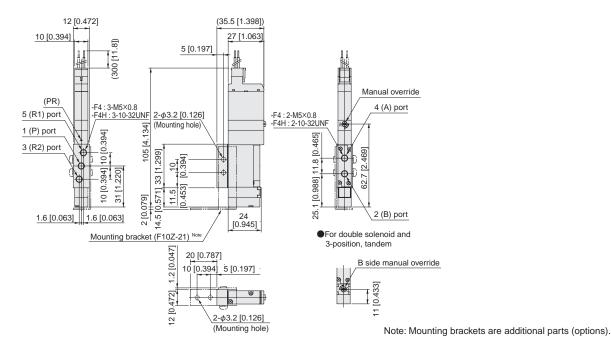

F10T0-F -PS

With outlet port single use fitting block With inlet port female thread block S type plug connector

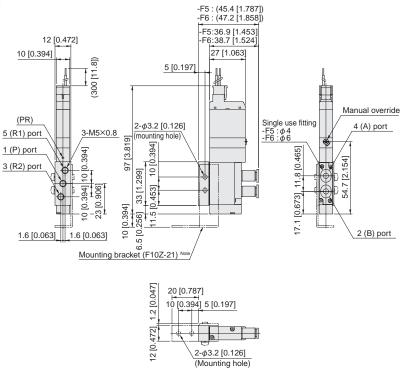


Note: Mounting brackets are additional parts (options).

F10T Valve specifications Operation system -A2-PS F10T Valve specifications Operation system -A2H-PS

With A-type sub-base




Internal pilot specifications

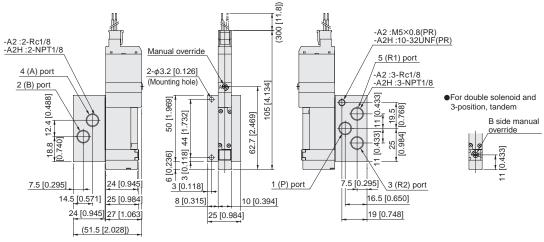

Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).

External pilot specifications

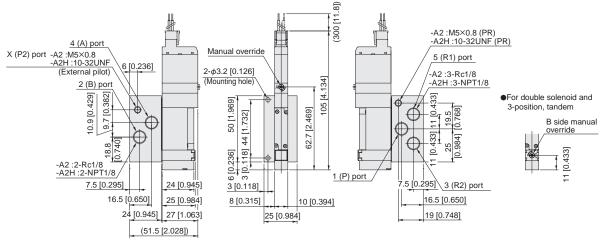


Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).

Manual lever: -R

Options

• L-type plug connector: -PL

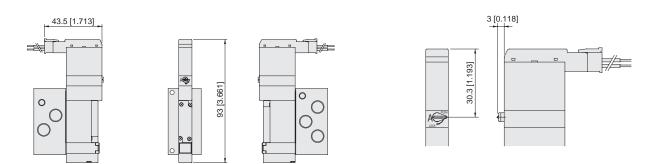



Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).

F10M Number of valves A M


Pilot specifications (Base piping type)

Monoblock manifold A type With manifold outlet port dual use fitting block S type plug connector




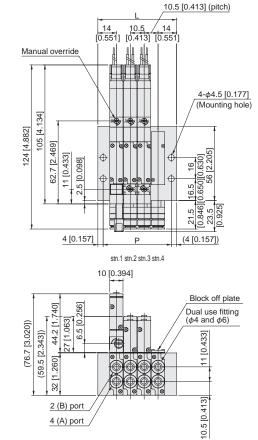

Number of units	L	Р
2	38.5 [1.516]	30.5 [1.201]
3	49.0 [1.929]	41.0 [1.614]
4	59.5 [2.343]	51.5 [2.028]
5	70.0 [2.756]	62.0 [2.441]
6	80.5 [3.169]	72.5 [2.854]
7	91.0 [3.583]	83.0 [3.268]
8	101.5 [3.996]	93.5 [3.681]
9	112.0 [4.409]	104.0 [4.094]
10	122.5 [4.823]	114.5 [4.508]
11	133.0 [5.236]	125.0 [4.921]
12	143.5 [5.650]	135.5 [5.335]
13	154.0 [6.063]	146.0 [5.748]
14	164.5 [6.476]	156.5 [6.161]
15	175.0 [6.890]	167.0 [6.575]
16	185.5 [7.303]	177.5 [6.988]
17	196.0 [7.717]	188.0 [7.402]
18	206.5 [8.130]	198.5 [7.815]
19	217.0 [8.543]	209.0 [8.228]
20	227.5 [8.957]	219.5 [8.642]

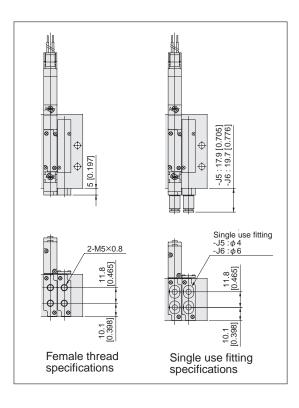


Monoblock manifold A type With manifold outlet port female thread block S type plug connector

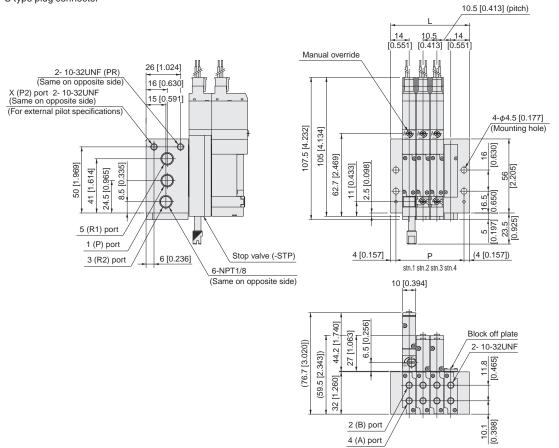

Number of units	L	Р
2	38.5 [1.516]	30.5 [1.201]
3	49.0 [1.929]	41.0 [1.614]
4	59.5 [2.343]	51.5 [2.028]
5	70.0 [2.756]	62.0 [2.441]
6	80.5 [3.169]	72.5 [2.854]
7	91.0 [3.583]	83.0 [3.268]
8	101.5 [3.996]	93.5 [3.681]
9	112.0 [4.409]	104.0 [4.094]
10	122.5 [4.823]	114.5 [4.508]
11	133.0 [5.236]	125.0 [4.921]
12	143.5 [5.650]	135.5 [5.335]
13	154.0 [6.063]	146.0 [5.748]
14	164.5 [6.476]	156.5 [6.161]
15	175.0 [6.890]	167.0 [6.575]
16	185.5 [7.303]	177.5 [6.988]
17	196.0 [7.717]	188.0 [7.402]
18	206.5 [8.130]	198.5 [7.815]
19	217.0 [8.543]	209.0 [8.228]
20	227.5 [8.957]	219.5 [8.642]

F10M Number of valves **F** (Direct piping type)

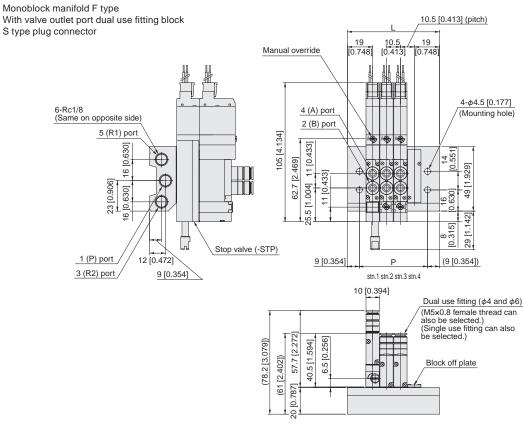



Onic (unnei	15101
Number of units	L	Р
2	48.5 [1.909]	30.5 [1.201]
3	59.0 [2.323]	41.0 [1.614]
4	69.5 [2.736]	51.5 [2.028]
5	80.0 [3.150]	62.0 [2.441]
6	90.5 [3.563]	72.5 [2.854]
7	101.0 [3.976]	83.0 [3.268]
8	111.5 [4.390]	93.5 [3.681]
9	122.0 [4.803]	104.0 [4.094]
10	132.5 [5.217]	114.5 [4.508]
11	143.0 [5.630]	125.0 [4.921]
12	153.5 [6.043]	135.5 [5.335]
13	164.0 [6.457]	146.0 [5.748]
14	174.5 [6.870]	156.5 [6.161]
15	185.0 [7.283]	167.0 [6.575]
16	195.5 [7.697]	177.5 [6.988]
17	206.0 [8.110]	188.0 [7.402]
18	216.5 [8.524]	198.5 [7.815]
19	227.0 [8.937]	209.0 [8.228]
20	237.5 [9.350]	219.5 [8.642]


Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).

F10M Number of valves FH (Direct piping type)

Monoblock manifold F type With valve outlet port female thread block S type plug connector








Unit dimensions

Number of units	L	Р
2	48.5 [1.909]	30.5 [1.201]
3	59.0 [2.323]	41.0 [1.614]
4	69.5 [2.736]	51.5 [2.028]
5	80.0 [3.150]	62.0 [2.441]
6	90.5 [3.563]	72.5 [2.854]
7	101.0 [3.976]	83.0 [3.268]
8	111.5 [4.390]	93.5 [3.681]
9	122.0 [4.803]	104.0 [4.094]
10	132.5 [5.217]	114.5 [4.508]
11	143.0 [5.630]	125.0 [4.921]
12	153.5 [6.043]	135.5 [5.335]
13	164.0 [6.457]	146.0 [5.748]
14	174.5 [6.870]	156.5 [6.161]
15	185.0 [7.283]	167.0 [6.575]
16	195.5 [7.697]	177.5 [6.988]
17	206.0 [8.110]	188.0 [7.402]
18	216.5 [8.524]	198.5 [7.815]
19	227.0 [8.937]	209.0 [8.228]
20	237.5 [9.350]	219.5 [8.642]

CA CA

Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).

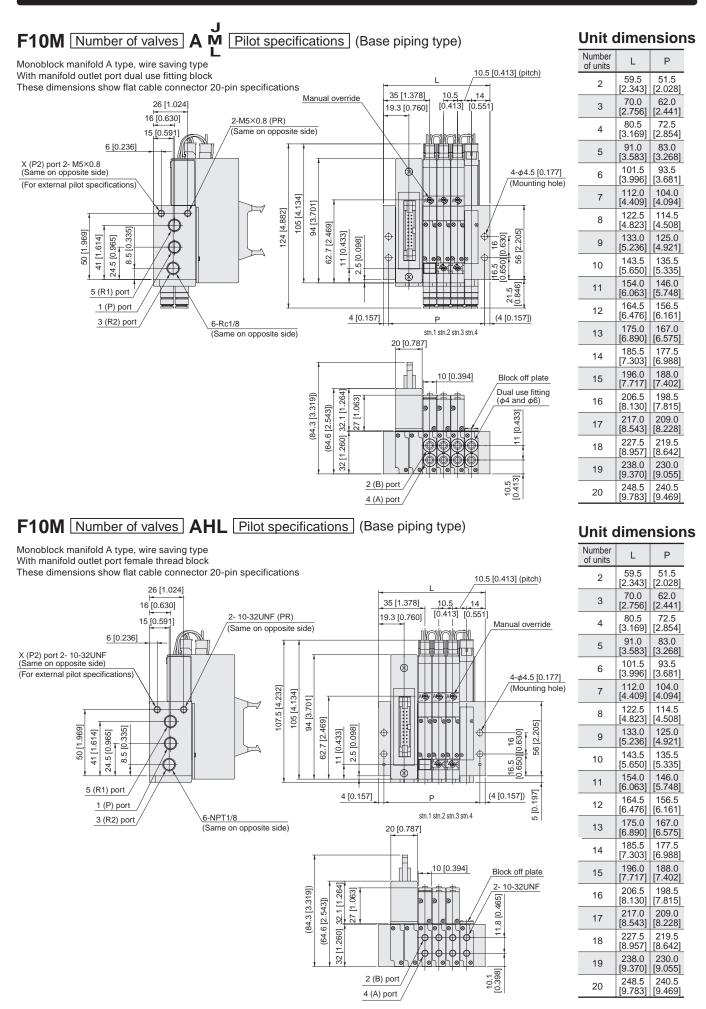



KOGANEI 117

F10M Number of valves **F** (Direct piping type)

Monoblock manifold F type, wire saving type With valve outlet port dual use fitting block

These dimensions show flat cable connector 20-pin specifications



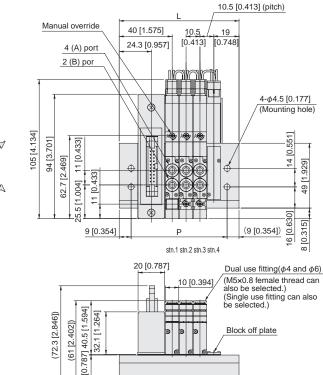


Number of units Ρ L 51.5 [2.028] 69.5 2 [2.736] 80.0 62.0 3 [2.441] [3.150] 90.5 72.5 4 [2.854] [3.563] 101.0 83.0 5 [3.976] [3.268] 111.5 93.5 6 [3.681] [4.390] 122.0 104.0 7 [4.094] [4.803] 114.5 [4.508] 132.5 [5.217] 8 143.0 125.0 9 [4.921] [5.630] 153.5 135.5 10 [6.043] [5.335] 164.0 146.0 11 [6.457] [5.748] 174.5 156.5 12 [6.870] [6.161] 185.0 167.0 13 [7.283] [6.575] 195.5 177.5 14 [7.697] [6.988] 206.0 188.0 15 [8.110] [7.402] 216.5 198 5 16 [8.524] [7.815] 227 0 209.0 17 [8.937] [8.228] 219.5 [8.642] 237.5 [9.350] 18 248 0 230.0 19 [9.764] [9.055] 258.5 240.5 20 [10.177] [9.469]

Unit dimensions

F10M Number of valves FH (Direct piping type)


Monoblock manifold F type, wire saving type With valve outlet port female thread block

These dimensions show flat cable connector 20-pin specifications

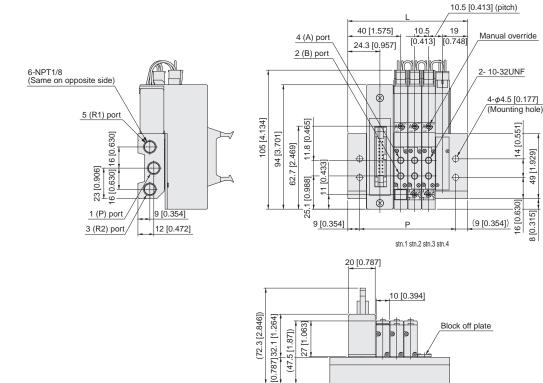

20

Number of units	L	Р
2	69.5 [2.736]	51.5 [2.028]
3	80.0 [3.150]	62.0 [2.441]
4	90.5 [3.563]	72.5 [2.854]
5	101.0 [3.976]	83.0 [3.268]
6	111.5 [4.390]	93.5 [3.681]
7	122.0 [4.803]	104.0 [4.094]
8	132.5 [5.217]	114.5 [4.508]
9	143.0 [5.630]	125.0 [4.921]
10	153.5 [6.043]	135.5 [5.335]
11	164.0 [6.457]	146.0 [5.748]
12	174.5 [6.870]	156.5 [6.161]
13	185.0 [7.283]	167.0 [6.575]
14	195.5 [7.697]	177.5 [6.988]
15	206.0 [8.110]	188.0 [7.402]
16	216.5 [8.524]	198.5 [7.815]
17	227.0 [8.937]	209.0 [8.228]
18	237.5 [9.350]	219.5 [8.642]
19	248.0 [9.764]	230.0 [9.055]
20	258.5 [10.177]	240.5 [9.469]

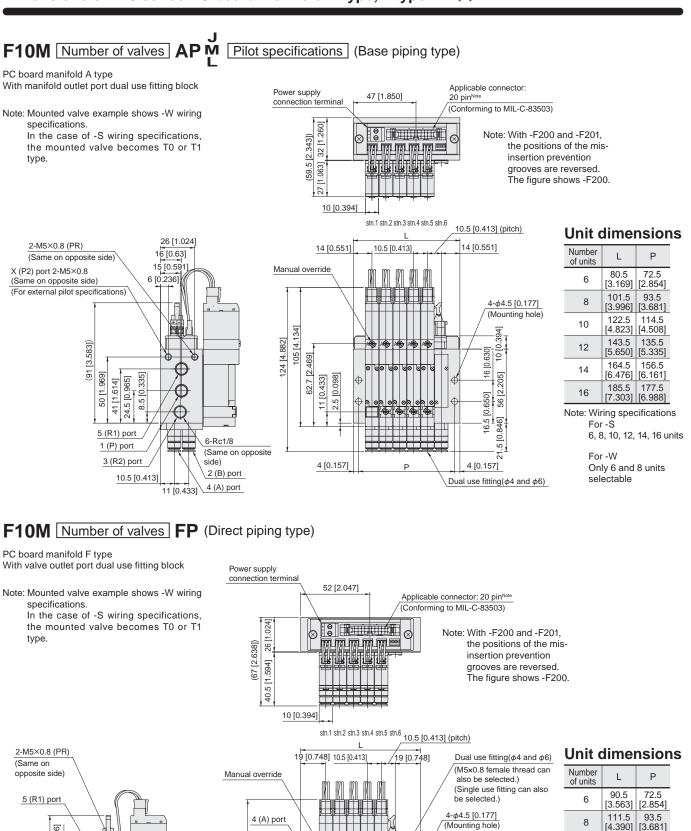

Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).

2 (B) port

4331

11 [0.4

5

ŝ

.004] 433]

9 [0.354]

62.7 [2.469]

105 [4.134]

21.5 [0.846]

22 [0.866]

(84 [3.307])

6-Rc1/8

(Same on

opposite side)

14 [0.551

551

14 [0.5

 \oplus

⊕

0.3541

18 [0.709

21 [0.827]

1 (P) port

3 (R2) port

€

KOGANEI 119

[4.390]

132.5

[5.217]

Note: Wiring specifications

For -S

For -W Only 6 and 8 units

selectable

153.5 135.5 [6.043] [5.335]

174.5 156.5 [6.870] [6.161]

195.5 177.5 [7.697] [6.988]

6, 8, 10, 12, 14, 16 units

10

12

14

16

10 [0.: 551

929]

354

0

14 [0.5

[0.591] 49 [1


15

(9 [0.354])

[3.681]

114.5 [4.508]

F10 SERIES

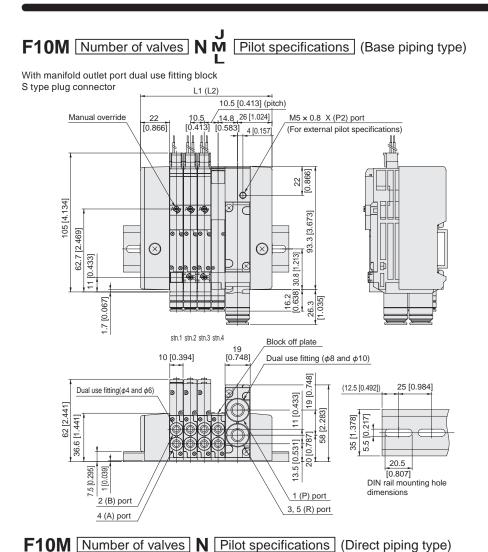


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	78.5 [3.091]	125 [4.921]	97.5 [3.839]	125 [4.921]
3	89.0 [3.504]	125 [4.921]	108.0 [4.252]	150 [5.906]
4	99.5 [3.917]	125 [4.921]	118.5 [4.665]	150 [5.906]
5	110.0 [4.331]	150 [5.906]	129.0 [5.079]	175 [6.890]
6	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
7	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
8	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
9	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
10	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
11	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
12	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
13	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
14	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
15	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
16	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
17	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
18	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
19	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
20	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]

Note: When two piping blocks are used.

With valve outlet port dual use fitting block S type plug connector

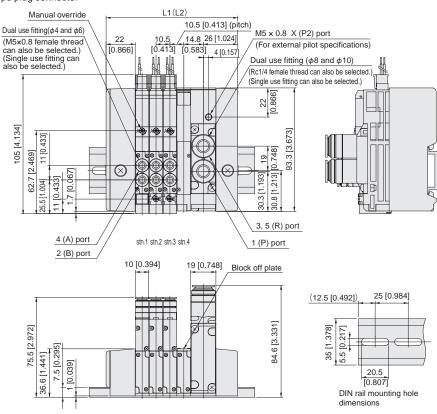


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	78.5 [3.091]	125 [4.921]	97.5 [3.839]	125 [4.921]
3	89.0 [3.504]	125 [4.921]	108.0 [4.252]	150 [5.906]
4	99.5 [3.917]	125 [4.921]	118.5 [4.665]	150 [5.906]
5	110.0 [4.331]	150 [5.906]	129.0 [5.079]	175 [6.890]
6	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
7	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
8	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
9	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
10	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
11	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
12	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
13	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
14	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
15	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
16	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
17	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
18	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
19	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
20	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]

Note: When two piping blocks are used.

Note: The overall valve length of the T0 type is 8 mm [0.315 in] shorter (end cover side protrusion is 8 mm [0.315 in] less).

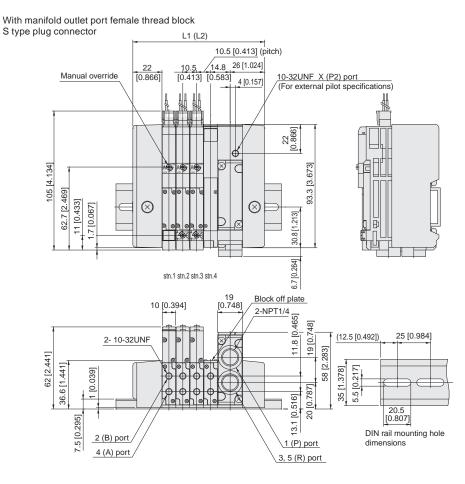


Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note	
2	78.5 [3.091]	125 [4.921]	97.5 [3.839]	125 [4.921]	
3	89.0 [3.504]	125 [4.921]	108.0 [4.252]	150 [5.906]	
4	99.5 [3.917]	125 [4.921]	118.5 [4.665]	150 [5.906]	
5	110.0 [4.331]	150 [5.906]	129.0 [5.079]	175 [6.890]	
6	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]	
7	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]	
8	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]	
9	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]	
10	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]	
11	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]	
12	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]	
13	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]	
14	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]	
15	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]	
16	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]	
17	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]	
18	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]	
19	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]	
20	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]	
Note: Wh	Note: When two piping blocks are used.				

F10 SERIES


F10M Number of valves NH Pilot specifications (Direct piping type)

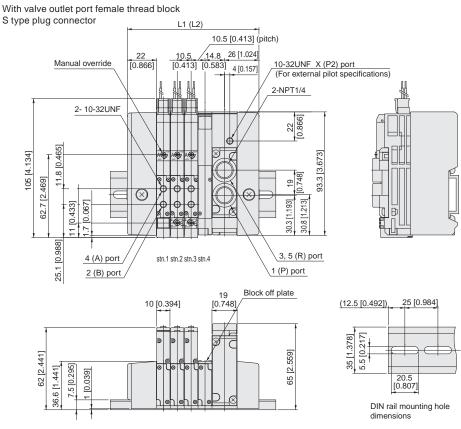


Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	78.5 [3.091]	125 [4.921]	97.5 [3.839]	125 [4.921]
3	89.0 [3.504]	125 [4.921]	108.0 [4.252]	150 [5.906]
4	99.5 [3.917]	125 [4.921]	118.5 [4.665]	150 [5.906]
5	110.0 [4.331]	150 [5.906]	129.0 [5.079]	175 [6.890]
6	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
7	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
8	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
9	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
10	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
11	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
12	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
13	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
14	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
15	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
16	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
17	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
18	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
19	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
20	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]

Note: When two piping blocks are used.

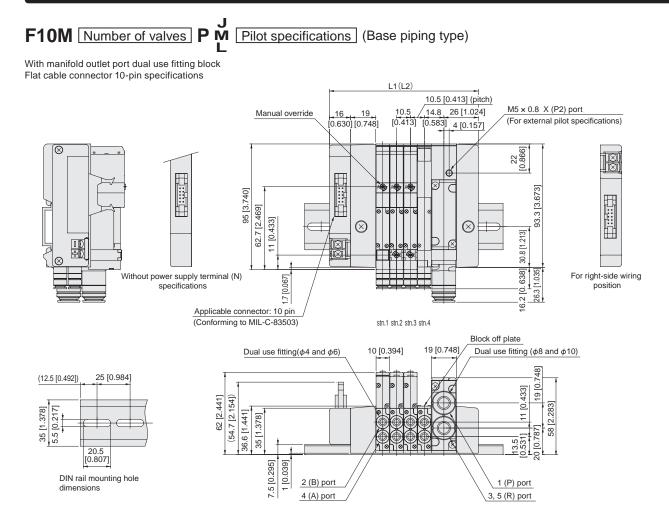

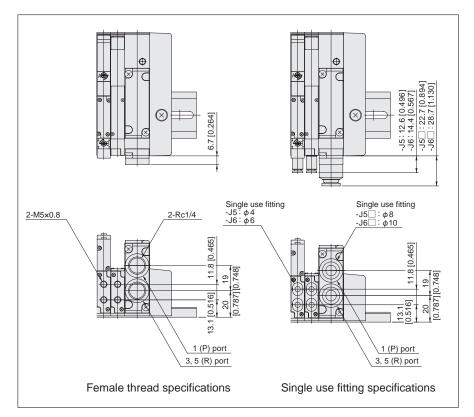

Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]


Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

F10M Number of valves PM

Pilot specifications (Base piping type)

Pilot specifications (Base piping type)

With manifold outlet port dual use fitting block Flat cable connector 20-pin specifications (side surface wiring)

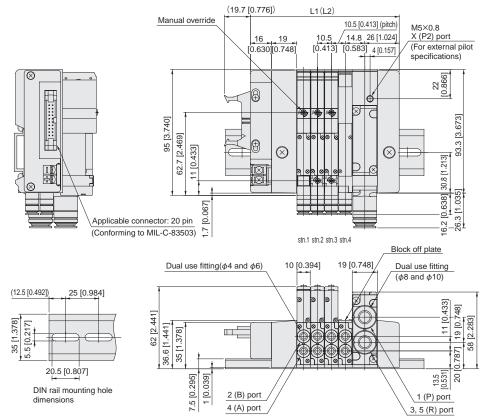

Unit dimensions


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port dual use fitting block Flat cable connector 26-pin specifications

РМ

F10M Number of valves

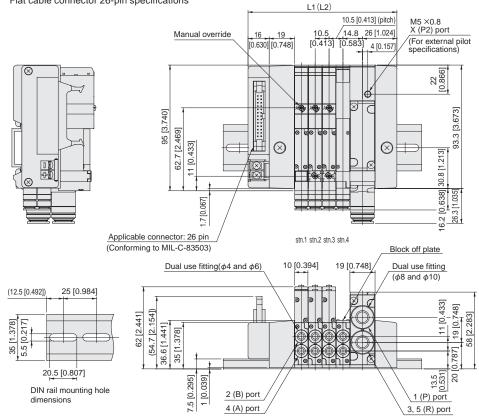

Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used.


* For right-side mounting wiring (-R), add

ΡΜ F10M Number of valves

Pilot specifications (Base piping type)

Pilot specifications (Base piping type)

With manifold outlet port dual use fitting block D-sub connector 25-pin specifications

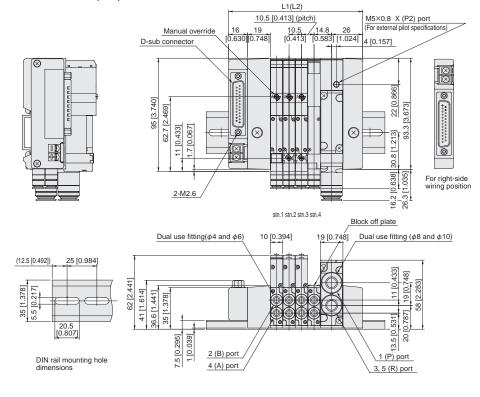


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port dual use fitting block Terminal block type

F10M Number of valves

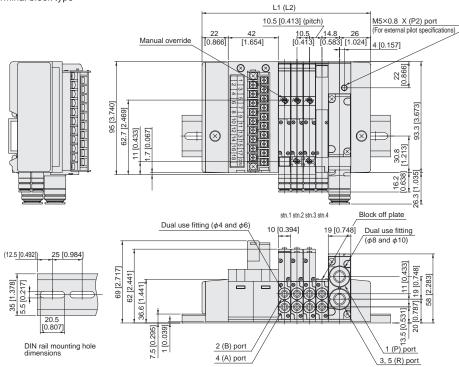


Μ

Unit dimensions


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]
3	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]
4	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]
5	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]
6	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]
7	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]
8	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]
9	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]
10	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]
11	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]
12	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]
13	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]
14	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]
15	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]
16	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]
17	278.0 [10.945]	325 [12.795]	297.0 [11.693]	325 [12.795]
18	288.5 [11.358]	325 [12.795]	307.5 [12.106]	350 [13.780]

Note: When two piping blocks are used.

With manifold outlet port female thread block Flat cable connector 10-pin specifications

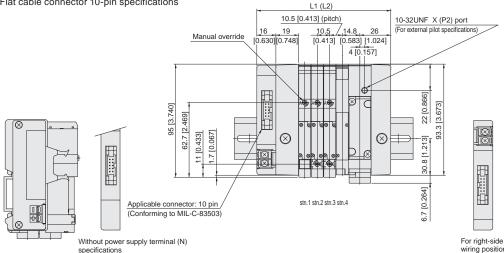

For right-side wiring position

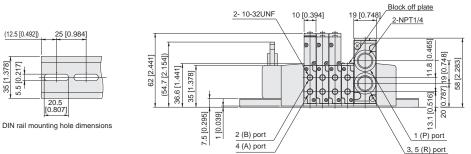



Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
-				

Note: When two piping blocks are used. For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

F10M Number of valves Pilot specifications (Direct piping type)

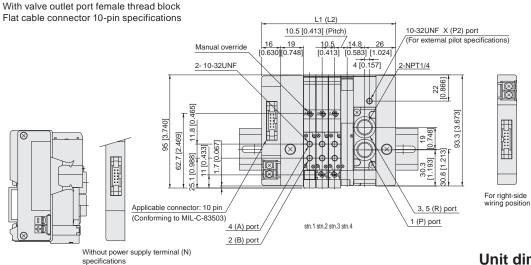

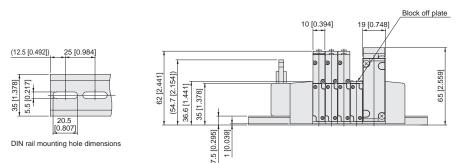


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

With manifold outlet port female thread block

Flat cable connector 20-pin specifications (side surface wiring)

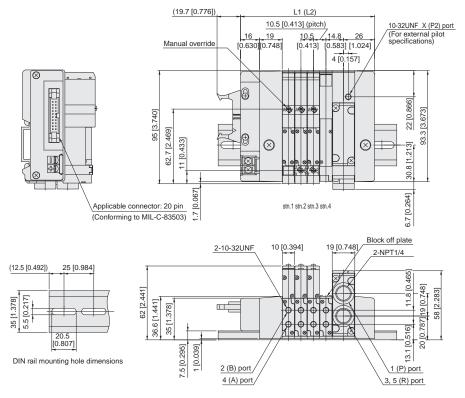


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

F10M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Flat cable connector 20-pin specifications

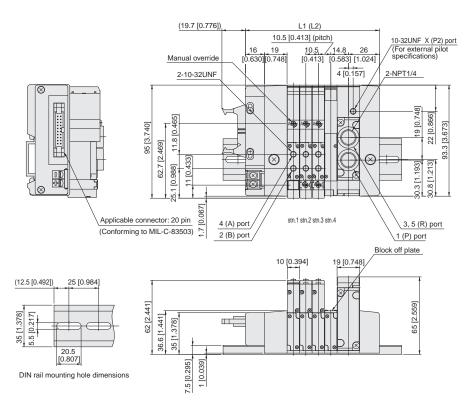


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

With manifold outlet port female thread block Flat cable connector 26-pin specifications

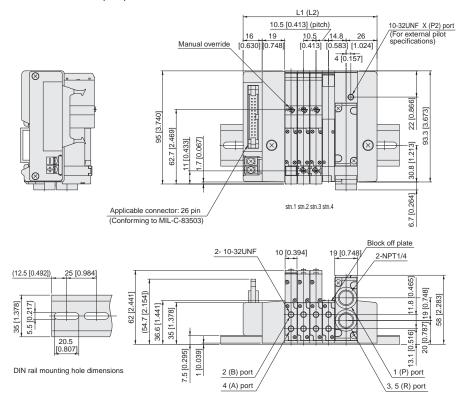


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

F10M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Flat cable connector 26-pin specifications

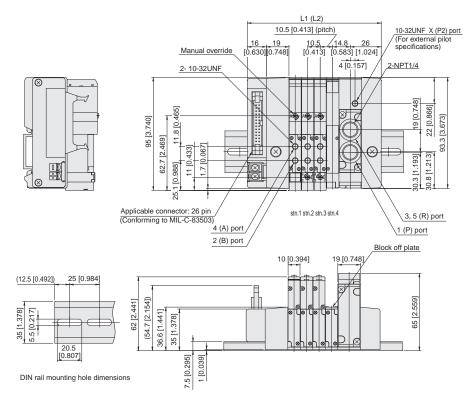


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

With manifold outlet port female thread block D-sub connector 25-pin specifications

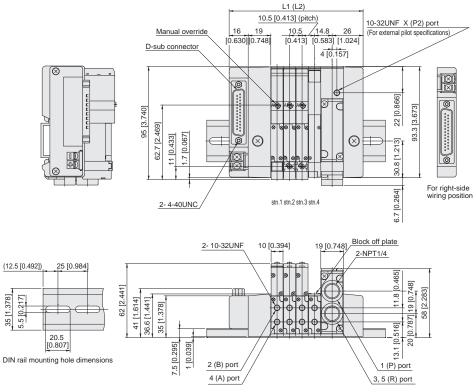


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

F10M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block D-sub connector 25-pin specifications

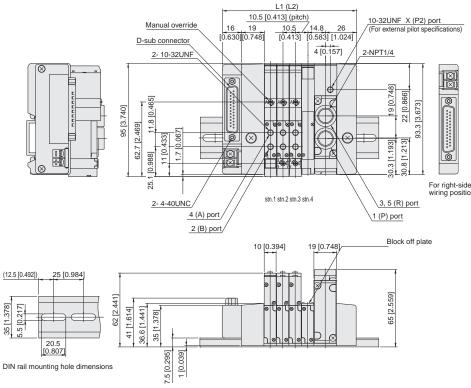


Unit dimensions

	Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
	2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
	3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
	4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
	5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
	6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
	7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
	8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
e on	9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
	10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
	11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
	12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
	13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
	14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
	15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
	16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
	17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
	18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
	19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
	20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add


With manifold outlet port female thread block D-sub connector 37-pin specifications

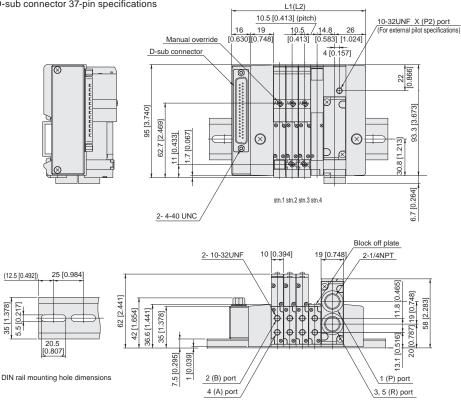

F10M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block D-sub connector 37-pin specifications

35 [1.378]

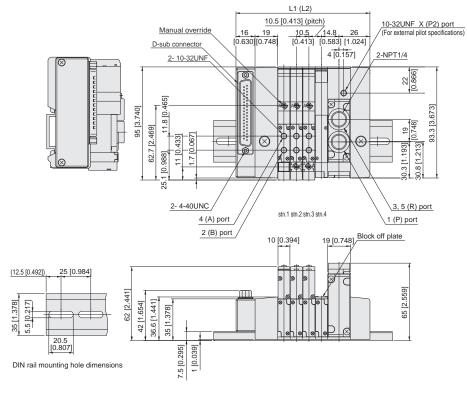

Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]


Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	91.5 [3.602]	125 [4.921]	110.5 [4.350]	150 [5.906]	
3	102.0 [4.016]	150 [5.906]	121.0 [4.764]	175 [6.890]	
4	112.5 [4.429]	150 [5.906]	131.5 [5.177]	175 [6.890]	
5	123.0 [4.843]	175 [6.890]	142.0 [5.591]	175 [6.890]	
6	133.5 [5.256]	175 [6.890]	152.5 [6.004]	200 [7.874]	
7	144.0 [5.669]	200 [7.874]	163.0 [6.417]	200 [7.874]	
8	154.5 [6.083]	200 [7.874]	173.5 [6.831]	225 [8.858]	
9	165.0 [6.496]	200 [7.874]	184.0 [7.244]	225 [8.858]	
10	175.5 [6.909]	225 [8.858]	194.5 [7.657]	250 [9.843]	
11	186.0 [7.323]	225 [8.858]	205.0 [8.071]	250 [9.843]	
12	196.5 [7.736]	250 [9.843]	215.5 [8.484]	250 [9.843]	
13	207.0 [8.150]	250 [9.843]	226.0 [8.898]	275 [10.827]	
14	217.5 [8.563]	275 [10.827]	236.5 [9.311]	275 [10.827]	
15	228.0 [8.976]	275 [10.827]	247.0 [9.724]	300 [11.811]	
16	238.5 [9.390]	275 [10.827]	257.5 [10.138]	300 [11.811]	
17	249.0 [9.803]	300 [11.811]	268.0 [10.551]	325 [12.795]	
18	259.5 [10.217]	300 [11.811]	278.5 [10.965]	325 [12.795]	
19	270.0 [10.630]	325 [12.795]	289.0 [11.378]	325 [12.795]	
20	280.5 [11.043]	325 [12.795]	299.5 [11.791]	350 [13.780]	

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

With manifold outlet port female thread block Terminal block type

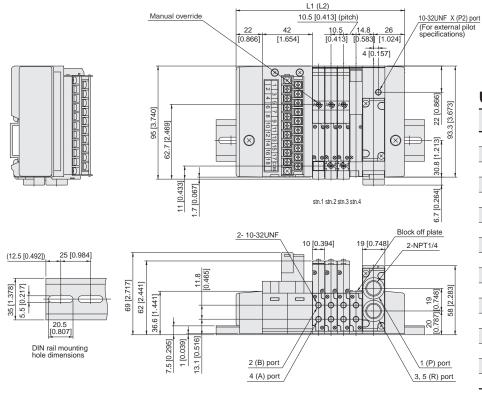


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]	
3	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]	
4	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]	
5	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]	
6	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]	
7	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]	
8	183.5 [7.224]	225 [8.858]	202.5 [7.972]	250 [9.843]	
9	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]	
10	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]	
11	215.0 [8.465]	250 [9.843]	234.0 [9.213]	275 [10.827]	
12	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]	
13	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]	
14	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]	
15	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]	
16	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]	
17	278.0 [10.945]	325 [12.795]	297.0 [11.693]	325 [12.795]	
18	288.5 [11.358]	325 [12.795]	307.5 [12.106]	350 [13.780]	

Note: When two piping blocks are used.

F10M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Terminal block type

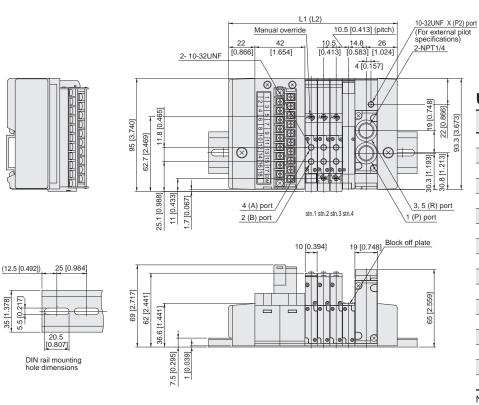

Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	120.5 [4.744]	150 [5.906]	139.5 [5.492]	175 [6.890]	
3	131.0 [5.157]	175 [6.890]	150.0 [5.906]	175 [6.890]	
4	141.5 [5.571]	175 [6.890]	160.5 [6.319]	200 [7.874]	
5	152.0 [5.984]	200 [7.874]	171.0 [6.732]	200 [7.874]	
6	162.5 [6.398]	200 [7.874]	181.5 [7.146]	225 [8.858]	
7	173.0 [6.811]	200 [7.874]	192.0 [7.559]	225 [8.858]	
8	183.5 [7.224]	225 [8.858] 202.5 [7.97]		250 [9.843]	
9	194.0 [7.638]	225 [8.858]	213.0 [8.386]	250 [9.843]	
10	204.5 [8.051]	250 [9.843]	223.5 [8.799]	250 [9.843]	
11	215.0 [8.465]	250 [9.843] 234.0 [9.21		275 [10.827]	
12	225.5 [8.878]	275 [10.827]	244.5 [9.626]	275 [10.827]	
13	236.0 [9.291]	275 [10.827]	255.0 [10.039]	300 [11.811]	
14	246.5 [9.705]	275 [10.827]	265.5 [10.453]	300 [11.811]	
15	257.0 [10.118]	300 [11.811]	276.0 [10.866]	325 [12.795]	
16	267.5 [10.531]	300 [11.811]	286.5 [11.280]	325 [12.795]	
17	278.0 [10.945]	325 [12.795]	297.0 [11.693]	325 [12.795]	
18	288.5 [11.358]	325 [12.795]	307.5 [12.106]	350 [13.780]	


Note: When two piping blocks are used.

35 [1.378] 5.5 [0.217] F10M Number of valves S

Pilot specifications (Base piping type)

With manifold outlet port dual use fitting block

(Integrated serial transmission block compatible model)

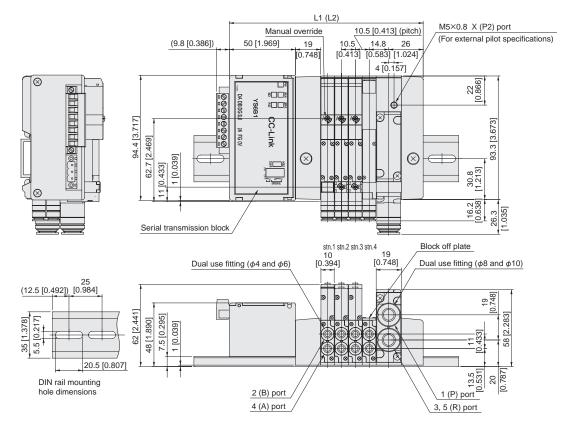

Unit dimensions


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note					
2	125.5 [4.941]	175 [6.890]	144.5 [5.689]	200 [7.874]					
3	136.0 [5.354]	200 [7.874]	155.0 [6.102]	200 [7.874]					
4	146.5 [5.768]	200 [7.874]	165.5 [6.516]	225 [8.858]					
5	157.0 [6.181]	200 [7.874]	176.0 [6.929]	225 [8.858]					
6	167.5 [6.594]	225 [8.858]	186.5 [7.343]	250 [9.843]					
7	178.0 [7.008]	225 [8.858]	197.0 [7.756]	250 [9.843]					
8	188.5 [7.421]	250 [9.843]	207.5 [8.169]	250 [9.843]					
9	199.0 [7.835]	250 [9.843]	218.0 [8.583]	275 [10.827]					
10	209.5 [8.248]	250 [9.843]	228.5 [8.996]	275 [10.827]					
11	220.0 [8.661]	275 [10.827]	239.0 [9.409]	300 [11.811]					
12	230.5 [9.075]	275 [10.827]	249.5 [9.823]	300 [11.811]					
13	241.0 [9.488]	300 [11.811]	260.0 [10.236]	300 [11.811]					
14	251.5 [9.902]	300 [11.811]	270.5 [10.650]	325 [12.795]					
15	262.0 [10.315]	325 [12.795]	281.0 [11.063]	325 [12.795]					
16	272.5 [10.728]	325 [12.795]	291.5 [11.476]	350 [13.780]					
17	283.0 [11.142]	350 [13.780]	302.0 [11.890]	375 [14.764]					
18	293.5 [11.555]	350 [13.780]	312.5 [12.303]	375 [14.764]					
19	304.0 [11.969]	350 [13.780]	323.0 [12.717]	375 [14.764]					
20	314.5 [12.382]	375 [14.764]	333.5 [13.130]	400 [15.748]					

Note: When two piping blocks are used.

* For right-side mounting wiring (-R), add

With manifold outlet port female thread block

(Integrated serial transmission block compatible manifold)

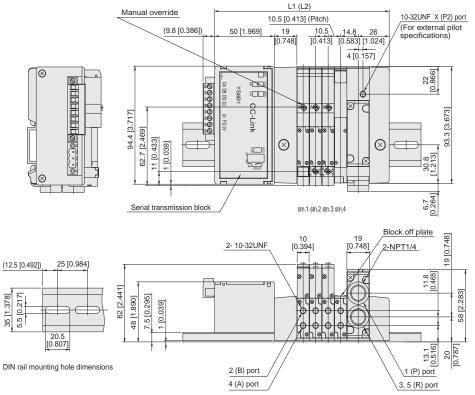

Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	125.5 [4.941]	175 [6.890]	144.5 [5.689]	200 [7.874]	
3	136.0 [5.354]	200 [7.874]	155.0 [6.102]	200 [7.874]	
4	146.5 [5.768]	200 [7.874]	165.5 [6.516]	225 [8.858]	
5	157.0 [6.181]	200 [7.874]	176.0 [6.929]	225 [8.858]	
6	167.5 [6.594]	225 [8.858]	186.5 [7.343]	250 [9.843]	
7	178.0 [7.008]	225 [8.858]	197.0 [7.756]	250 [9.843]	
8	188.5 [7.421]	250 [9.843]	207.5 [8.169]	250 [9.843]	
9	199.0 [7.835]	250 [9.843]	218.0 [8.583]	275 [10.827]	
10	209.5 [8.248]	250 [9.843]	228.5 [8.996]	275 [10.827]	
11	220.0 [8.661]	275 [10.827]	239.0 [9.409]	300 [11.811]	
12	230.5 [9.075]	275 [10.827]	249.5 [9.823]	300 [11.811]	
13	241.0 [9.488]	300 [11.811]	260.0 [10.236]	300 [11.811]	
14	251.5 [9.902]	300 [11.811]	270.5 [10.650]	325 [12.795]	
15	262.0 [10.315]	325 [12.795]	281.0 [11.063]	325 [12.795]	
16	272.5 [10.728]	325 [12.795]	291.5 [11.476]	350 [13.780]	
17	283.0 [11.142]	350 [13.780]	302.0 [11.890]	375 [14.764]	
18	293.5 [11.555]	350 [13.780]	312.5 [12.303]	375 [14.764]	
19	304.0 [11.969]	350 [13.780]	323.0 [12.717]	375 [14.764]	
20	314.5 [12.382]	375 [14.764]	333.5 [13.130]	400 [15.748]	


Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

5.5 mm [0.217 in] to the L1 (L2) dimension.

F10M Number of valves SH Pilot specifications (Direct piping type)

With valve outlet port female thread block


(Integrated serial transmission block compatible manifold)

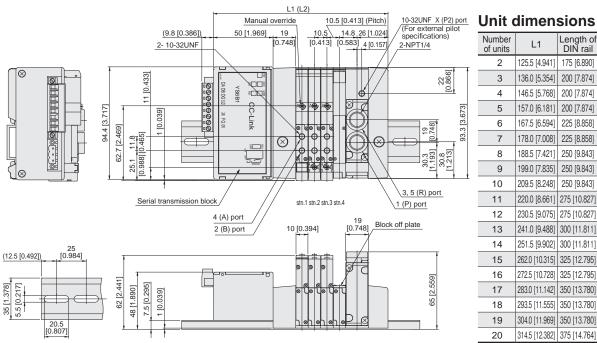

DIN rail mounting hole dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	125.5 [4.941]	175 [6.890]	144.5 [5.689]	200 [7.874]	
3	136.0 [5.354]	200 [7.874]	155.0 [6.102]	200 [7.874]	
4	146.5 [5.768]	200 [7.874]	165.5 [6.516]	225 [8.858]	
5	157.0 [6.181]	200 [7.874]	176.0 [6.929]	225 [8.858]	
6	167.5 [6.594]	225 [8.858]	186.5 [7.343]	250 [9.843]	
7	178.0 [7.008]	225 [8.858]	197.0 [7.756]	250 [9.843]	
8	188.5 [7.421]	250 [9.843]	207.5 [8.169]	250 [9.843]	
9	199.0 [7.835]	250 [9.843]	218.0 [8.583]	275 [10.827]	
10	209.5 [8.248]	250 [9.843]	228.5 [8.996]	275 [10.827]	
11	220.0 [8.661]	275 [10.827]	239.0 [9.409]	300 [11.811]	
12	230.5 [9.075]	275 [10.827]	249.5 [9.823]	300 [11.811]	
13	241.0 [9.488]	300 [11.811]	260.0 [10.236]	300 [11.811]	
14	251.5 [9.902]	300 [11.811]	270.5 [10.650]	325 [12.795]	
15	262.0 [10.315]	325 [12.795]	281.0 [11.063]	325 [12.795]	
16	272.5 [10.728]	325 [12.795]	291.5 [11.476]	350 [13.780]	
17	283.0 [11.142]	350 [13.780]	302.0 [11.890]	375 [14.764]	
18	293.5 [11.555]	350 [13.780]	312.5 [12.303]	375 [14.764]	
19	304.0 [11.969]	350 [13.780]	323.0 [12.717]	375 [14.764]	
20	314.5 [12.382]	375 [14.764]	333.5 [13.130]	400 [15.748]	

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

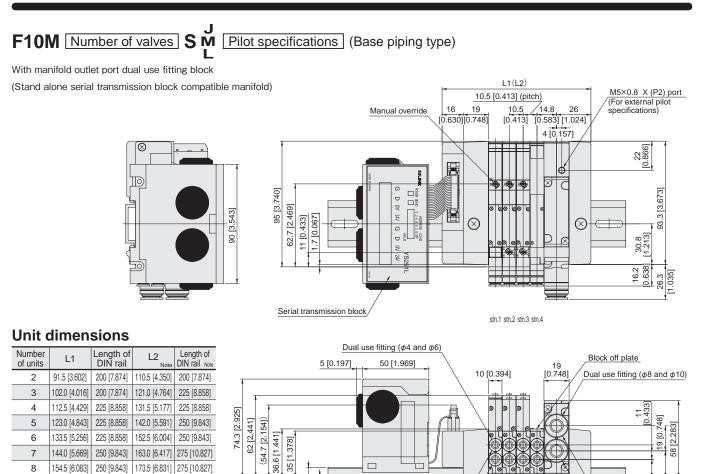

[0.039]

2 (B) port

4 (A) port

7.5 [0.295]

* For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

Note: When two piping blocks are used.

165.0 [6.496] 275 [10.827]

175.5 [6.909] 275 [10.827]

186.0 [7.323] 300 [11.811]

207.0 [8.150] 300 [11.811]

217.5 [8.563] 325 [12.795]

228.0 [8.976] 325 [12.795]

196.5 [7.736] 300 [11.811] 215.5 [8.484]

9

10

11

12

13

14

15

16

Additional Parts (available separately)

184.0 [7.244]

194.5 [7.657]

205.0 [8.071]

226.0 [8.898]

236.5 [9.311]

238.5 [9.390] 350 [13.780] 257.5 [10.138] 350 [13.780]

247.0 [9.724] 350 [13.780]

275 [10.827]

300 [11.811]


300 [11.811]


325 [12.795]


325 [12.795]

350 [13.780]

• Muffler: KM-J10 for both plug-in and non-plug-in







35 [1.378]


DIN rail mounting hole dimensions

13.5 [0.531]


1 (P) port

3, 5 (R) port

20

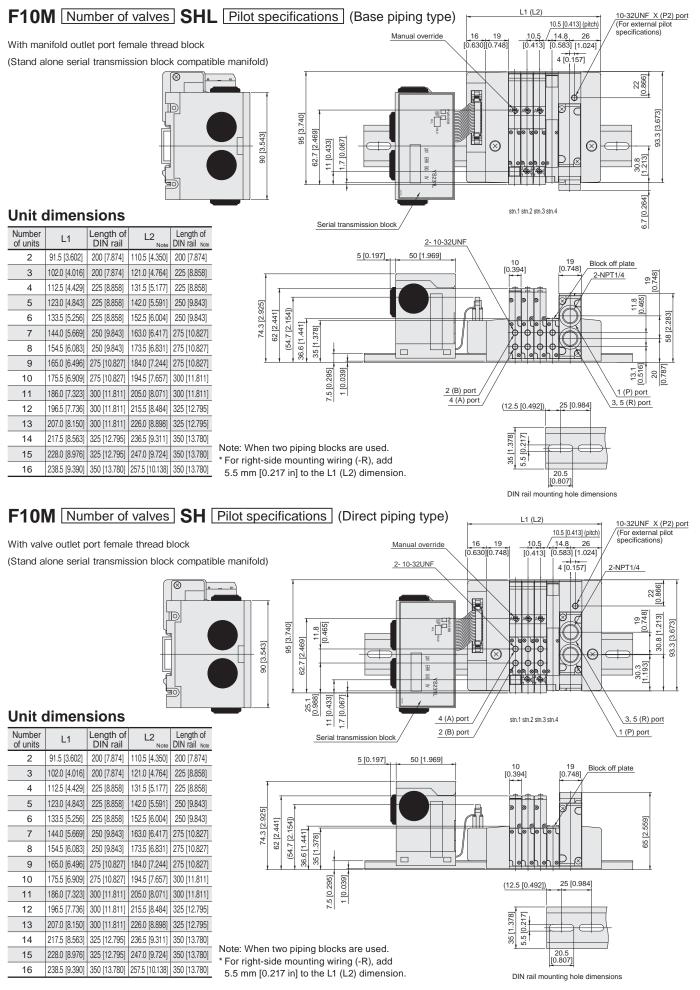

With manifold outlet port female thread block (EtherCAT)

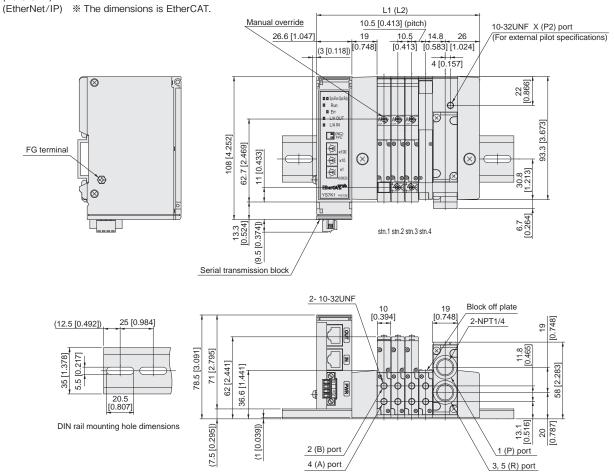


Unit dimensions

Number of units	L1 Length of L2 DIN rail N		L2 Note	Length of DIN rail Note					
2	120.1 [4.728]	150 [5.906]	121.1 [4.768]	175 [6.890]					
3	112.6 [4.433]	175 [6.890]	131.6 [5.181]	175 [6.890]					
4	123.1 [4.846]	175 [6.890]	142.1 [5.594]	200 [7.874]					
5	133.6 [5.260]	175 [6.890]	152.6 [6.008]	200 [7.874]					
6	144.1 [5.673]	200 [7.874]	163.1 [6.421]	225 [8.858]					
7	154.6 [6.087]	200 [7.874]	173.6 [6.835]	225 [8.858]					
8	165.1 [6.500]	225 [8.858]	184.1 [7.248]	225 [8.858]					
9	175.6 [6.913]	225 [8.858]	194.6 [7.661]	250 [9.843]					
10	186.1 [7.327]	225 [8.858]	205.1 [8.075]	250 [9.843]					
11	196.6 [7.740]	250 [9.843]	215.6 [8.488]	275 [10.827]					
12	207.1 [8.154]	250 [9.843]	226.1 [8.902]	275 [10.827]					
13	217.6 [8.567]	275 [10.827]	236.6 [9.315]	275 [10.827]					
14	228.1 [8.980]	275 [10.827]	247.1 [9.728]	300 [11.811]					
15	238.6 [9.394]	300 [11.811]	257.6 [10.142]	300 [11.811]					
16	249.1 [9.807]	300 [11.811]	268.1 [10.555]	325 [12.795]					
17	259.6 [10.220]	325 [12.795] 278.6 [10.96		350 [13.780]					
18	270.1 [10.634]	325 [12.795] 289.1 [11.382]		350 [13.780]					
19	280.6 [11.047]	325 [12.795]	299.6 [11.795]	350 [13.780]					
20	291.1 [11.461]	350 [13.780]	310.1 [12.209]	375 [14.764]					

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

With valve outlet port female thread block

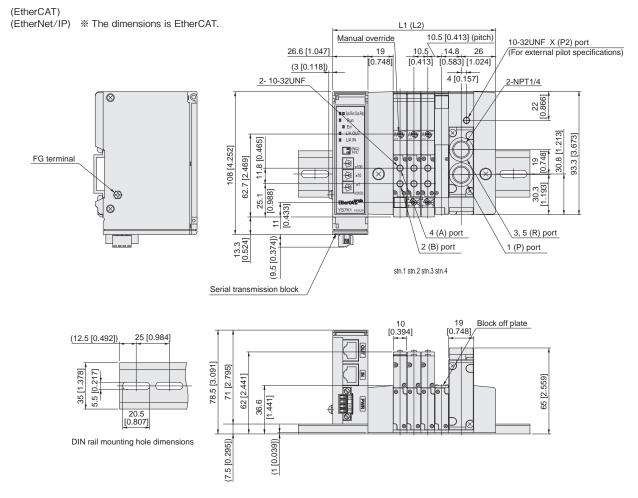

Unit dimensions


Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note				
2	120.1 [4.728]	150 [5.906]	121.1 [4.768]	175 [6.890]				
3	112.6 [4.433]	175 [6.890]	131.6 [5.181]	175 [6.890]				
4	123.1 [4.846]	175 [6.890]	142.1 [5.594]	200 [7.874]				
5	133.6 [5.260]	175 [6.890]	152.6 [6.008]	200 [7.874]				
6	144.1 [5.673]	200 [7.874]	163.1 [6.421]	225 [8.858]				
7	154.6 [6.087]	200 [7.874]	173.6 [6.835]	225 [8.858]				
8	165.1 [6.500]	225 [8.858]	184.1 [7.248]	225 [8.858]				
9	175.6 [6.913]	225 [8.858]	194.6 [7.661]	250 [9.843]				
10	186.1 [7.327]	225 [8.858]	205.1 [8.075]	250 [9.843]				
11	196.6 [7.740]	250 [9.843]	215.6 [8.488]	275 [10.827]				
12	207.1 [8.154]	250 [9.843]	226.1 [8.902]	275 [10.827]				
13	217.6 [8.567]	275 [10.827]	236.6 [9.315]	275 [10.827]				
14	228.1 [8.980]	275 [10.827]	247.1 [9.728]	300 [11.811]				
15	238.6 [9.394]	300 [11.811]	257.6 [10.142]	300 [11.811]				
16	249.1 [9.807]	300 [11.811]	268.1 [10.555]	325 [12.795]				
17	259.6 [10.220]	325 [12.795]	278.6 [10.969]	350 [13.780]				
18	270.1 [10.634]	325 [12.795]	289.1 [11.382]	350 [13.780]				
19	280.6 [11.047]	325 [12.795]	299.6 [11.795]	350 [13.780]				
20	291.1 [11.461]	350 [13.780]	310.1 [12.209]	375 [14.764]				

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 5.5 mm [0.217 in] to the L1 (L2) dimension.

SOLENOID VALVES F15 series

Contents

Specifications	138
Dimensions of Single Valve Unit	144
Dimensions of Monoblock Manifold	147
Dimensions of Monoblock Manifold, Wire-saving Type	150
Dimensions of PC Board Manifold	152
Dimensions of Split Manifold Non-plug-in Type	153
Dimensions of Split Manifold Plug-in Type	155
Dimensions of Serial Transmission Compatible Manifold —	164

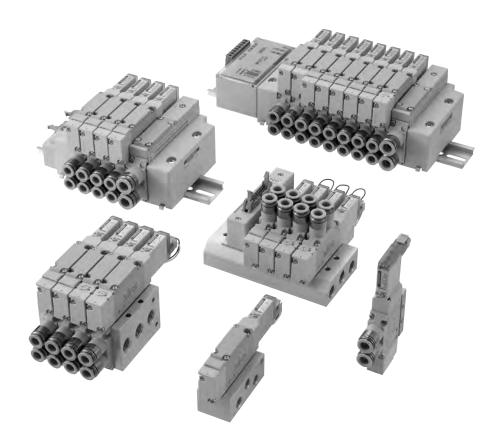

F15 SERIES Specifications

Specifications

Basic Models and Valve Functions

Basic model	F15□T0	F15⊡T1 F15⊡T2	F15□T3 F15□T4 F15□T5	F15□TA F15□TB F15□TC	
Number of positions	2 pos	sitions	3 positions	4 positions	
Number of ports		Tandem 3-port			
Valve function	Single solenoid only Both single and double solenoid use		Closed center, Exhaust center, Pressure center	NC/NC, NO/NO, NC/NO	

Remark: For the optional specifications and order codes, see p.44-71.

Specifications

<u> </u>									
		Basic model	F15□T0	F15_T3	F15 TA	F15_T0G	F15_T3G	F15 T0V	
ltom		<u> </u>	F15□T1	F15□T4	F15□TB	F15T1G	F15□T4G	F15□T1V	F15□T3V
Item			F15□T2	F15_T5	F15 TC	F15 T2G	F15□T5G	F15□T2V	
Media						Air			
Operatio	on type			Internal pilot type		External pilot type (f	or positive pressure)	External pilot ty	pe (for vacuum)
Flow rate	Sonic conductar	nce C dm ³ /(s·bar) Note1	2.05	2.05	1.60	2.05	2.05	2.05	2.05
characteristic	S Effective area	Note2 mm ² (Cv)	10.3 (0.57)	10.3 [0.57]	8 (0.44)	10.3 (0.57)	10.3 [0.57]	10.3 (0.57)	10.3 [0.57]
Port size	Note3		Dual use fitting	for $\phi 6$ and $\phi 8$,	Rc1/8, NPT1/8	M5×0.8,10-32L	JNF, dual use fittir	ng for $\phi 6$ and $\phi 8$, Rc1/8, NTP1/8
Lubrication		Not required							
Operatir	ng pressure	Main valve	0.15~0.7 MPa [22~102 psi.]			0~0.7 MPa [0~102 psi.] Note4 - 100 kPa~0.15 MPa [-29.53 in.Hg~22			— 29.53 in.Hg~22 psi.]
range		External pilot				0.2~0.7 MPa [29	9~102 psi.] Note4	0.2~0.7 MPa [29~102 psi.]	
Proof pr	essure	MPa [psi.]	1.05 [152]						
Respons	se time Note5	12VDC, 24VDC	20/25 (30) or below	15/45 (50) or below	20/30 (35) or below	20/25 (30) or below	15/45 (50) or below	20/25 (30) or below	15/45 (50) or below
ON/OFF	- ms	100VAC	20/25 or below	15/45 or below		20/25 or below	15/45 or below	20/25 or below	15/45 or below
Maximu	m operating fre	equency Hz	5						
Minimum time to energize for self holding Note6 ms		r self holding Note6 ms	50			50		50	
Operating temperature range (atmosphere and media) °C [°F]				:	5~50 [41~122]]			
Shock re	esistance	m/s ² [G]	294.2 [30] (245 [25]) Figure in parentheses is for when mounted on the split manifold.						
Mountin	g direction		Any						
					N			0	

Notes: 1. For details, see the flow rate characteristics on p.141.

2. The effective area is a calculated value, and not a measured value.

3. For details, see the port size on p.140.

4. When the main valve pressure is 0.2~0.7 MPa [29~102 psi.], set the external pilot pressure to the main valve pressure or higher, and to 0.7 MPa [102 psi.] or less.

Remark: Specification values are based on Koganei test standards.

Notes: 5. Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center. Values in parentheses () are for low-current type.

6. When used as a double solenoid valve. Excludes T0.

Solenoid Specifications

Item	Rated	d voltage	12VDC	24VDC (Standard type)	24VDC (Low-current type)	100'	100VAC		VAC	
Voltage range		v	10.8~13.2 (12±10%)	21.6~26.4 (24±10%)	21.6~26.4 (24±10%)	90~ (100±		108~ (120±	~132 :10%)	
Rated frequency		Hz	_	_	—	50	60	50	60	
Current (when rated vo	Itage is applied) n	nA (r.m.s)	33	17	—	8	}	8.	.3	
Power consump	tion	W	0.4	0.4	—	0.8	VA	1 \	1 VA	
g Current	Sta	arting mA			17			—		
(when rated voltage i	s applied) Ho	olding mA	—	—	4.2					
ed Current (when rated voltage i Power consump	St	tarting W			0.4			_		
공 Power consump	H	olding W	—	—	0.1					
Starting time (st	andard)	ms	—	—	70	_	-	_	-	
Allowable leakage	current	mA	2.0	1.0	1.0	1.	1.0 1.0			
Type of insulation					Туре В					
Insulation resistant	ce Note 1	MΩ			Over 100					
Color of LED indica	ator Note2			14	SA) : Red, 12(SB) : Gre	en				
Surge suppression (as standard)			Surge absorp	Surge absorption transistor Flywheel diode Bridge diode						

Notes: 1. Value at 500VDC megger. 2. The color of the **T0** indicator is red only. Remark: Specification values are based on Koganei test standards.

Basic Models and Valve Functions

Basic model	F15T0	F15T2	F15T3 F15T4 F15T5
Number of positions	2 pos	sitions	3 positions
Number of ports			
Valve function	Single solenoid only	Double solenoid only	Closed center, Exhaust center, Pressure center

Remark: For the optional specifications and order codes, see p.44-71.

Specifications

Item		Basic model	F15T0 F15T2	F15T3 F15T4 F15T5	F15T0G F15T2G	F15T3G F15T4G F15T5G	F15T0V F15T2V	F15T3V	
Media					A	ir			
Operatio	on type		Internal	pilot type	External pilot type (f	or positive pressure)	External pilot ty	pe (for vacuum)	
Flow rate	Sonic conducta	nce C dm ³ /(s·bar) Note1	2.05	2.05	2.05	2.05	2.05	2.05	
characteristics	^s Effective are	a Note2 mm2 (Cv)	10.3 (0.57)	10.3 (0.57)	10.3 (0.57)	10.3 (0.57)	10.3 (0.57)	10.3 (0.57)	
Port size Note3			Dual use fitting for $\phi 6$	and ϕ 8, Rc1/8, NPT1/8	M5×0.8,10-3	32UNF, dual use fitti	ng for $\phi 6$ and $\phi 8$, R	Rc1/8, NTP1/8	
Lubricat	Lubrication			Not required					
Operatir	ng pressure	Main valve	0.15~0.7 MPa	0.15~0.7 MPa [22~102 psi.] 0~0.7 MPa [0~102 psi.] Note4 - 100			— 100 kPa~0.15 MPa [$-$ 100 kPa \sim 0.15 MPa [$-$ 29.53 in.Hg \sim 22 psi.]	
range		External pilot			0.2~0.7 MPa [29~102 psi.] Note4		[29~102 psi.]		
Proof pr	essure	MPa [psi.]			1.05	[152]			
Respons	se time Note5 C	N/OFF ms	20/30 or below	15/50 or below	20/30 or below	15/50 or below	20/30 or below	15/50 or below	
Maximu	m operating fr	equency Hz			Į	5			
Minimum t	time to energize fo	r self holding Note6 ms	50		50		50		
Operating temperature range (atmosphere and media) °C [°F]			·	5~50 [4	1~122]	•			
Shock resistance m/s ² [G]		294.2	[30] (245 [25]) Figi	ure in parentheses is	s for when mounted	l on the split-type ma	anifold.		
Mounting direction				A	ny				
Notos: 1	Notes: 1 For details, see the flow rate characteristics on p.141 Notes: 5 Values when air pressure is 0.5 MPa [73 psi]. For switching phase time						itching phase timing		

Notes: 1. For details, see the flow rate characteristics on p.141.

2. The effective area is a calculated value, and not a measured value.

3. For details, see the port size on p.140.

4. When the main valve pressure is 0.2~0.7 MPa [29~102 psi.], set the external pilot pressure to the main valve pressure or higher, and to 0.7 MPa [102 psi.] or less.

Notes: 5. Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center.

6. In the case of double solenoid.

Remark: Specification values are based on Koganei test standards.

Solenoid Specifications for DIN Connector (-39) Type


Item	R	ated voltage	12VDC	24VDC	120	VAC	240	VAC
Voltage range V		10.8~13.2 (12±10%)	21.6~26.4 (24±10%)	90~	132	180~264		
	Frequency	Hz	_	_	50	60	50	60
Current	Starting	mA (r.m.s)	_	_	43 38		22	19
	Holding	mA (r.m.s)	140 (1.7W)	75 (1.8W)	29	24	14	12
Allowable	Allowable leakage current mA		8	8 4 4			2	
Insulation resistance ^{Note} MΩ			Over 1					
Surge suppression (as standard)		Surge absorp	Surge absorption transistor			Varistor		

Note: Value at 500VDC megger.

Remark: Specification values are based on Koganei test standards.

Flow Rate

How to obtain cylinder speed




Measuring conditions


- Air pressure : 0.5 MPa [73 psi.]
 Piping (outer diameter × inner diameter ×
- length) : $\phi 8 \times \phi 6 \times 1000$ mm [39 in.]
- Fitting : Quick fitting TS8-01

Port Size


- •Load ratio= $\frac{\text{Load}}{\text{Cylinder theoretical thrust}}$ (%)
- •Cylinder stroke : 150 mm [5.91 in.]








Delay time





How to read the graph

When the supply pressure is 0.5 MPa [73 psi.] and flow rate is 500 ℓ /min [17.7 ft.³/min.] (ANR), the valve outlet pressure becomes 0.4 MPa [58 psi.].

1 mm/s = 0.0394 in./sec. 1 MPa = 145 psi. 1 ℓ /min = 0.0353 ft.³/min.

	Description/Piping specification	PR	X(P2)	4(A), 2(B)	1(P), 3(R2), 5(R1), 3, 5(R)
	With sub-base	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/8, NPT1/8	Rc1/8, NPT1/8
۵.	With female thread block	—	—	Rc1/8, NPT1/8	Rc1/8, NPT1/8
Single unit	With dual use fitting block	—	_	Dual use fitting for $\phi 6$ and $\phi 8$	Rc1/8, NPT1/8
⊡ ⊐	With single use fitting block	—	—	φ6 or φ8	Rc1/8, NPT1/8
	Monoblock type with female thread block, and PC board type with female thread block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/8, NPT1/8	Rc1/4, NPT1/4
	Monoblock type with fitting block, and PC board type with fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Dual use fitting for $\phi 6$ and $\phi 8$	Rc1/4, NPT1/4
Manifold	Monoblock type with single use fitting block, and PC board type with single use fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	φ6 or φ8	Rc1/4, NPT1/4
lani	Split type with female thread block, and serial transmission type with female thread block	—	M5×0.8, 10-32UNF	Rc1/8, NPT1/8	Rc1/4, NPT1/4
2	Split type with fitting block, and serial transmission type with fitting block	_	M5×0.8, 10-32UNF	Dual use fitting for $\phi 6$ and $\phi 8$	Dual use fitting for ϕ 8 and ϕ 10
	Split type with single use fitting block, and serial transmission type with single use fitting block	_	M5×0.8, 10-32UNF	φ6 or φ8	Single use fitting for ϕ 8 or ϕ 10

• When used as a single unit

	1(P)→2(B)	2(B)→3(R2)/4(A)→5(R1)			
Basic model	Sonic conductance C dm ³ /(s·bar)	Critical pressure ratio b	Sonic conductance C dm ³ /(s•bar)	Critical pressure ratio b	
F15 T0-A2					
F15□T1-A2	1.76	0.25	1.72	0.26	
F15 T2-A2					
F15 T3-A2					
F15_T4-A2	1.78	0.25	1.72	0.24	
F15 T5-A2					
F15 TA-A2					
F15 TB-A2	1.53	0.26	1.61	0.23	
F15 TC-A2					
F15 T0-F3 F15 T1-F3	1.00	0.05	4 74	0.00	
F15 T2-F3	1.80	0.25	1.71	0.29	
F15 T3-F3					
F15 T4-F3	1.81	1.81 0.23	1.61	0.27	
F15 T5-F3	1.01	0.20	1.01	0.27	
F15 TA-F3					
F15 TB-F3	1.57	0.28	1.57	0.24	
F15 TC-F3					
F15 T0-F4					
F15□T1-F4	1.83	0.30	1.62	0.33	
F15_T2-F4					
F15 T3-F4					
F15_T4-F4	1.57	0.36	1.51	0.25	
F15_T5-F4					
F15 TA-F4					
F15 TB-F4	1.54	0.31	1.55	0.27	
F15 TC-F4					

	1(P)→2(B)	/1(P)→4(A)	2(B)→3(R2)/4(A)→5(R1)		
Basic model	Sonic conductance C	Critical pressure ratio	Sonic conductance C	Critical pressure ratio	
	dm ³ /(s·bar)	b	dm ³ /(s·bar)	b	
F15 T0-F5					
F15 T1-F5	1.62	0.38	1.56	0.28	
F15 T2-F5					
F15 T3-F5					
F15 T4-F5	1.57	0.36	1.51	0.25	
F15 T5-F5					
F15 TA-F5					
F15 TB-F5	1.44	0.34	1.46	0.24	
F15 TC-F5					
F15 T0-F6			1.70	0.30	
F15 T1-F6	1.86	0.30			
F15 T2-F6					
F15□T3-F6					
F15 T4-F6	1.84	0.29	1.64	0.29	
F15 T5-F6					
F15 TA-F6					
F15 TB-F6	1.58	0.31	1.57	0.31	
F15 TC-F6					

When mounted on a manifold

	Manifold model	F15M	F(FP)	F15M	A(AP)	F15M	N(P)(S)
	<u> </u>	1(P)→2(B)/1(P)→4(A)	2(B)→3(R2)/4(A)→5(R1)	1(P)→2(B)/1(P)→4(A)	2(B)→3(R2)/4(A)→5(R1)	1(P)→2(B)/1(P)→4(A)	2(B)→3(R2)/4(A)→5(R1)
Valve mode		Sonic conductant	ce C dm ³ /(s•bar)	Sonic conductant	ce C dm³/(s•bar)	Sonic conductant	ce C dm ³ /(s·bar)
F15 T0							
F15 T1		1.72	1.56	1.56	1.46	2.01	1.84
F15 T2	Outlet port						
F15 T3	dual use fitting						
F15 T4	for $\phi 6$ and $\phi 8$	1.72	1.53	1.57	1.43	2.02	1.78
F15 T5	These are the cases of ϕ 8.						
F15 TA							
F15 TB		1.48	1.47	1.38	1.34	1.57	1.61
F15 TC							
F15 T0							
F15 T1		1.50	1.46	1.38	1.39	1.67	1.70
F15 T2	-						
F15_13_ F15_T4_	Outlet port	1.52	1.46	1.39	1.37	1.67	1.66
F15_14_	ϕ 6 fitting	1.52	1.40	1.39	1.37	1.07	1.00
F15_TA_	-						
F15_TB_		1.37	1.39	1.28	1.30	1.41	1.50
F15 TC		1.07	1.00	1.20	1.00		1.00
F15 T0							
F15 T1		1.73	1.56	1.60	1.47	2.05	1.83
F15 T2							
F15 T3							
F15 T4	Outlet port	1.72	1.54	1.60	1.45	2.05	1.78
F15 T5	φ8 fitting						
F15 TA	1						
F15 TB		1.49	1.48	1.39	1.36	1.58	1.60
F15 TC							

Notes: 1. When the individual air supply spacer or the individual air exhaust spacer, the back pressure prevention valve, or the stop valve is used, sonic conductance decreases by about 30%.

2: For the flow rate characteristics of other outlet ports, consult us.

Remark: Specification values are based on Koganei test standards.

Single	Valve	Unit	Mass
--------	-------	------	------

single valve onit mass glo								
F15T	F15_TA1	F15_TA2	F15 T -FJ	F15_TFJ5	F15 T -FJ6			
Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion			
None	With plate	With plate	With dual use fitting block	With $\phi 6$ fitting block	With ϕ 8 fitting block			
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion			
None	None	With A type sub-base	None	None	None			
82 [2.89]	101 [3.56]	210 [7.41]	114 [4.02]	125 [4.41]	130 [4.59]			

					g [oz.]	
F15 T FM		F15_TF3	F15_TF4	F15_TF5	F15 T	
	Outlet portion Outlet portion With female thread block With dual use fitting block Inlet portion Inlet portion		Outlet portion	Outlet portion	Outlet portion	
			With female thread block	With ϕ 6 fitting block	With ϕ 8 fitting block	
			Inlet portion	Inlet portion	Inlet portion	
None With fem		With female thread block	With female thread block	With female thread block	With female thread block	
	104 [3.67]	127 [4.48]	117 [4.13]	138 [4.87]	143 [5.04]	

Basic Type F15T0 is 13 g [0.46 oz.] less than the mass shown above.

Monoblock Manifold Mass (single valve unit included)

Monoblock manifold	Mass calculation of each unit						
		4(A), 2(B) ports outlet specifications					
	Female thread blockDual use fitting block $\phi 6$		ϕ 6 fitting block	ϕ 8 fitting block			
A type	(230×n)+128 [(8.11×n)+4.51]	(240×n)+128 [(8.47×n)+4.51]	(251×n)+128 [(8.85×n)+4.51]	(256×n)+128 [(9.03×n)+4.51]			
F type	$(156 \times n) + 116 [(5.50 \times n) + 4.09]$	(166×n)+116 [(5.86×n)+4.09]	(177×n)+116 [(6.24×n)+4.09]	(182×n)+116 [(6.42×n)+4.09]			

Additional mass (wire-saving type) Monoblock manifold Wiring specification -F100N, -F101N -F200N, -F201N, -F260N -D250N, -D251N 340+4n [11.99+0.14n] 342+4n [12.06+0.14n] 346+4n [12.20+0.14n] A type 194+4n [6.84+0.14n] 198+4n [6.98+0.14n] F type 192+4n [6.77+0.14n]

Calculation example : F15M8AM

stn.1~stn.8 F15T1-A1-PS DC24V

(230×8)+128=1968 g [69.42 oz.]

When mounting the block-off plate, subtract 100 g [3.53 oz] per unit from the above calculation result.

When mounting the F15 T0 specification valve, subtract 13 g [0.46 oz.] per unit from the above calculation result.

PC Board Manifold Mass (single valve unit included)

		Mass calculation of each unit						
PC board manifold		Circuit board and						
	Female thread block	Dual use fitting block	ϕ 6 fitting block	ϕ 8 fitting block	connector portion			
A type	(230×n)+128 [(8.11×n)+4.51]	(240×n)+128 [(8.47×n)+4.51]	(251×n)+128 [(8.85×n)+4.51]	(256×n)+128 [(9.03×n)+4.51]	(2×n)+29			
F type	(162×n)+121 [(5.71×n)+4.27]	(172×n)+121 [(6.07×n)+4.27]	(183×n)+121 [(6.46×n)+4.27]	(188×n)+121 [(6.63×n)+4.27]	[(0.07×n)+1.02]			

Calculation example : F15M8APM-F201-W

stn.1~stn.8 F15T1-A1-PP DC24V

(230×8)+128+(2×8)+29=2013 g [71.01 oz.]

When mounting the block-off plate, subtract 100 g [3.53 oz] per unit from the above calculation result.

When mounting the F15 T0 specification valve, subtract 13 g [0.46 oz.] per unit from the above calculation result.

g [oz.]

g [oz.]

g [oz.]

Mass of Split Manifold and Serial Transmission Compatible Manifold

Because the valve and manifold have the same output specifications, their mass is the same. The mass can only be changed by choosing a different type of inlet/ outlet block.

Mass of Split Manifold Non-Plug-in Type (single valve unit included)

	Mass calculation of each unit			
New also in time	4(A), 2(B) ports outlet specifications			
Non-plug-in type	Female thread block	Dual use fitting block	$\checkmark \phi 6$ fitting block $\phi 8$ fitting	
	$(173 \times n) + 249$ [(6.10×n)+8.78]	(183×n)+249 [(6.46×n)+8.78]	(194×n)+249 [(6.84×n)+8.78]	(199×n)+249 [(7.02×n)+8.78]

g [oz.]

g [oz.]

Additional mass			
Piping block specification			
Female thread block	Dual use fitting block	ϕ 8 fitting block	ϕ 10 fitting block
153 [5.40]	167 [5.89]	191 [6.74]	201 [7.09]

Calculation example : F15M8N-MR

stn.1~stn.8 F15T1-A1-PS DC24V

(173×8)+249+153=1786 g [63.00 oz.]

When mounting the block-off plate, subtract 100 g [3.53 oz] per unit from the above calculation result.

When mounting the F15 T0 specification valve, subtract 13 g [0.46 oz.] per unit from the above calculation result.

Mass of Split Manifold Plug-in Type/ Serial Transmission Compatible Manifold (single valve unit included) g [oz.]

	Mass calculation of each unit			
Plug-in type	4(A), 2(B) ports outlet specifications			
Serial transmission compatible manifold	Female thread block	Dual use fitting block	ϕ 6 fitting block	ϕ 8 fitting block
	(177×n)+249 [(6.24×n)+8.78]	(187×n)+249 [(6.60×n)+8.78]	(198×n)+249 [(6.98×n)+8.78]	(203×n)+249 [(7.16×n)+8.78]

			g [oz.]		
	Additional mass				
	Piping block specification				
Female thread block	Dual use fitting block	ϕ 8 fitting block	ϕ 10 fitting block		
153 [5.40]	167 [5.89]	191 [6.74]	201 [7.09]		

				g [oz.]
	Additional mass			
Wiring block specification				
-F100, -F101	-F200 , -F201 , -F260	-D250, -D251	-D370NU	-T200
32 [1.13]	34 [1.20]	39 [1.38]	72 [2.54]	158 [5.57]

			g [oz.]	
Additional mass				
Serial transmission block specification				
Stand-alone type	Integrated type	EtherCAT	EtherNet/IP	
231 [8.15]	138 [4.87]	100 [3.53]	110 [3.88]	

Calculation example : F15M8PM-MR-F201 DC24V

stn.1~stn.8 F15T1-A1 DC24V

(177×8)+249+153+34=1852 g [65.33 oz.]


When mounting the block-off plate, subtract 100 g [3.53 oz] per unit from the above calculation result.

When mounting the F15 T0 specification valve, subtract 13 g [0.46 oz.] per unit from the above calculation result.

F15T Valve specifications -F3-PS

With outlet port dual use fitting block With inlet port female thread block S type plug connector


* For T0 Type dimensions, see page 145.

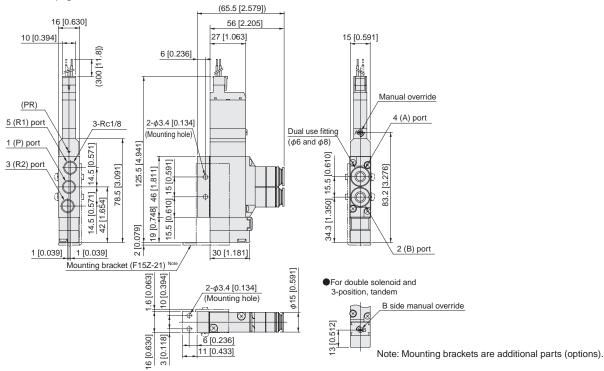

F15TValve specifications-F4-PSF15TValve specifications-F4H-PS


With outlet port female thread block With inlet port female thread block S type plug connector

* For T0 Type dimensions, see page 145.

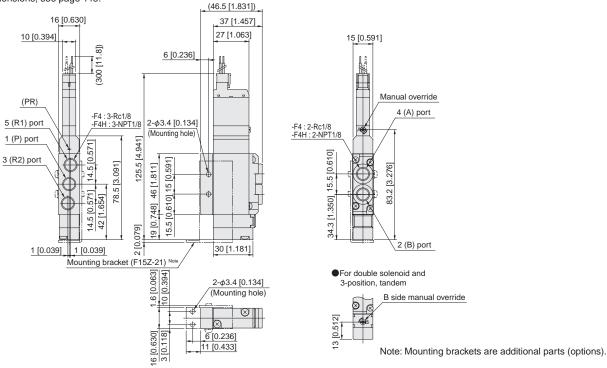


F15T0-F -PS

With outlet port single use fitting block With inlet port female thread block S type plug connector

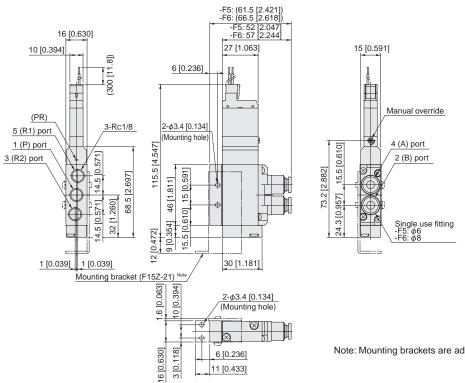


Note: Mounting brackets are additional parts (options).

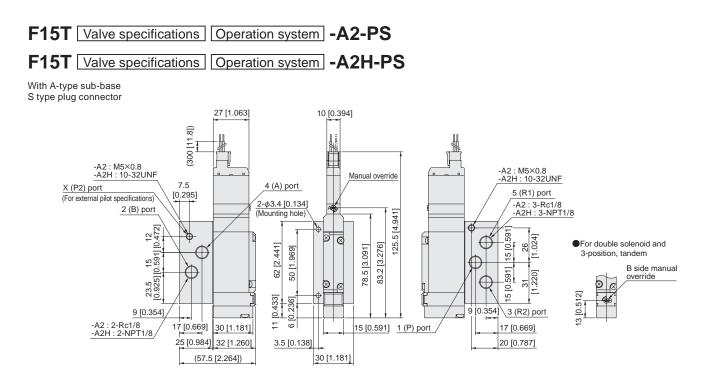


Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side extension is 10 mm [0.394 in] less).

Options

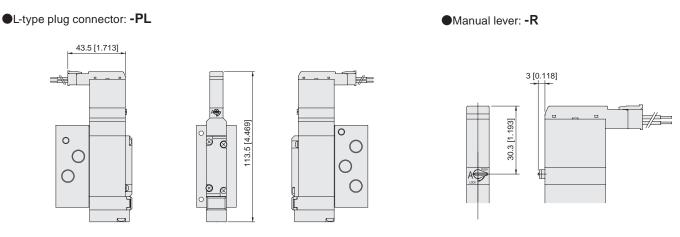


Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side extension is 10 mm [0.394 in] less).

Solenoid with DIN type connector: -39

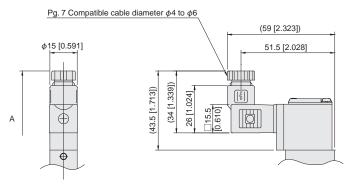

Protruding lock type manual override: -83

Symbol Model	A (Full length)
F15T0	117.2 [4.614]
F15T2	170.4 [6.709]
F15T3 to T5	180.4 [7.102]



Monoblock manifold A type

With manifold outlet port dual use fitting block S type plug connector

ġ


Lr

6-Rc1/4


(Same on opposite side)

5 (R1) port


1 (P) port 3 (R2) port

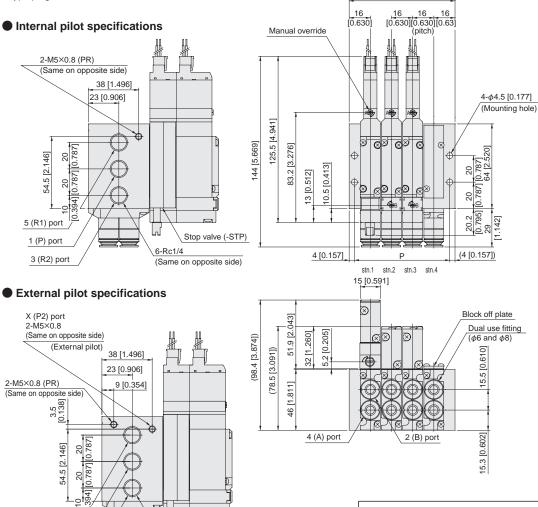



Unit dimension			
Number of units	L	Р	
2	48 [1.890]	40 [1.575]	
3	64 [2.520]	56 [2.205]	
4	80 [3.150]	72 [2.835]	
5	96 [3.780]	88 [3.465]	
6	112 [4.409]	104 [4.094]	
7	128 [5.039]	120 [4.724]	
8	144 [5.669]	136 [5.354]	
9	160 [6.299]	152 [5.984]	
10	176 [6.929]	168 [6.614]	
11	192 [7.559]	184 [7.244]	
12	208 [8.189]	200 [7.874]	
13	224 [8.819]	216 [8.504]	
14	240 [9.449]	232 [9.134]	
15	256 [10.079]	248 [9.764]	
16	272 [10.709]	264 [10.394]	
17	288 [11.339]	280 [11.024]	
18	304 [11.969]	296 [11.654]	
19	320 [12.598]	312 [12.283]	
20	336 [13.228]	328 [12.913]	




L









Monoblock manifold A type With manifold outlet port female thread block S type plug connector

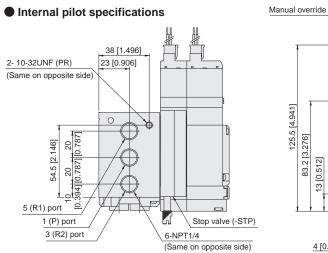

External pilot specifications



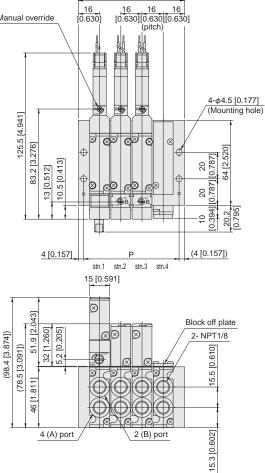

Unit dimensions


•••••		
Number of units	L	Р
2	48 [1.890]	40 [1.575]
3	64 [2.520]	56 [2.205]
4	80 [3.150]	72 [2.835]
5	96 [3.780]	88 [3.465]
6	112 [4.409]	104 [4.094]
7	128 [5.039]	120 [4.724]
8	144 [5.669]	136 [5.354]
9	160 [6.299]	152 [5.984]
10	176 [6.929]	168 [6.614]
11	192 [7.559]	184 [7.244]
12	208 [8.189]	200 [7.874]
13	224 [8.819]	216 [8.504]
14	240 [9.449]	232 [9.134]
15	256 [10.079]	248 [9.764]
16	272 [10.709]	264 [10.394]
17	288 [11.339]	280 [11.024]
18	304 [11.969]	296 [11.654]
19	320 [12.598]	312 [12.283]
20	336 [13.228]	328 [12.913]


F15M Number of valves **F** (Direct piping type)


Number of units I. Р Monoblock manifold F type 23 With valve outlet port dual use fitting block 62 [2.441] 40 [1.575] Manual override (pitch) 2 S type plug connector 78 [3.071] 56 [2.205] 3 6-Rc1/4 72 [2.835] 94 (Same on opposite side) 4 [3.701] 4 (A) port 4-φ4.5 [0.177] 5 (R1) port 110 88 2 (B) port 5 (Mounting hole) [4.331] [3.465] 104 [4.094] 125.5 [4.941] 126 [4.961] 6 20.5 [0.807 Č 15.5 [0.610] 142 [5.591] 120 \otimes 7 83.2 [3.276] [4.724] 520] 18 [0.709] 158 136 8 64 [2.5 20.5 [0.807] [5.354] [6.220] 32 [1.260] 34.3 [1.350] 23 [0.906] 13 [0.512] 174 152 9 [6.850] [5.984] 190 168 10 10 [0.394] [7.480] 19.7 [6.614] 1 (P) port 0 184 206 3 (R2) port 11 [8.110] [7.244] 11 [0.433] Р (11 [0.433]) 10.5 [0.413] Stop valve (-STP) 222 200 stn.1 stn.2 stn.3 stn.4 12 [7.874] [8.740] 13 [0.512] 15 [0.591] 238 [9.370] 216 13 [8.504] Dual use fitting (ϕ 6 and ϕ 8) (Rc1/8 female thread can also be selected.) 254 232 14 [10.000] [9.134] (Single use fitting can also be selected.) 248 [9.764] 270 15 -1 1 [10.630] 75.9 [2.988] \otimes 100.4 [3.953]) 286 [11.260] 264 [10.394] 56 [2.205] 16 (80.5 [3.169]) 5.2 [0.205] ଇଷ 280 [11.024] 302 Block off plate 17 [11.890] ⊕ 318 296 [0.945] 18 [11.654] 12.520] 334 312 19 [12.283] 4 [13.150] 350 328 [13.780] [12.913]

Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side protrusion is 10 mm [0.394 in] less).

F15M Number of valves **FH** (Direct piping type)







Unit dimensions


20

Number of units	L	Р
2	62 [2.441]	40 [1.575]
3	78 [3.071]	56 [2.205]
4	94 [3.701]	72 [2.835]
5	110 [4.331]	88 [3.465]
6	126 [4.961]	104 [4.094]
7	142 [5.591]	120 [4.724]
8	158 [6.220]	136 [5.354]
9	174 [6.850]	152 [5.984]
10	190 [7.480]	168 [6.614]
11	206 [8.110]	184 [7.244]
12	222 [8.740]	200 [7.874]
13	238 [9.370]	216 [8.504]
14	254 [10.000]	232 [9.134]
15	270 [10.630]	248 [9.764]
16	286 [11.260]	264 [10.394]
17	302 [11.890]	280 [11.024]
18	318 [12.520]	296 [11.654]
19	334 [13.150]	312 [12.283]
20	350 [13.780]	328 [12.913]

Unit dimensions


Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side protrusion is 10 mm [0.394 in] less).

F15 SERIES

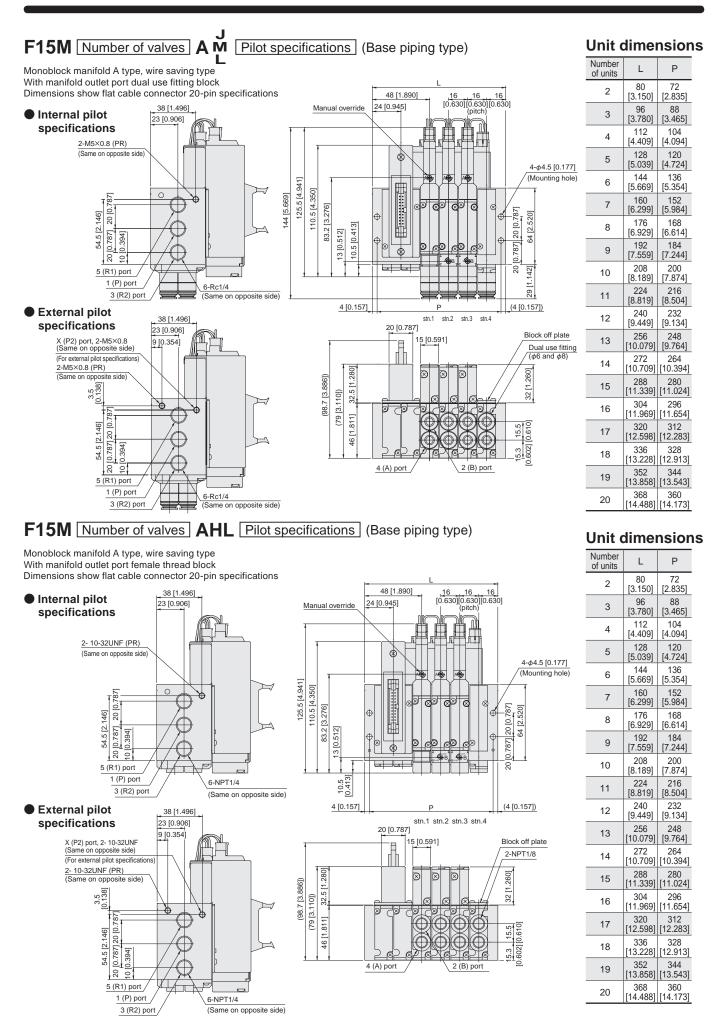

150 KOGANEI

F15M Number of valves **F** (Direct piping type)

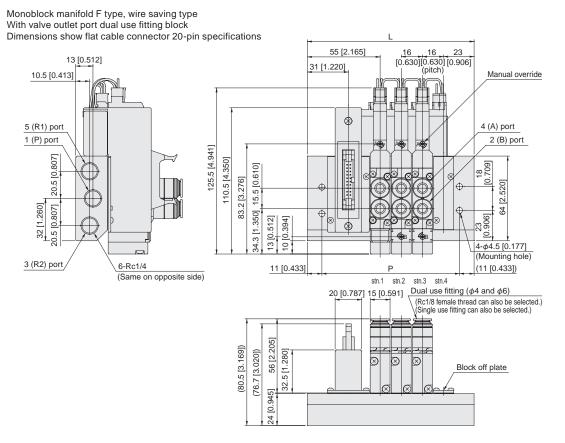


Unit dimensions Р L

Number of units 72 [2.835] 94 [3.701] 2 110 88 3 [3.465] [4.331] 126 [4.961] 104 [4.094] 4 120 142 5 [5.591] [4.724] 136 [5.354] 158 6 [6.220] 174 152 7 [6.850] [5.984] 190 [7.480] 168 [6.614] 8 206 184 9 [8.110] [7.244] 200 222 10 [8.740] [7.874] 238 216 11 [9.370] [8.504] 254 232 12 10.000] [9.134] 248 270 13 [10.630] [9.764] 286 264 14 [11.260] [10.394] 302 280 [11.890] [11.024] 15 296 [11.654] 318 16 [12.520] 334 312 [12.283] 17 13.150] 350 [13.780] 328 [12.913] 18 366 344 [14.409] [13.543] 19 382 360 [15.039] [14.173] 20

F15M Number of valves **FH** (Direct piping type)

Monoblock manifold F type, wire saving type

With valve outlet port female thread block Dimensions show flat cable connector 20-pin specifications

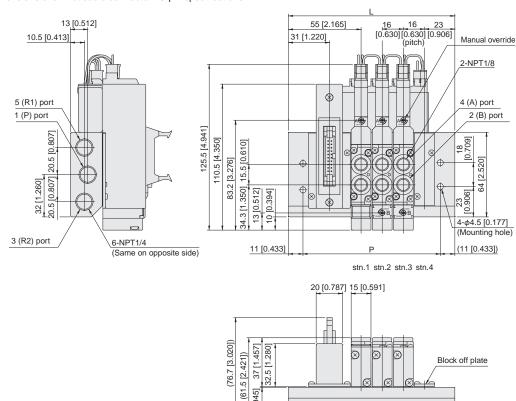


[0.945] 24

 \bigotimes

Unit dimensions

Number of units	L	Р
2	94 [3.701]	72 [2.835]
3	110 [4.331]	88 [3.465]
4	126 [4.961]	104 [4.094]
5	142 [5.591]	120 [4.724]
6	158 [6.220]	136 [5.354]
7	174 [6.850]	152 [5.984]
8	190 [7.480]	168 [6.614]
9	206 [8.110]	184 [7.244]
10	222 [8.740]	200 [7.874]
11	238 [9.370]	216 [8.504]
12	254 [10.000]	232 [9.134]
13	270 [10.630]	248 [9.764]
14	286 [11.260]	264 [10.394]
15	302 [11.890]	280 [11.024]
16	318 [12.520]	296 [11.654]
17	334 [13.150]	312 [12.283]
18	350 [13.780]	328 [12.913]
19	366 [14.409]	344 [13.543]
20	382 [15.039]	360 [14.173]

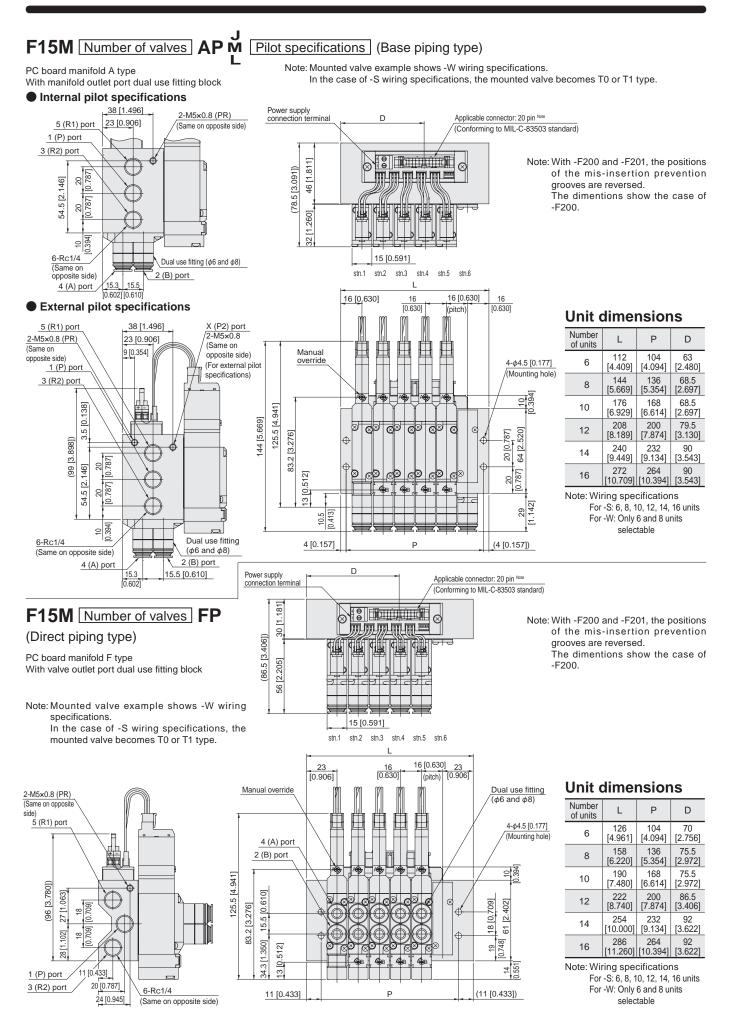


Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side protrusion is 10 mm [0.394 in] less).

J **F15M** Number of valves

N M Pilot specifications (Base piping type)

With manifold outlet port dual use fitting block S type plug connector

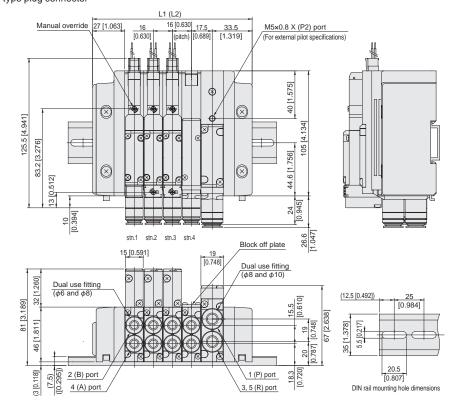


Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	102 [4.016]	150 [5.906]	121 [4.764]	150 [5.906]
3	118 [4.646]	150 [5.906]	137 [5.394]	175 [6.890]
4	134 [5.276]	175 [6.890]	153 [6.024]	200 [7.874]
5	150 [5.906]	175 [6.890]	169 [6.654]	200 [7.874]
6	166 [6.535]	200 [7.874]	185 [7.283]	225 [8.858]
7	182 [7.165]	225 [8.858]	201 [7.913]	250 [9.843]
8	198 [7.795]	225 [8.858]	217 [8.543]	250 [9.843]
9	214 [8.425]	250 [9.843]	233 [9.173]	275 [10.827]
10	230 [9.055]	275 [10.827]	249 [9.803]	275 [10.827]
11	246 [9.685]	275 [10.827]	265 [10.433]	300 [11.811]
12	262 [10.315]	300 [11.811]	281 [11.063]	325 [12.795]
13	278 [10.945]	325 [12.795]	297 [11.693]	325 [12.795]
14	294 [11.575]	325 [12.795]	313 [12.323]	350 [13.780]
15	310 [12.205]	350 [13.780]	329 [12.953]	375 [14.764]
16	326 [12.835]	375 [14.764]	345 [13.583]	375 [14.764]
17	342 [13.465]	375 [14.764]	361 [14.213]	400 [15.748]
18	358 [14.094]	400 [15.748]	377 [14.843]	425 [16.732]
19	374 [14.724]	400 [15.748]	393 [15.472]	425 [16.732]
20	390 [15.354]	425 [16.732]	409 [16.102]	450 [17.717]
Note: W/ben two nining blocks are used				

Note: When two piping blocks are used.

F15M Number of valves **N** Pilot specifications (Direct piping type)

With valve outlet port dual use fitting block S type plug connector

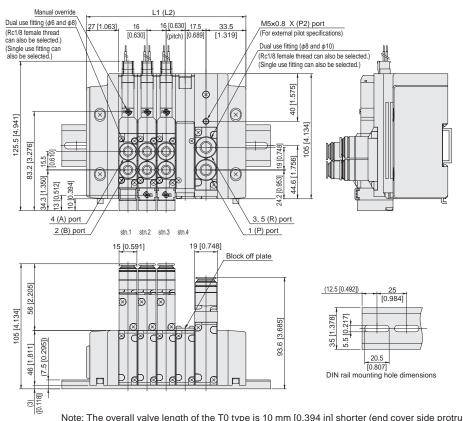


Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	102 [4.016]	150 [5.906]	121 [4.764]	150 [5.906]
3	118 [4.646]	150 [5.906]	137 [5.394]	175 [6.890]
4	134 [5.276]	175 [6.890]	153 [6.024]	200 [7.874]
5	150 [5.906]	175 [6.890]	169 [6.654]	200 [7.874]
6	166 [6.535]	200 [7.874]	185 [7.283]	225 [8.858]
7	182 [7.165]	225 [8.858]	201 [7.913]	250 [9.843]
8	198 [7.795]	225 [8.858]	217 [8.543]	250 [9.843]
9	214 [8.425]	250 [9.843]	233 [9.173]	275 [10.827]
10	230 [9.055]	275 [10.827]	249 [9.803]	275 [10.827]
11	246 [9.685]	275 [10.827]	265 [10.433]	300 [11.811]
12	262 [10.315]	300 [11.811]	281 [11.063]	325 [12.795]
13	278 [10.945]	325 [12.795]	297 [11.693]	325 [12.795]
14	294 [11.575]	325 [12.795]	313 [12.323]	350 [13.780]
15	310 [12.205]	350 [13.780]	329 [12.953]	375 [14.764]
16	326 [12.835]	375 [14.764]	345 [13.583]	375 [14.764]
17	342 [13.465]	375 [14.764]	361 [14.213]	400 [15.748]
18	358 [14.094]	400 [15.748]	377 [14.843]	425 [16.732]
19	374 [14.724]	400 [15.748]	393 [15.472]	425 [16.732]
20	390 [15.354]	425 [16.732]	409 [16.102]	450 [17.717]

Note: When two piping blocks are used.

Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side protrusion is 10 mm [0.394 in] less).

With manifold outlet port female thread block S type plug connector

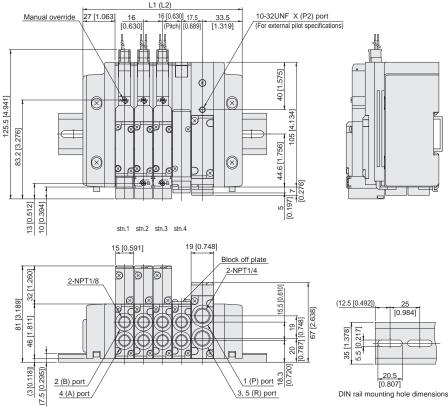


Unit	dimen	eione
Unit	aimen	SIONS

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note	
2	102 [4.016]	150 [5.906]	121 [4.764]	150 [5.906]	
3	118 [4.646]	150 [5.906]	137 [5.394]	175 [6.890]	
4	134 [5.276]	175 [6.890]	153 [6.024]	200 [7.874]	
5	150 [5.906]	175 [6.890]	169 [6.654]	200 [7.874]	
6	166 [6.535]	200 [7.874]	185 [7.283]	225 [8.858]	
7	182 [7.165]	225 [8.858]	201 [7.913]	250 [9.843]	
8	198 [7.795]	225 [8.858]	217 [8.543]	250 [9.843]	
9	214 [8.425]	250 [9.843]	233 [9.173]	275 [10.827]	
10	230 [9.055]	275 [10.827]	249 [9.803]	275 [10.827]	
11	246 [9.685]	275 [10.827]	265 [10.433]	300 [11.811]	
12	262 [10.315]	300 [11.811]	281 [11.063]	325 [12.795]	
13	278 [10.945]	325 [12.795]	297 [11.693]	325 [12.795]	
14	294 [11.575]	325 [12.795]	313 [12.323]	350 [13.780]	
15	310 [12.205]	350 [13.780]	329 [12.953]	375 [14.764]	
16	326 [12.835]	375 [14.764]	345 [13.583]	375 [14.764]	
17	342 [13.465]	375 [14.764]	361 [14.213]	400 [15.748]	
18	358 [14.094]	400 [15.748]	377 [14.843]	425 [16.732]	
19	374 [14.724]	400 [15.748]	393 [15.472]	425 [16.732]	
20	390 [15.354]	425 [16.732]	409 [16.102]	450 [17.717]	
Note: Wh	Note: When two piping blocks are used.				

F15M Number of valves NH Pilot specifications (Direct piping type)

With valve outlet port female thread block S type plug connector

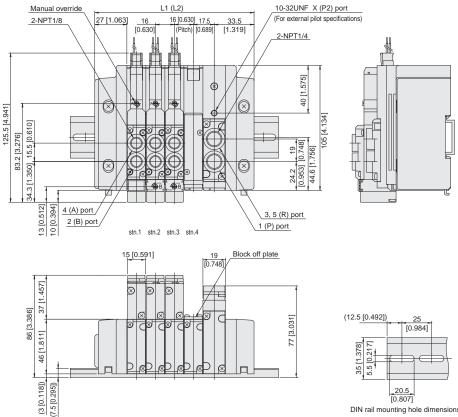

Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	102 [4.016]	150 [5.906]	121 [4.764]	150 [5.906]
3	118 [4.646]	150 [5.906]	137 [5.394]	175 [6.890]
4	134 [5.276]	175 [6.890]	153 [6.024]	200 [7.874]
5	150 [5.906]	175 [6.890]	169 [6.654]	200 [7.874]
6	166 [6.535]	200 [7.874]	185 [7.283]	225 [8.858]
7	182 [7.165]	225 [8.858]	201 [7.913]	250 [9.843]
8	198 [7.795]	225 [8.858]	217 [8.543]	250 [9.843]
9	214 [8.425]	250 [9.843]	233 [9.173]	275 [10.827]
10	230 [9.055]	275 [10.827]	249 [9.803]	275 [10.827]
11	246 [9.685]	275 [10.827]	265 [10.433]	300 [11.811]
12	262 [10.315]	300 [11.811]	281 [11.063]	325 [12.795]
13	278 [10.945]	325 [12.795]	297 [11.693]	325 [12.795]
14	294 [11.575]	325 [12.795]	313 [12.323]	350 [13.780]
15	310 [12.205]	350 [13.780]	329 [12.953]	375 [14.764]
16	326 [12.835]	375 [14.764]	345 [13.583]	375 [14.764]
17	342 [13.465]	375 [14.764]	361 [14.213]	400 [15.748]
18	358 [14.094]	400 [15.748]	377 [14.843]	425 [16.732]
19	374 [14.724]	400 [15.748]	393 [15.472]	425 [16.732]
20	390 [15.354]	425 [16.732]	409 [16.102]	450 [17.717]

Note: When two piping blocks are used.


DIN rail mounting hole dimensions

Note: The overall valve length of the T0 type is 10 mm [0.394 in] shorter (end cover side protrusion is 10 mm [0.394 in] less).

F15M Number of valves


P M Pilot specifications (Base piping type)

With manifold outlet port dual use fitting block

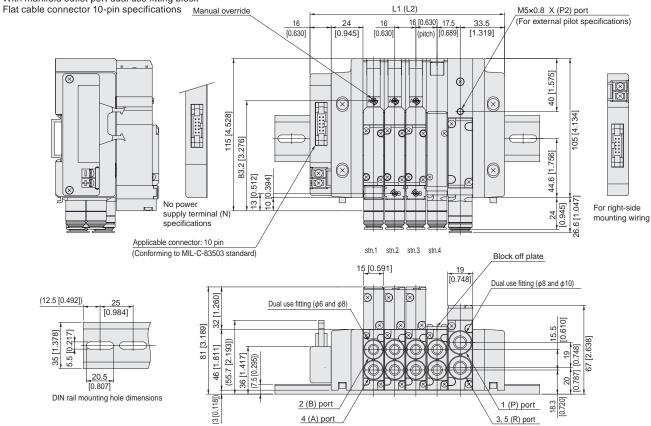

2 (B) port

4 (A) port

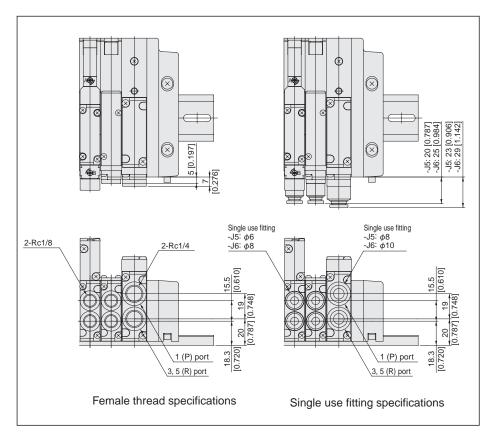

Unit dimensions

1 (P) port

3, 5 (R) port

18.3


Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]

Note: When two piping blocks are used.

For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port dual use fitting block

Flat cable connector 20-pin specifications (side surface wiring)

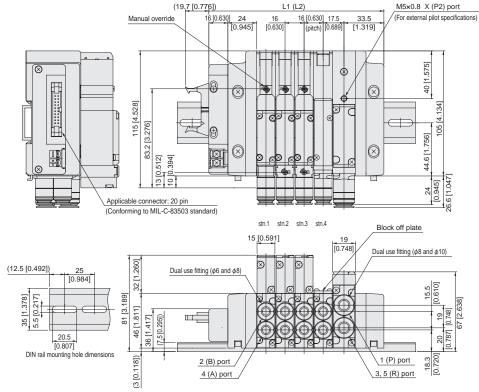

Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]


Note: When two piping blocks are used.

* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port dual use fitting block Flat cable connector 26-pin specifications

Ρ

F15M Number of valves

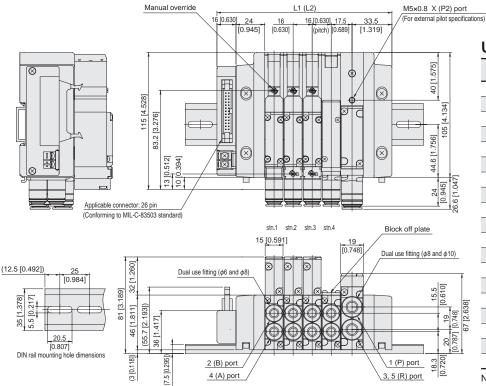

M [Pilot specifications] (Base piping type)


Unit dimensions


Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used.

* For right-side mounting wiring (-R), add

3 mm [0.118 in] to the L1 (L2) dimension.

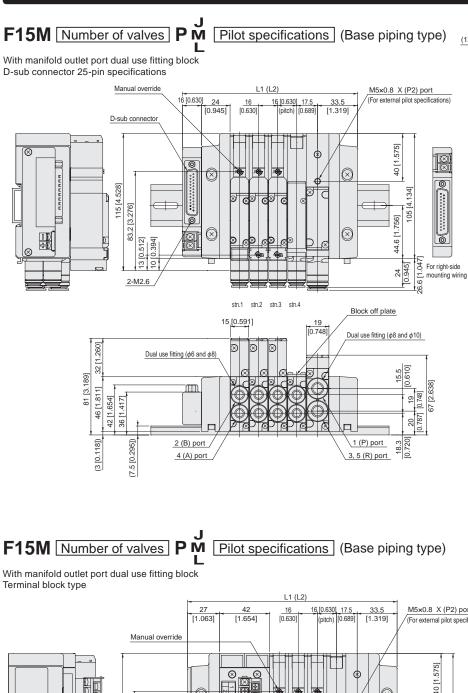




Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note	
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]	
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]	
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]	
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]	
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]	
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]	
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]	
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]	
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]	
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]	
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]	
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]	
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]	
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]	
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]	
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]	
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]	
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]	
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]	

Note: When two piping blocks are used.

* For right-side mounting wiring (-R), add

3 mm [0.118 in] to the L1 (L2) dimension.

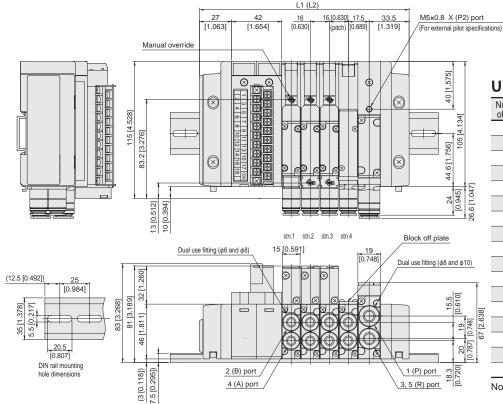


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	144 [5.669]	175 [6.890]	163 [6.417]	200 [7.874]
3	160 [6.299]	200 [7.874]	179 [7.047]	225 [8.858]
4	176 [6.929]	225 [8.858]	195 [7.677]	225 [8.858]
5	192 [7.559]	225 [8.858]	211 [8.307]	250 [9.843]
6	208 [8.189]	250 [9.843]	227 [8.937]	275 [10.827]
7	224 [8.819]	250 [9.843]	243 [9.567]	275 [10.827]
8	240 [9.449]	275 [10.827]	259 [10.197]	300 [11.811]
9	256 [10.079]	300 [11.811]	275 [10.827]	300 [11.811]
10	272 [10.709]	300 [11.811]	291 [11.457]	325 [12.795]
11	288 [11.339]	325 [12.795]	307 [12.087]	350 [13.780]
12	304 [11.969]	350 [13.780]	323 [12.717]	350 [13.780]
13	320 [12.598]	350 [13.780]	339 [13.346]	375 [14.764]
14	336 [13.228]	375 [14.764]	355 [13.976]	400 [15.748]
15	352 [13.858]	400 [15.748]	371 [14.606]	400 [15.748]
16	368 [14.488]	400 [15.748]	387 [15.236]	425 [16.732]
17	384 [15.118]	425 [16.732]	403 [15.866]	450 [17.717]
18	400 [15.748]	425 [16.732]	419 [16.496]	450 [17.717]

Note: When two piping blocks are used.

With manifold outlet port female thread block Flat cable connector 10-pin specifications

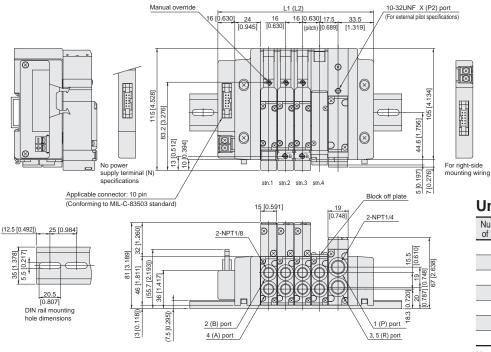


Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Flat cable connector 10-pin specifications

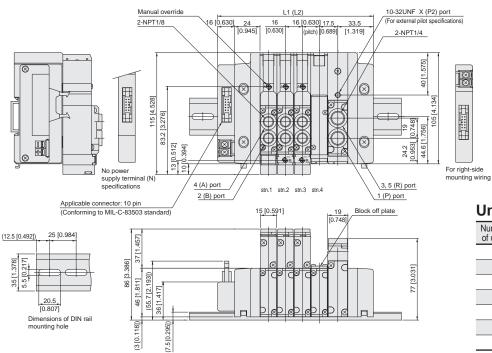


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block

Flat cable connector 20-pin specifications (top surface wiring)

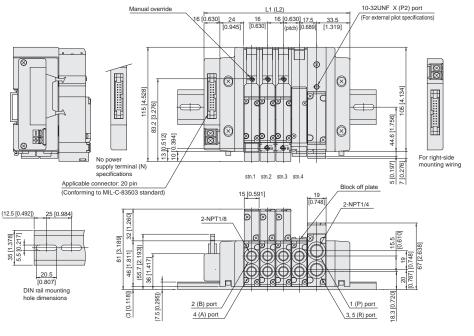

Unit dimensions


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block

Flat cable connector 20-pin specifications (top surface wiring)

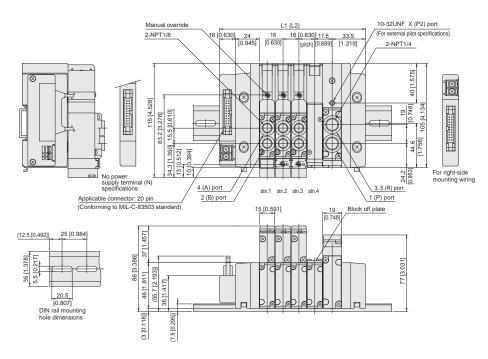

Unit dimensions


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]

Note: When two piping blocks are used.

* For right-side mounting wiring (-R), add


3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block Flat cable connector 26-pin specifications

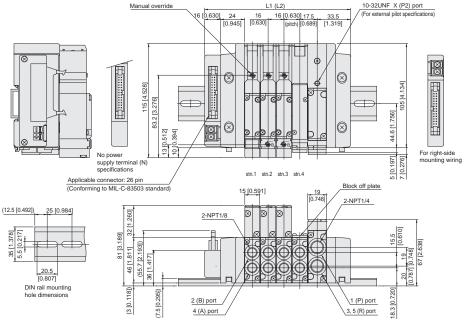

F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Flat cable connector 26-pin specifications

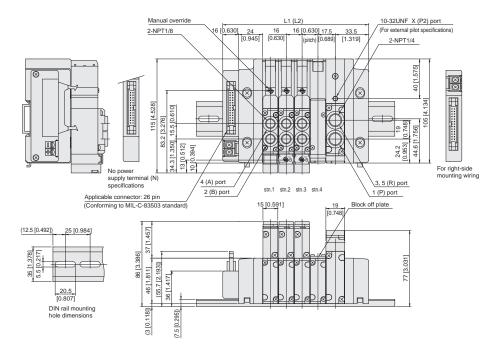

Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.


Unit dimensions

	-			
Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used.


* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block D-sub connector 25-pin specifications

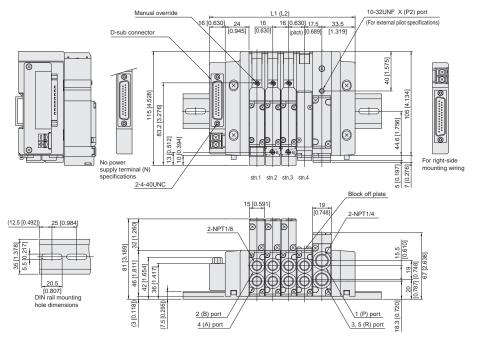

F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block D-sub connector 25-pin specifications

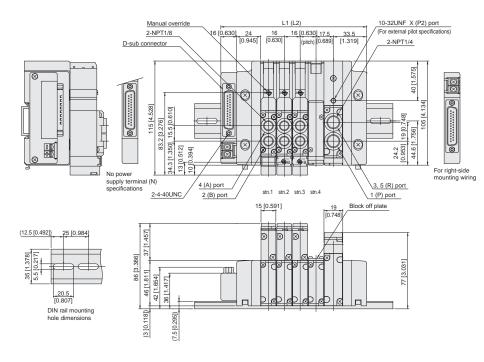

Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.


Unit dimensions

Number	Number L1 Length of L2 Length of					
of units	L1	DIN rail	L2 Note	DIN rail Note		
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]		
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]		
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]		
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]		
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]		
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]		
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]		
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]		
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]		
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]		
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]		
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]		
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]		
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]		
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]		
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]		
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]		
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]		
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]		

Note: When two piping blocks are used.


* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block D-sub connector 37-pin specifications

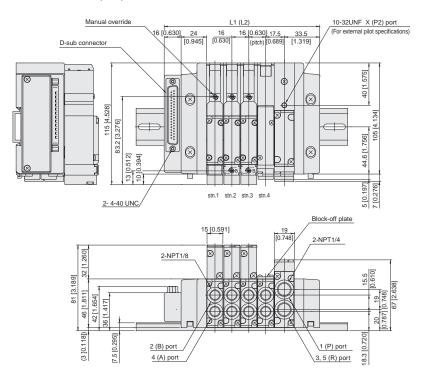

F15M Number of valves PH Pilot specifications (Base piping type)

With valve outlet port female thread block D-sub connector 37-pin specifications

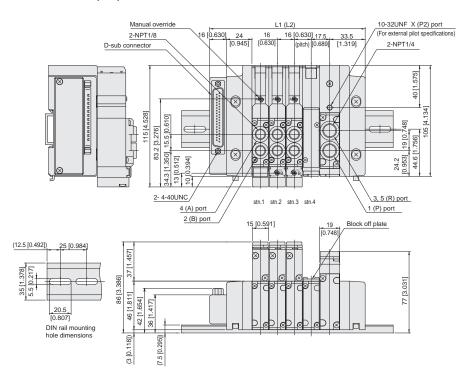

Unit dimensions

Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	150 [5.906]	134 [5.276]	175 [6.890]
3	131 [5.157]	175 [6.890]	150 [5.906]	200 [7.874]
4	147 [5.787]	200 [7.874]	166 [6.535]	200 [7.874]
5	163 [6.417]	200 [7.874]	182 [7.165]	225 [8.858]
6	179 [7.047]	225 [8.858]	198 [7.795]	250 [9.843]
7	195 [7.677]	250 [9.843]	214 [8.425]	250 [9.843]
8	211 [8.307]	250 [9.843]	230 [9.055]	275 [10.827]
9	227 [8.937]	275 [10.827]	246 [9.685]	300 [11.811]
10	243 [9.567]	300 [11.811]	262 [10.315]	300 [11.811]
11	259 [10.197]	300 [11.811]	278 [10.945]	325 [12.795]
12	275 [10.827]	325 [12.795]	294 [11.575]	350 [13.780]
13	291 [11.457]	325 [12.795]	310 [12.205]	350 [13.780]
14	307 [12.087]	350 [13.780]	326 [12.835]	375 [14.764]
15	323 [12.717]	375 [14.764]	342 [13.465]	375 [14.764]
16	339 [13.346]	375 [14.764]	358 [14.094]	400 [15.748]
17	355 [13.976]	400 [15.748]	374 [14.724]	425 [16.732]
18	371 [14.606]	425 [16.732]	390 [15.354]	425 [16.732]
19	387 [15.236]	425 [16.732]	406 [15.984]	450 [17.717]
20	403 [15.866]	450 [17.717]	422 [16.614]	475 [18.701]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block Terminal block type

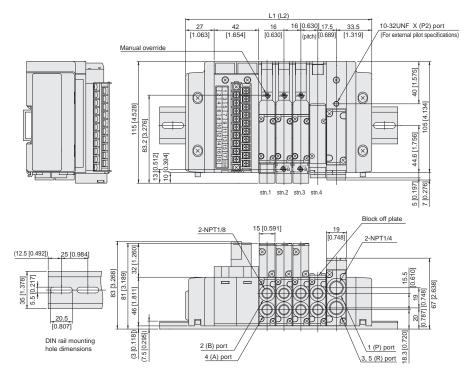


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	144 [5.669]	175 [6.890]	163 [6.417]	200 [7.874]
3	160 [6.299]	200 [7.874]	179 [7.047]	225 [8.858]
4	176 [6.929]	225 [8.858]	195 [7.677]	225 [8.858]
5	192 [7.559]	225 [8.858]	211 [8.307]	250 [9.843]
6	208 [8.189]	250 [9.843]	227 [8.937]	275 [10.827]
7	224 [8.819]	250 [9.843]	243 [9.567]	275 [10.827]
8	240 [9.449]	275 [10.827]	259 [10.197]	300 [11.811]
9	256 [10.079]	300 [11.811]	275 [10.827]	300 [11.811]
10	272 [10.709]	300 [11.811]	291 [11.457]	325 [12.795]
11	288 [11.339]	325 [12.795]	307 [12.087]	350 [13.780]
12	304 [11.969]	350 [13.780]	323 [12.717]	350 [13.780]
13	320 [12.598]	350 [13.780]	339 [13.346]	375 [14.764]
14	336 [13.228]	375 [14.764]	355 [13.976]	400 [15.748]
15	352 [13.858]	400 [15.748]	371 [14.606]	400 [15.748]
16	368 [14.488]	400 [15.748]	387 [15.236]	425 [16.732]
17	384 [15.118]	425 [16.732]	403 [15.866]	450 [17.717]
18	400 [15.748]	425 [16.732]	419 [16.496]	450 [17.717]

Note: When two piping blocks are used.

F15M Number of valves PH Pilot specifications (Direct piping type)

With valve outlet port female thread block Terminal block type

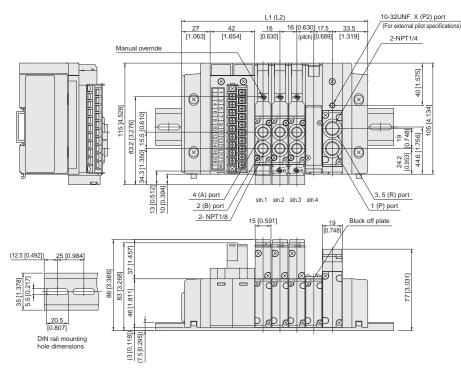


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	144 [5.669]	175 [6.890]	163 [6.417]	200 [7.874]
3	160 [6.299]	200 [7.874]	179 [7.047]	225 [8.858]
4	176 [6.929]	225 [8.858]	195 [7.677]	225 [8.858]
5	192 [7.559]	225 [8.858]	211 [8.307]	250 [9.843]
6	208 [8.189]	250 [9.843]	227 [8.937]	275 [10.827]
7	224 [8.819]	250 [9.843]	243 [9.567]	275 [10.827]
8	240 [9.449]	275 [10.827]	259 [10.197]	300 [11.811]
9	256 [10.079]	300 [11.811]	275 [10.827]	300 [11.811]
10	272 [10.709]	300 [11.811]	291 [11.457]	325 [12.795]
11	288 [11.339]	325 [12.795]	307 [12.087]	350 [13.780]
12	304 [11.969]	350 [13.780]	323 [12.717]	350 [13.780]
13	320 [12.598]	350 [13.780]	339 [13.346]	375 [14.764]
14	336 [13.228]	375 [14.764]	355 [13.976]	400 [15.748]
15	352 [13.858]	400 [15.748]	371 [14.606]	400 [15.748]
16	368 [14.488]	400 [15.748]	387 [15.236]	425 [16.732]
17	384 [15.118]	425 [16.732]	403 [15.866]	450 [17.717]
18	400 [15.748]	425 [16.732]	419 [16.496]	450 [17.717]

Note: When two piping blocks are used.

With manifold outlet port dual use fitting block

(Models that support integrated serial transmission block)

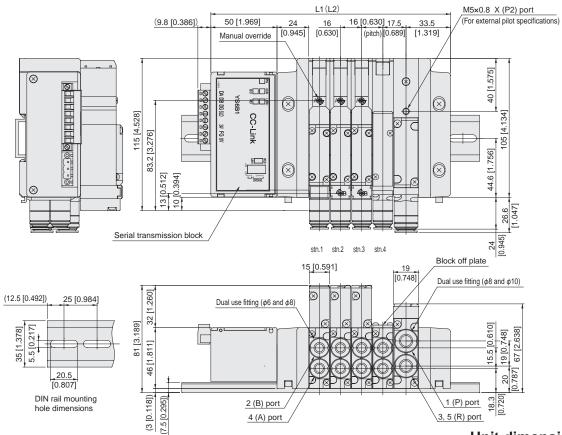


Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	149 [5.866]	200 [7.874]	168 [6.614]	225 [8.858]
3	165 [6.496]	225 [8.858]	184 [7.244]	225 [8.858]
4	181 [7.126]	225 [8.858]	200 [7.874]	250 [9.843]
5	197 [7.756]	250 [9.843]	216 [8.504]	275 [10.827]
6	213 [8.386]	275 [10.827]	232 [9.134]	275 [10.827]
7	229 [9.016]	275 [10.827]	248 [9.764]	300 [11.811]
8	245 [9.646]	300 [11.811]	264 [10.394]	325 [12.795]
9	261 [10.276]	325 [12.795]	280 [11.024]	325 [12.795]
10	277 [10.906]	325 [12.795]	296 [11.654]	350 [13.780]
11	293 [11.535]	350 [13.780]	312 [12.283]	375 [14.764]
12	309 [12.165]	350 [13.780]	328 [12.913]	375 [14.764]
13	325 [12.795]	375 [14.764]	344 [13.543]	400 [15.748]
14	341 [13.425]	400 [15.748]	360 [14.173]	400 [15.748]
15	357 [14.055]	400 [15.748]	376 [14.803]	425 [16.732]
16	373 [14.685]	425 [16.732]	392 [15.433]	450 [17.717]
17	389 [15.315]	450 [17.717]	408 [16.063]	475 [18.701]
18	405 [15.945]	450 [17.717]	424 [16.693]	475 [18.701]
19	421 [16.575]	475 [18.701]	440 [17.323]	500 [19.685]
20	437 [17.205]	500 [19.685]	456 [17.953]	500 [19.685]

Note: When two piping blocks are used. * For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

With manifold outlet port female thread block

(Models that support integrated serial transmission block)

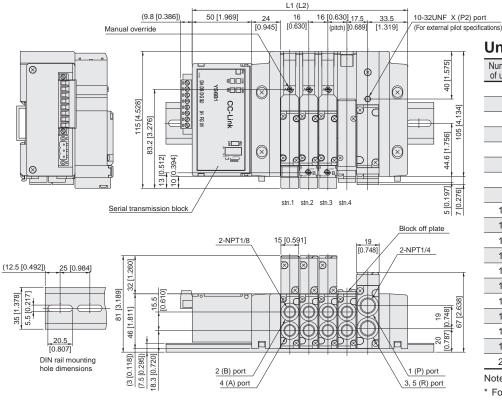

Unit dimensions

Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	149 [5.866]	200 [7.874]	168 [6.614]	225 [8.858]
3	165 [6.496]	225 [8.858]	184 [7.244]	225 [8.858]
4	181 [7.126]	225 [8.858]	200 [7.874]	250 [9.843]
5	197 [7.756]	250 [9.843]	216 [8.504]	275 [10.827]
6	213 [8.386]	275 [10.827]	232 [9.134]	275 [10.827]
7	229 [9.016]	275 [10.827]	248 [9.764]	300 [11.811]
8	245 [9.646]	300 [11.811]	264 [10.394]	325 [12.795]
9	261 [10.276]	325 [12.795]	280 [11.024]	325 [12.795]
10	277 [10.906]	325 [12.795]	296 [11.654]	350 [13.780]
11	293 [11.535]	350 [13.780]	312 [12.283]	375 [14.764]
12	309 [12.165]	350 [13.780]	328 [12.913]	375 [14.764]
13	325 [12.795]	375 [14.764]	344 [13.543]	400 [15.748]
14	341 [13.425]	400 [15.748]	360 [14.173]	400 [15.748]
15	357 [14.055]	400 [15.748]	376 [14.803]	425 [16.732]
16	373 [14.685]	425 [16.732]	392 [15.433]	450 [17.717]
17	389 [15.315]	450 [17.717]	408 [16.063]	475 [18.701]
18	405 [15.945]	450 [17.717]	424 [16.693]	475 [18.701]
19	421 [16.575]	475 [18.701]	440 [17.323]	500 [19.685]
20	437 [17.205]	500 [19.685]	456 [17.953]	500 [19.685]


Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

3 mm [0.118 in] to the L1 (L2) dimension.

F15M Number of valves SH Pilot specifications (Direct piping type)

With valve outlet port female thread block

(Models that support integrated serial transmission block)

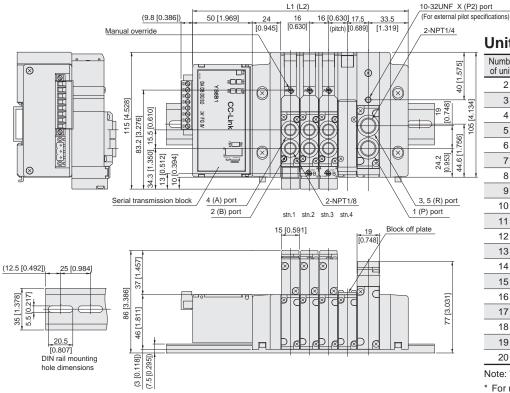

Unit dimensions

Unit					
Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note	
2	149 [5.866]	200 [7.874]	168 [6.614]	225 [8.858]	
3	165 [6.496]	225 [8.858]	184 [7.244]	225 [8.858]	
4	181 [7.126]	225 [8.858]	200 [7.874]	250 [9.843]	
5	197 [7.756]	250 [9.843]	216 [8.504]	275 [10.827]	
6	213 [8.386]	275 [10.827]	232 [9.134]	275 [10.827]	
7	229 [9.016]	275 [10.827]	248 [9.764]	300 [11.811]	
8	245 [9.646]	300 [11.811]	264 [10.394]	325 [12.795]	
9	261 [10.276]	325 [12.795]	280 [11.024]	325 [12.795]	
10	277 [10.906]	325 [12.795]	296 [11.654]	350 [13.780]	
11	293 [11.535]	350 [13.780]	312 [12.283]	375 [14.764]	
12	309 [12.165]	350 [13.780]	328 [12.913]	375 [14.764]	
13	325 [12.795]	375 [14.764]	344 [13.543]	400 [15.748]	
14	341 [13.425]	400 [15.748]	360 [14.173]	400 [15.748]	
15	357 [14.055]	400 [15.748]	376 [14.803]	425 [16.732]	
16	373 [14.685]	425 [16.732]	392 [15.433]	450 [17.717]	
17	389 [15.315]	450 [17.717]	408 [16.063]	475 [18.701]	
18	405 [15.945]	450 [17.717]	424 [16.693]	475 [18.701]	
19	421 [16.575]	475 [18.701]	440 [17.323]	500 [19.685]	
20	437 [17.205]	500 [19.685]	456 [17.953]	500 [19.685]	
N					


Note: When two piping blocks are used.

* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.

81 [3.189] 74.3 [2.925]

46 [1.811] (55.7 [2.193])

(3 [0.118]) (7.5 [0.295])

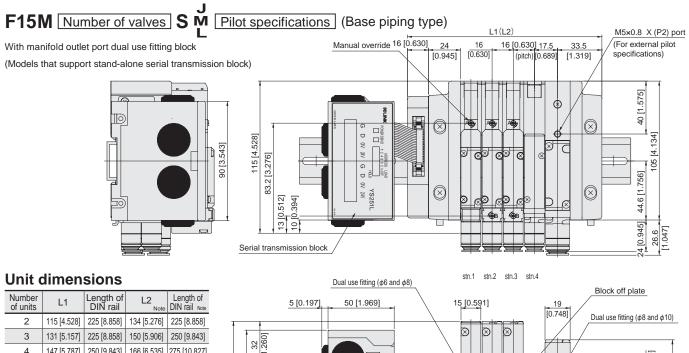

2 (B) port

4 (A) port

3	131 [5.157]	225 [8.858]	150 [5.906]	250 [9.843]
4	147 [5.787]	250 [9.843]	166 [6.535]	275 [10.827]
5	163 [6.417]	275 [10.827]	182 [7.165]	275 [10.827]
6	179 [7.047]	275 [10.827]	198 [7.795]	300 [11.811]
7	195 [7.677]	300 [11.811]	214 [8.425]	325 [12.795]
8	211 [8.307]	300 [11.811]	230 [9.055]	325 [12.795]
9	227 [8.937]	325 [12.795]	246 [9.685]	350 [13.780]
10	243 [9.567]	350 [13.780]	262 [10.315]	375 [14.764]
11	259 [10.197]	350 [13.780]	278 [10.945]	375 [14.764]
12	275 [10.827]	375 [14.764]	294 [11.575]	400 [15.748]
13	291 [11.457]	400 [15.748]	310 [12.205]	400 [15.748]
14	307 [12.087]	400 [15.748]	326 [12.835]	425 [16.732]
15	323 [12.717]	425 [16.732]	342 [13.465]	450 [17.717]
16	339 [13.346]	450 [17.717]	358 [14.094]	450 [17.717]




* For right-side mounting wiring (-R), add


3 mm [0.118 in] to the L1 (L2) dimension.

Additional Parts (available separately)


•Muffler: KM-J10 [for both plug-in and non-plug-in]




Muffler: KM-J6 [for individual exhaust spacer only]



Muffler: KM-J8 [for individual exhaust spacer only]







25 [0.984]

Ø

(12.5 [0.492])

35 [1.378]

1 (P) port

3 and 5 (R) port

15.5 [0.610]

67 [2.638


8.3 [0.720] 20 19 0.787] [0.748]

DIN rail mounting hole dimensions


F15M Number of valves SHL Pilot specifications (Base piping type) L1 (L2) Manual override 16 [0.630] 24 [0.945] 16 [0.630] 17.5 (pitch) [0.689] With manifold outlet port female thread block <u>16</u> [0.630] <u>33.5</u> [1.319] 10-32UNF X (P2) port (For external pilot specifications) (Models that support stand-alone serial transmission block) 40 [1.575] ۲ D $\overline{\mathcal{A}}$ (X é 134] 115 [4.528] 90 [3.543] Đ 105 [4.1 83.2 [3.276] 44.6 [1.756] IKK SIG \otimes \odot YS2 13 [0.512] .394] Ø 10_0 7 1971 **Unit dimensions** Serial transmission block stn.1 stn.2 stn.3 stn.4 5 [0 Number of units Length of DIN rail Length of L2 11 2-NPT1/8 Block off plate DIN rail Note 5 [0.197] 50 [1.969] 15 [0.591] <u>19</u> [0.748] 2 115 [4.528] 225 [8.858] 134 [5.276] 225 [8.858] 2-NPT1/4 3 131 [5.157] 225 [8.858] 150 [5.906] 250 [9.843] \otimes 32 [1.260] 147 [5.787] 250 [9.843] 166 [6.535] 275 [10.827] 4 <u>15.5</u> [0.610] 5 163 [6.417] 275 [10.827] 182 [7.165] 275 [10.827] 81 [3.189] 74.3 [2.925] 67 [2.638] 46 [1.811] (55.7 [2.193]) A 6 179 [7.047] 275 [10.827] 198 [7.795] 300 [11.811] 19 [0.748] 8.3 [0.720] 7 195 [7.677] 300 [11.811] 214 [8.425] 325 [12.795] Æ 787 211 [8.307] 300 [11.811] 230 [9.055] 8 325 [12.795] 20 227 [8.937] 325 [12.795] 246 [9.685] 9 350 [13.780] (3 [0.118]) (7.5 [0.295] 243 [9.567] 350 [13.780] 262 [10.315] 375 [14.764] 10 1 (P) port 2 (B) port (12.5 [0.492]) 25 [0.984] 259 [10.197] 350 [13.780] 278 [10.945] 375 [14.764] 4 (A) port 3, 5 (R) port 11 275 [10.827] 375 [14.764] 294 [11.575] 400 [15.748] 12 5.5 [0.217] 35 [1.378] 291 [11.457] 400 [15.748] 310 [12.205] 400 [15.748] 13 307 [12.087] 400 [15.748] 326 [12.835] 425 [16.732] 14 Note: When two piping blocks are used. 15 323 [12.717] 425 [16.732] 342 [13.465] 450 [17.717] 20.5 * For right-side mounting wiring (-R), add 339 [13.346] 450 [17.717] 358 [14.094] 450 [17.717] 16 3 mm [0.118 in] to the L1 (L2) dimension. DIN rail mounting hole dimensions **F15M** Number of valves **SH** Pilot specifications (Direct piping type) L1 (L2) 10-32UNF X (P2) port (For external pilot specifications) With valve outlet port female thread block 16 [0.630] 16 [0.630] 17.5 Manual override <u>16</u> 24 [0.945] <u>33.5</u> [1.319] (pitch) [0,689 2-NPT1/4 (Models that support stand-alone serial transmission block) 40 [1.575] ۲ Þ 19 [0.748] [4.134] 115 [4.528] 34.3 [1.350] 15.5 [0.610] 90 [3.543] 83.2 [3.276] 105 .7561 44.6 [1.] \otimes $(\times$ [0.512] 24.2 [0.953] 394]


Unit dimensions


Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	115 [4.528]	225 [8.858]	134 [5.276]	225 [8.858]
3	131 [5.157]	225 [8.858]	150 [5.906]	250 [9.843]
4	147 [5.787]	250 [9.843]	166 [6.535]	275 [10.827]
5	163 [6.417]	275 [10.827]	182 [7.165]	275 [10.827]
6	179 [7.047]	275 [10.827]	198 [7.795]	300 [11.811]
7	195 [7.677]	300 [11.811]	214 [8.425]	325 [12.795]
8	211 [8.307]	300 [11.811]	230 [9.055]	325 [12.795]
9	227 [8.937]	325 [12.795]	246 [9.685]	350 [13.780]
10	243 [9.567]	350 [13.780]	262 [10.315]	375 [14.764]
11	259 [10.197]	350 [13.780]	278 [10.945]	375 [14.764]
12	275 [10.827]	375 [14.764]	294 [11.575]	400 [15.748]
13	291 [11.457]	400 [15.748]	310 [12.205]	400 [15.748]
14	307 [12.087]	400 [15.748]	326 [12.835]	425 [16.732]
15	323 [12.717]	425 [16.732]	342 [13.465]	450 [17.717]
16	339 [13.346]	450 [17.717]	358 [14.094]	450 [17.717]

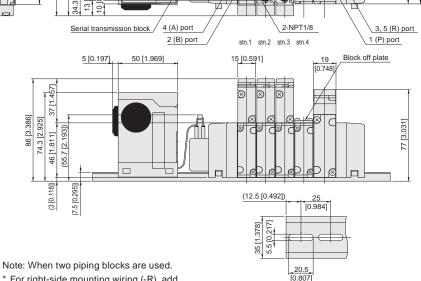


* For right-side mounting wiring (-R), add 3 mm [0.118 in] to the L1 (L2) dimension.



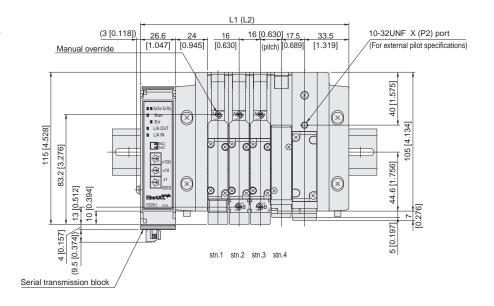



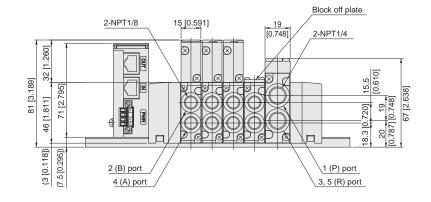



Unit dimensions


Number of units	L1	Length of DIN rail	L2 _{Note}	Length of DIN rail Note
2	125.6 [4.945]	175 [6.890]	144.6 [5.693]	200 [7.874]
3	141.6 [5.575]	200 [7.874]	160.6 [6.323]	200 [7.874]
4	157.6 [6.205]	200 [7.874]	176.6 [6.953]	225 [8.858]
5	173.6 [6.835]	225 [8.858]	192.6 [7.583]	250 [9.843]
6	189.6 [7.465]	250 [9.843]	208.6 [8.213]	250 [9.843]
7	205.6 [8.094]	250 [9.843]	224.6 [8.843]	275 [10.827]
8	221.6 [8.724]	275 [10.827]	240.6 [9.472]	300 [11.811]
9	237.6 [9.354]	300 [11.811]	256.6 [10.102]	300 [11.811]
10	253.6 [9.984]	300 [11.811]	272.6 [10.732]	325 [12.795]
11	269.6 [10.614]	325 [12.795]	288.6 [11.362]	350 [13.780]
12	285.6 [11.244]	325 [12.795]	304.6 [11.992]	350 [13.780]
13	301.6 [11.874]	350 [13.780]	320.6 [12.622]	375 [14.764]
14	317.6 [12.504]	375 [14.764]	336.6 [13.252]	375 [14.764]
15	333.6 [13.134]	375 [14.764]	352.6 [13.882]	400 [15.748]
16	349.6 [13.764]	400 [15.748]	368.6 [14.512]	425 [16.732]
17	365.6 [14.394]	425 [16.732]	384.6 [15.142]	450 [17.717]
18	381.6 [15.024]	425 [16.732]	400.6 [15.772]	450 [17.717]
19	397.6 [15.654]	450 [17.717]	416.6 [16.402]	475 [18.701]
20	413.6 [16.283]	475 [18.701]	432.6 [17.031]	475 [18.701]


Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

3 mm [0.118 in] to the L1 (L2) dimension.



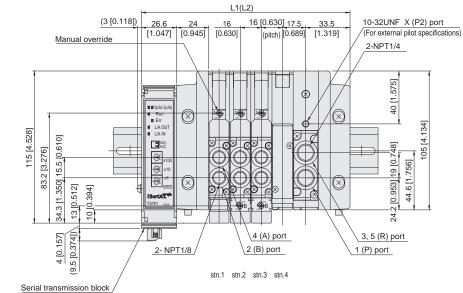



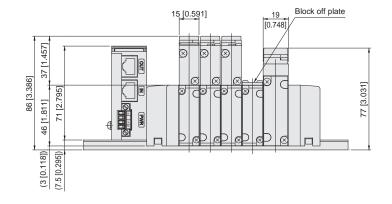

Unit dimensions

Number Longth of Longth of				
Number of units	L1	Length of DIN rail	L2 Note	Length of DIN rail Note
2	125.6 [4.945]	175 [6.890]	144.6 [5.693]	200 [7.874]
3	141.6 [5.575]	200 [7.874]	160.6 [6.323]	200 [7.874]
4	157.6 [6.205]	200 [7.874]	176.6 [6.953]	225 [8.858]
5	173.6 [6.835]	225 [8.858]	192.6 [7.583]	250 [9.843]
6	189.6 [7.465]	250 [9.843]	208.6 [8.213]	250 [9.843]
7	205.6 [8.094]	250 [9.843]	224.6 [8.843]	275 [10.827]
8	221.6 [8.724]	275 [10.827]	240.6 [9.472]	300 [11.811]
9	237.6 [9.354]	300 [11.811]	256.6 [10.102]	300 [11.811]
10	253.6 [9.984]	300 [11.811]	272.6 [10.732]	325 [12.795]
11	269.6 [10.614]	325 [12.795]	288.6 [11.362]	350 [13.780]
12	285.6 [11.244]	325 [12.795]	304.6 [11.992]	350 [13.780]
13	301.6 [11.874]	350 [13.780]	320.6 [12.622]	375 [14.764]
14	317.6 [12.504]	375 [14.764]	336.6 [13.252]	375 [14.764]
15	333.6 [13.134]	375 [14.764]	352.6 [13.882]	400 [15.748]
16	349.6 [13.764]	400 [15.748]	368.6 [14.512]	425 [16.732]
17	365.6 [14.394]	425 [16.732]	384.6 [15.142]	450 [17.717]
18	381.6 [15.024]	425 [16.732]	400.6 [15.772]	450 [17.717]
19	397.6 [15.654]	450 [17.717]	416.6 [16.402]	475 [18.701]
20	413.6 [16.283]	475 [18.701]	432.6 [17.031]	475 [18.701]


Note: When two piping blocks are used. * For right-side mounting wiring (-R), add

3 mm [0.118 in] to the L1 (L2) dimension.

SOLENOID VALVES F18 series

Contents

Specifications	172
Dimensions of Single Valve Unit	177
Dimensions of Monoblock Manifold	180
Dimensions of Split Manifold Non-plug-in Type	183
Dimensions of Split Manifold Plug-in Type	185
Dimensions of Serial Transmission Compatible Manifold —	194

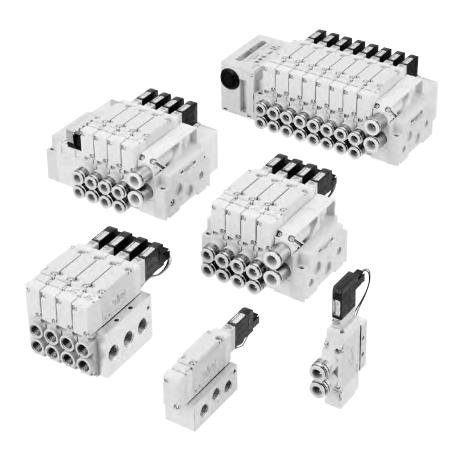

F18 SERIES Specifications

Specifications

Basic Models and Valve Functions

F18T0	F18T1 F18T2	F18T3 F18T4 F18T5
2 positions		3 positions
Single solenoid only	Both single and double solenoid use	Closed center, Exhaust center, Pressure center
	2 pos	F18T0 F18T2 2 positions 5

Remark: For the optional specifications and order codes, see p.72-88.

Specifications

Item		Basic model	F18T0 F18T1 F18T2	F18T3 F18T4 F18T5	F18T0G F18T1G F18T2G	F18T3G F18T4G F18T5G	F18T0V F18T1V F18T2V	F18T3V	
Media					A	ir			
Operation	type		Internal p	oilot type	External pilot type (for	or positive pressure)	External pilot ty	be (for vacuum)	
Flow rate	Sonic conduc	tance C dm ³ /(s · bar) Note1			3.	6			
	Effective are	a Note2 mm ² (Cv)			18	(1)			
Port size N	Note3		Dual use fitting for $\phi 8$ a	and \$\$\phi\$ 10, Rc1/4, NPT1/4	M5×0.8, 10-3	2UNF, dual use fitti	ng for $\phi 8$ and $\phi 10$, R	c1/4, NPT1/4	
Lubrication				Not required					
Operating	g pressure	Main valve	0.15~0.7 MPa [22~102 psi.]		0~0.7 MPa [0~102 psi.] ^{Note4}		-100 kPa~0.15 MPa [-29.53 in.Hg~22 psi.]		
range		External pilot			0.2~0.7 MPa [29~102 psi.] Note4		0.2~0.7 MPa [29~102 psi.]		
Proof pres	ssure	MPa [psi.]			1.05	[152]			
Response	e time Note5	12VDC, 24VDC	25/35 or below	15/70 or below	25/35 or below	15/70 or below	25/35 or below	15/70 or below	
ON/OFF	ms	100VAC	25/35 or below	15/70 or below	25/35 or below	15/70 or below	25/35 or below	15/70 or below	
Maximum	operating f	requency Hz			5	5			
Minimum tim	ne to energize f	or self holding Note6 ms	50		50		50		
Operating temperature range (atmosphere and media) °C [°F]				5~50 [4	1~122]				
Shock resistance		m/s ² [G]	1373 [140] (Axial direction 294.2 [30])	294.2 [30]	1373 [140] (Axial direction 294.2 [30])	294.2 [30]	1373 [140] (Axial direction 294.2 [30])	294.2 [30]	
Mounting	direction				Ar	ıy			

Notes: 1. The sonic conductance value is a calculated value, and not a measured value.

2. For details, see the effective area on p.174.

3. For details, see the port size on p.174.

4. When the main valve pressure is 0.2~0.7 MPa [29~102 psi.], set the external pilot pressure to the main valve pressure or higher, and to 0.7 MPa [102 psi.] or less.

Remark: Specification values are based on Koganei test standards.

Notes: 5. Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center.

Solenoid Specifications

Item Rated voltage		12VDC	24VDC	100'	VAC	120	VAC
Valtaga ranga	V	10.8~13.2	21.6~26.4	90~	·110	108~	~132
Voltage range	v	(12±10%)	(24±10%)	(100±	:10%)	(120±10%)	
Rated frequency	Hz			50	60	50	60
Current mA (r.m.s)	Starting			10 ^{Note 1}	10 ^{Note 1}	11.8	11.8
(when rated voltage is applied)	Holding	76	38	10 ^{Note 1}	10 ^{Note 1}	11.8	11.8
Power consumption	W	0.9	0.9	1.0 VA		1.4 VA	
Allowable leakage current	mA	4.0	2.0	2.	0	2.0	
Type of insulation		Туре В					
Insulation resistance ^{Note 2} MΩ		Over 100					
Color of LED indicator Note3		14(SA) : Red, 12(SB) : Green	14(SA) : Red, 12(SB) : Green		14(SA) : Red,	12(SB) : Green	
Surge suppression (as standard)		Flywhee	el diode	Bridge diode			
		,					

Notes: 1. Since the AC types have built-in bridge diodes, the starting current and holding current values are virtually the same. Value at 500VDC megger.
 The color of the **T0** indicator is red only.

Remark: Specification values are based on Koganei test standards.

^{6.} When used as a double solenoid valve. Excludes T0.

Basic Models and Valve Functions

F18T0	F18T2	F18T3 F18T4 F18T5
2 pos	3 positions	
	5	
Single solenoid only	Double solenoid only	Closed center, Exhaust center, Pressure center
	2 pos	2 positions 5

Remark: For the optional specifications and order codes, see p.72-88.

Specifications

Item		Basic model	F18T0 F18T2	F18T3 F18T4 F18T5	F18T0G F18T2G	F18T3G F18T4G F18T5G	F18T0V F18T2V	F18T3V
Media					A	ir		
Operation typ	ре		Internal p	oilot type	External pilot type (for	or positive pressure)	External pilot typ	be (for vacuum)
Flow rate So	nic conduct	ance C dm ³ /(s · bar) Note1			3.	6	ŀ	
characteristics Eff	fective are	a Note2 mm ² (Cv)			18	(1)		
Port size Notes	3		Dual use fitting for $\phi 8$ a	nd \$\$\phi\$ 10, Rc1/4, NPT1/4	M5×0.8, 10-3	2UNF, dual use fitti	ng for ϕ 8 and ϕ 10, R	c1/4, NPT1/4
Lubrication			Not required					
Operating pr	essure	Main valve	0.15~0.7 MPa	0.15~0.7 MPa [22~102 psi.] 0~0.7 MPa [0~102 psi.] Note4		–100 kPa~0.15 MPa [-	-29.53 in.Hg~22 psi.]	
range		External pilot			0.2~0.7 MPa [29	9~102 psi.] ^{Note4}	0.2~0.7 MPa	[29~102 psi.]
Proof pressu	re	MPa [psi.]		1.05 [152]				
Response tin	ne ^{Note5} C	N/OFF ms	25/35 or below	15/70 or below	25/35 or below	15/70 or below	25/35 or below	15/70 or below
Maximum op	erating fr	equency Hz			5	5		
Minimum time to	o energize fo	or self holding Note6 ms	50		50		50	
Operating temperature range (atmosphere and media) °C [°F]					5~50 [4	1~122]		
Shock resista	ance	m/s² [G]	1373 [140] (Axial direction 294.2 [30])	294.2 [30]	1373 [140] (Axial direction 294.2 [30])	294.2 [30]	1373 [140] (Axial direction 294.2 [30])	294.2 [30]
Mounting dire	ection				Ar	ıy		

Notes: 1. The sonic conductance value is a calculated value, and not a measured

value. 2. For details, see the effective area on p.174.

3. For details, see the port size on p.174.

When the main valve pressure is 0.2~0.7 MPa [29~102 psi.], set the external pilot pressure to the main valve pressure or higher, and to 0.7 MPa [102 psi.] or less.

Remark: Specification values are based on Koganei test standards.

Notes: 5. Values when air pressure is 0.5 MPa [73 psi.]. For switching phase timing in the AC specification, add a maximum of 5 ms to the response time. The values for 2-position valves are those when used as a single solenoid, and the values for 3-position valves are those when switching from the neutral position of closed center.

6. In the case of a double solenoid valve.

Solenoid Specifications for DIN Connector (-39) Type


Item	Ra	ated voltage	12VDC	24VDC	120	/AC	240	VAC
Voltage r	ange	V	10.8~13.2 (12±10%)	21.6~26.4 (24±10%)	90~	132	180~	~264
	Frequency	Hz	_	_	50	60	50	60
Current	Starting	mA (r.m.s)	_	_	43	38	22	19
	Holding	mA (r.m.s)	140 (1.7W)	75 (1.8W)	29	24	14	12
Allowable leakage current mA		mA	8	4	4	ŀ		2
Insulation resistance Note MΩ			Over 100					
Surge suppression (as standard)			Surge absorp	Varistor		Varistor		

Note: Value at 500VDC megger.

Remark: Specification values are based on Koganei test standards.


Flow Rate

How to obtain cylinder speed




Measuring conditions


- ●Air pressure: 0.5 MPa [73 psi.]
- Piping (outer diameter×inner diameter× length) : $\phi 10 \times \phi 7.5 \times 1000 \text{ mm}$ [39 in.]
- ●Fitting : Quick fitting TS10-02
- Load •Load ratio= $\frac{Load}{Cylinder theoretical thrust}$ (%)
- Cylinder stroke : 150 mm [5.91 in.]








Delay time





Supply pressure -MPa MPa 0.7 0.6 Valve outlet pressure 0.5 .6 0.4 0.3 0.2 0.1 0 250 500 750 1000 1250 15001750 Flow rate ℓ /min (ANR)

How to read the graph

When the supply pressure is 0.5 MPa [73 psi.] and flow rate is 1000 ℓ /min [35.3 ft.3/min.] (ANR), the valve outlet pressure becomes 0.4 MPa [58 psi.].

- 1 mm/s = 0.0394 in./sec. 1 MPa = 145 psi.
- 1 ℓ /min = 0.0353ft.³/min.

Port Size

	Description/Piping specification	PR	X (P2)	4(A), 2(B)	1(P), 3(R2), 5(R1), 3, 5(R)
	With sub-base	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/4, NPT1/4	Rc1/4, NPT1/4
Ð	With female thread block	_	_	Rc1/4, NPT1/4	Rc1/4, NPT1/4
Single unit	With dual use fitting block	—	_	Dual use fitting for $\phi 8$ and $\phi 10$	Rc1/4, NPT1/4
S	With single use fitting block	—	—	φ8 orφ10	Rc1/4, NPT1/4
	Monoblock type with female thread block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Rc1/4, NPT1/4	Rc3/8, NPT3/8
-	Monoblock type with fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	Dual use fitting for $\phi 8$ and $\phi 10$	Rc3/8, NPT3/8
Manifold	Monoblock type with single use fitting block	M5×0.8, 10-32UNF	M5×0.8, 10-32UNF	φ8 or φ10	Rc3/8, NPT3/8
Jan	Split type with female thread block, and serial transmission type with female thread block	—	M5×0.8, 10-32UNF	Rc1/4, NPT1/4	Rc3/8, NPT3/8
~	Split type with fitting block, and serial transmission type with fitting block	_	M5×0.8, 10-32UNF	Dual use fitting for $\phi 8$ and $\phi 10$	Single use fitting for ϕ 12
	Split type with single use fitting block, and serial transmission type with single use fitting block	_	M5×0.8, 10-32UNF	φ8 or φ10	

Effective Area [Cv]

When used as

a single ur	nit mm² [Cv]		mm ² (Cv)
Basic model	Effective area	Basic model	Effective area
F18T0A2		F18T0F5	
F18T1A2		F18T1 -F5	
F18T2A2	17.3 〔0.96〕	F18T2F5	15.0 [0.83]
F18T3A2		F18T3F5	
F18T4A2		F18T4F5	
F18T5A2		F18T5F5	
F18T0F3		F18T0 - F6	
F18T1 -F3		F18T1 -F6	
F18T2F3	17.0 [0.94]	F18T2F6	16.5 (0.91)
F18T3F3	17.0 (0.34)	F18T3F6	
F18T4F3		F18T4F6	
F18T5F3		F18T5F6	
F18T0F4			
F18T1F4			
F18T2F4	17.3 [0.96]		
F18T3F4	17.3 (0.90)		
F18T4F4			
F18T5F4			

When mounted on a manifold

When	mm² (Cv)			
Valve type	Manifold model	F18M□F	F18M	F18M N(P)(S)
F18T0	Outlet port Dual use fitting for $\phi 8$ and $\phi 10$, Female thread	17.0 (0.94)	16.0 (0.89)	18.0〔1〕
F18T2	Outlet port \$\phi\$ 8 fitting	15.0 (0.83)	14.7 (0.82)	16.7 (0.93)
F18T4 F18T5	Outlet port ϕ 10 fitting	16.5 (0.91)	15.0 (0.83)	17.0 (0.94)

Caution: When the individual air supply spacer or the individual air exhaust spacer is used, effective area decreases by about 30%.

Remark: Specification values are based on Koganei test standards.

Single Valve Unit Mass

			g [oz.		
F18T	F18T - A1	F18TA2	F18T -FJ	F18T	F18T
Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion
None	With plate	With plate	With dual use fitting block	With ϕ 8 fitting block	With ϕ 10 fitting block
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion
None	None	With A type sub-base	None	None	None
118 [4.16]	144 [5.08]	308 [10.86]	159 [5.61]	184 [6.49]	193 [6.81]

				g [oz.]
F18T	F18TF3	F18TF4	F18TF5	F18TF6
Outlet portion	Outlet portion	Outlet portion	Outlet portion	Outlet portion
With female thread block	With dual use fitting block	With female thread block	With ϕ 8 fitting block	With ϕ 10 fitting block
Inlet portion	Inlet portion	Inlet portion	Inlet portion	Inlet portion
None	With female thread block	With female thread block	With female thread block	With female thread block
147 [5.19]	184 [6.49]	172 [6.07]	209 [7.37]	218 [7.69]

Basic Type F18T0 is 15 g [0.53 oz.] less than the mass shown above.

Monoblock Manifold Mass (single valve unit included)

g [oz.]

g [oz.]

		Mass calculation of each unit						
Monoblock manifold		4(A), 2(B) ports outlet specifications						
	Female thread block	Dual use fitting block	ϕ 8 fitting block	ϕ 10 fitting block				
A type	(334×n) + 165 [(11.78×n) + 5.82]	$(344 \times n) + 165 [(12.13 \times n) + 5.82]$	(369×n) + 165 [(13.02×n) + 5.82]	(378×n) + 165 [(13.33×n) + 5.82]				
F type	$(222 \times n) + 70 [(7.83 \times n) + 2.47]$	(232×n) + 70 [(8.18×n) + 2.47]	$(257 \times n) + 70 [(9.07 \times n) + 2.47]$	(266×n) + 70 [(9.38×n) + 2.47]				

Calculation example : F18M8AM

stn.1~stn.8 F18T1-A1-PS DC24V

 $(334 \times 8) + 165 = 2837 \text{ g} [100.07 \text{ oz.}]$

When mounting a block-off plate, subtract 110 g [3.88 oz.] per unit from the above calculation result for the female thread specification; subtract 120 g [4.23 oz.] for the dual use fitting specification; subtract 145 g [5.11 oz.] for the ϕ 8 fitting specification; and subtract 154 g [5.43 oz.] for the ϕ 10 fitting specification.

When mounting the F18T0 specification valve, subtract 15 g [0.53 oz.] per unit from the above calculation result.

Mass of Split Manifold and Serial Transmission Compatible Manifold

Because the valve and manifold have the same output specifications, their mass is the same. The mass can only be changed by choosing a different type of inlet/ outlet block.

Mass of Split Manifold Non-Plug-in Type (single valve unit included)

		Mass calculati	on of each unit				
Non plug in tupo		4(A), 2(B) ports outlet specifications					
Non-plug-in type	Female thread block	Dual use fitting block	ϕ 8 fitting block	¢10 fitting block			
	$(241 \times n) + 234 [(8.50 \times n) + 8.25]$	$(251 \times n) + 234 [(8.85 \times n) + 8.25]$	$(276 \times n) + 234 [(9.74 \times n) + 8.25]$	(285×n) + 234 [(10.05×n) + 8.25]			

g [oz.]				
Additional mass				
Piping block specification				
Fitting block				
189 [6.67]				

Calculation example : F18M8N-MR

stn.1~stn.8 F18T1-A1-PS DC24V

 $(241 \times 8) + 234 + 164 = 2326 \text{ g} [82.05 \text{ oz.}]$

When mounting a block-off plate, subtract 110 g [3.88 oz.] per unit from the above calculation result for the female thread specification; subtract 120 g [4.23 oz.] for the dual use fitting specification; subtract 145 g [5.11 oz.] for the ϕ 8 fitting specification; and subtract 154 g [5.43 oz.] for the ϕ 10 fitting specification.

When mounting the F18T0 specification valve, subtract 15 g [0.53 oz.] per unit from the above calculation result.

Mass of Split Manifold Plug-in Type/ Serial Transmission Compatible Manifold (single valve unit included)

		Mass calculati	on of each unit	
Plug-in type	4(A), 2(B) ports outlet specifications			
Serial transmission	Female thread block	Dual use fitting block	ϕ 8 fitting block	ϕ 10 fitting block
compatible manifold	(243×n) + 238 [(8.57×n) + 8.40]	$(253 \times n) + 238$ [(8.92×n) + 8.40]	$(278 \times n) + 238 [(9.81 \times n) + 8.40]$	(287×n) + 238 [(10.12×n) + 8.40]

	g [oz.]		
Additional mass			
Piping block specification			
Female thread block	Fitting block		
174 [6.14]	199 [7.02]		

g [oz.]

g [oz.]

Additional mass						
	Wiring block specification					
-F100, -F101	-F200, -F201, -F260	-D250, -D251	-D370NU	-T200		
69 [2.43]	71 [2.50]	72 [2.54]	96 [3.39]	154 [5.43]		

	g [oz.]
Additional mass	
Serial transmission block	
160 [5.64] (236 [8.32] for CompoNet)	

Calculation example : F18M8PM-MR-F201 DC24V

stn.1~stn.8 F18T1-A1 DC24V

(243×8)+238+174+71=2427 g [85.61 oz.]


When mounting the block-off plate, subtract 130 g [4.59 oz] per unit from the above calculation result.

When mounting the F18 T0 specification valve, subtract 15 g [0.53 oz.] per unit from the above calculation result.

F18T Valve specifications -F3-PS

With outlet port dual use fitting block With inlet port female thread block S type plug connector

* For T0 Type dimensions, see page 178.

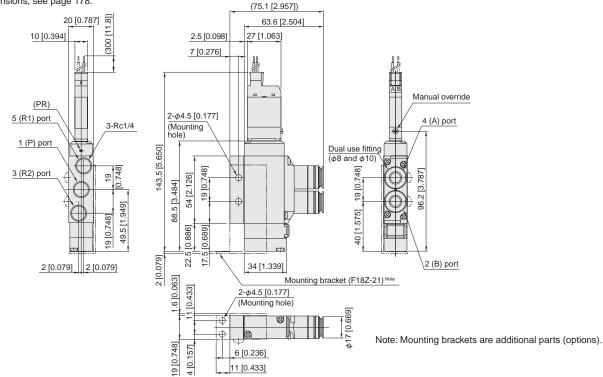


F18T Valve specifications -F4-PS F18T Valve specifications -F4H-PS

With outlet port female thread block With inlet port female thread block

S type plug connector


* For T0 Type dimensions, see page 178.

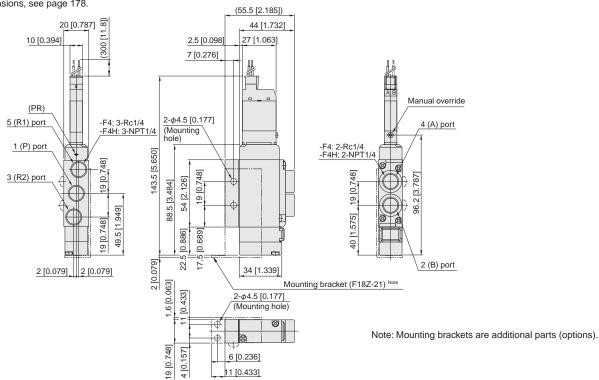




F18T0-F -PS

With outlet port single use fitting block With inlet port female thread block S type plug connector

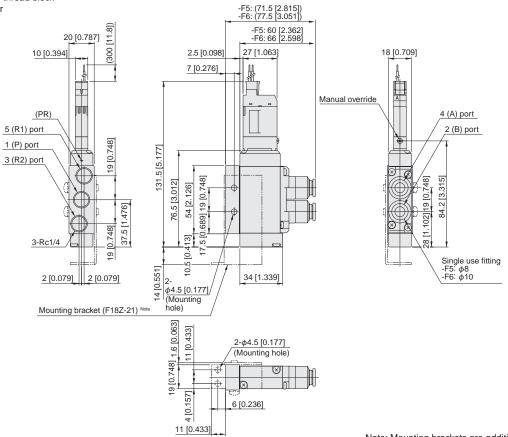

Note: Mounting brackets are additional parts (options).

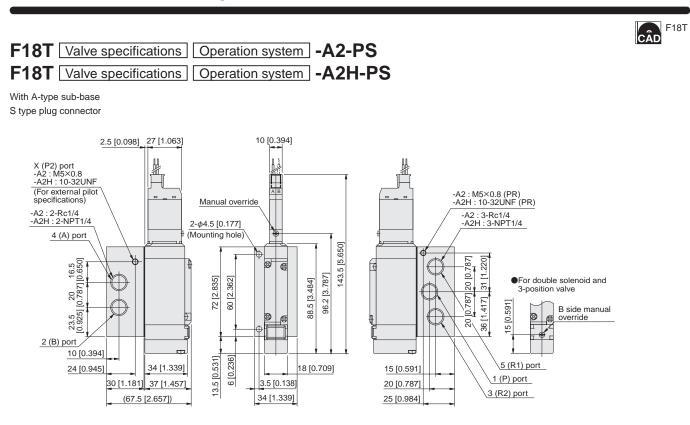

Note: The overall valve length of the T0 type is 12 mm [0.472 in] shorter (end cover side protrusion is 12 mm [0.472 in] less).

0

((

A (Full length)


127.7 [5.028]

180.4 [7.102]

192.4 [7.575]

Options


●L type plug connector: -PL




Note: The overall valve length of the T0 type is 12 mm [0.472 in] shorter (end cover side protrusion is 12 mm [0.472 in] less).

Solenoid with DIN type connector: -39


Pg. 7 Compatible cable diameter ϕ 4 to ϕ 6

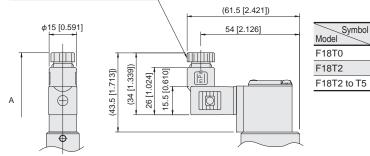


Manual lever: -R



Protruding locking type manual override: -83



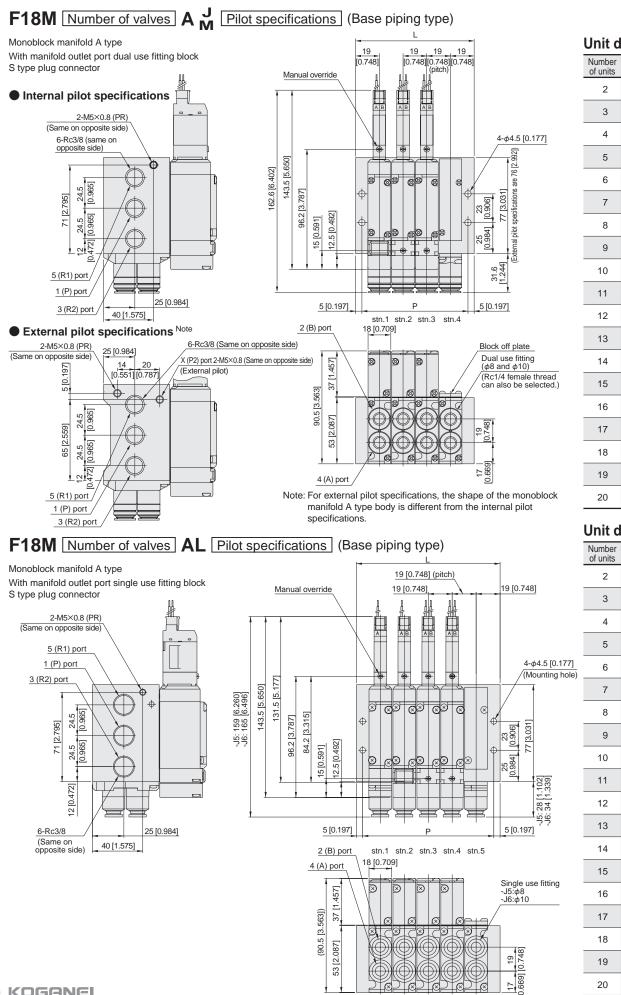



of units	-	
2	57 [2.244]	47 [1.850]
3	76 [2.992]	66 [2.598]
4	95 [3.740]	85 [3.346]
5	114 [4.488]	104 [4.094]
6	133 [5.236]	123 [4.843]
7	152 [5.984]	142 [5.591]
8	171 [6.732]	161 [6.339]
9	190 [7.480]	180 [7.087]
10	209 [8.228]	199 [7.835]
11	228 [8.976]	218 [8.583]
12	247 [9.724]	237 [9.331]
13	266 [10.472]	256 [10.079]
14	285 [11.220]	275 [10.827]
15	304 [11.969]	294 [11.575]
16	323 [12.717]	313 [12.323]
17	342 [13.465]	332 [13.071]
18	361 [14.213]	351 [13.819]
19	380 [14.961]	370 [14.567]
20	399 [15.709]	389 [15.315]

Unit dimensions

Number of units	L	Р
2	57 [2.244]	47 [1.850]
3	76 [2.992]	66 [2.598]
4	95 [3.740]	85 [3.346]
5	114 [4.488]	104 [4.094]
6	133 [5.236]	123 [4.843]
7	152 [5.984]	142 [5.591]
8	171 [6.732]	161 [6.339]
9	190 [7.480]	180 [7.087]
10	209 [8.228]	199 [7.835]
11	228 [8.976]	218 [8.583]
12	247 [9.724]	237 [9.331]
13	266 [10.472]	256 [10.079]
14	285 [11.220]	275 [10.827]
15	304 [11.969]	294 [11.575]
16	323 [12.717]	313 [12.323]
17	342 [13.465]	332 [13.071]
18	361 [14.213]	351 [13.819]
19	380 [14.961]	370 [14.567]
20	399 [15.709]	389 [15.315]


F18M Number of valves AHL Pilot specifications (Base piping type)




Unit dimensions

Monoblock manifold A type With manifold outlet port female thread block S type plug connector


Internal pilot specifications



External pilot specifications Note




19 19 19 [0.748][0.748][0.748] (pitch) Manual override 4-φ4.5 [0.177] (Mounting hole) 143.5 [5.650] ØØ 0 ØØ \otimes \otimes Φ ¢ 96.2 [3.787] 77 [3.031] 23 [0.906] 15 [0.591] 12.5 [0.492] ŧ 25 [0.984] \otimes \otimes ରାଷ (5 [0.197]) 5 [0.197] P 2 stn.1 stn.2 stn.3 stn.4



Number of units	L	Р
2	57 [2.244]	47 [1.850]
3	76 [2.992]	66 [2.598]
4	95 [3.740]	85 [3.346]
5	114 [4.488]	104 [4.094]
6	133 [5.236]	123 [4.843]
7	152 [5.984]	142 [5.591]
8	171 [6.732]	161 [6.339]
9	190 [7.480]	180 [7.087]
10	209 [8.228]	199 [7.835]
11	228 [8.976]	218 [8.583]
12	247 [9.724]	237 [9.331]
13	266 [10.472]	256 [10.079]
14	285 [11.220]	275 [10.827]
15	304 [11.969]	294 [11.575]
16	323 [12.717]	313 [12.323]
17	342 [13.465]	332 [13.071]
18	361 [14.213]	351 [13.819]
19	380 [14.961]	370 [14.567]
20	399 [15.709]	389 [15.315]


Note: For external pilot specifications, the shape of the monoblock manifold A type body is different from the internal pilot specifications.


F18M Number of valves **F** (Direct piping type)

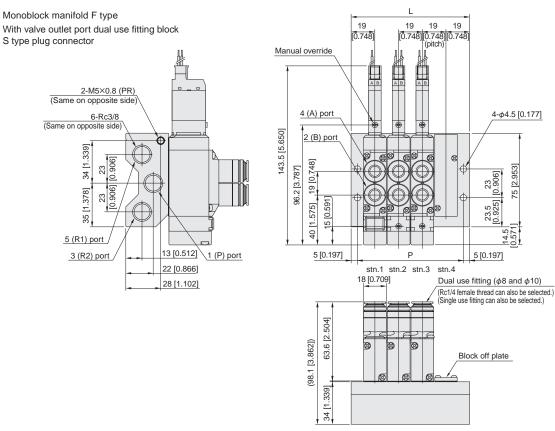

Note: The overall valve length of the T0 type is 12 mm [0.472 in] shorter (end cover side protrusion is 12 mm [0.472 in] less).

F18M Number of valves FH (Direct piping type)



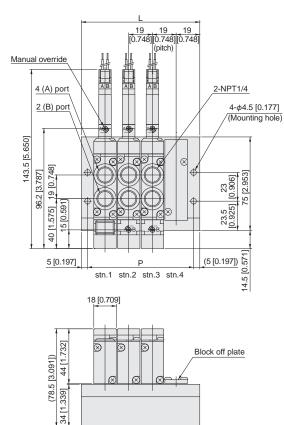

CÂD F18MF		
Unit d	imen	sions
Number of units	L	Р
2	57 [2.244]	47 [1.850]
3	76 [2.992]	66 [2.598]
4	95 [3.740]	85 [3.346]
5	114 [4.488]	104 [4.094]
6	133 [5.236]	123 [4.843]
7	152 [5.984]	142 [5.591]
8	171 [6.732]	161 [6.339]
9	190 [7.480]	180 [7.087]
10	209 [8.228]	199 [7.835]
11	228 [8.976]	218 [8.583]
12	247 [9.724]	237 [9.331]
13	266 [10.472]	256 [10.079]
14	285 [11.220]	275 [10.827]
15	304 [11.969]	294 [11.575]
16	323 [12.717]	313 [12.323]
17	342 [13.465]	332 [13.071]
18	361 [14.213]	351 [13.819]
19	380 [14.961]	370 [14.567]
20	399 [15.709]	389 [15.315]
		F18MF
Unit d	limen	sions
Number of units	L	Р
2	57 [2.244]	47 [1.850]
3	76 [2.992]	66 [2.598]
4	95 [3.740]	85 [3.346]
5	114 [4.488]	104 [4.094]
6	133 [5.236]	123 [4.843]
7	152 [5.984]	142 [5.591]
8	171 [6.732]	161 [6.339]
9	190 [7.480]	180 [7.087]
10	209 [8.228]	199 [7.835]
11	228 [8.976]	218 [8.583]
12	247 [9.724]	237 [9.331]
13	266 [10.472]	256 [10.079]
	285	275

14

15

16

17

18

19

20

285

11.220]

304

11.969]

323 [12.717]

342

13.465]

361

14.213]

380

14.961]

399 389 [15.709] [15.315]

275

[10.827]

294

[11.575]

313 [12.323]

332

[13.071]

351


[13.819]

370

[14.567]

Note: The overall valve length of the T0 type is 12 mm [0.472 in] shorter (end cover side protrusion is 12 mm [0.472 in] less).


182 KOGANEI

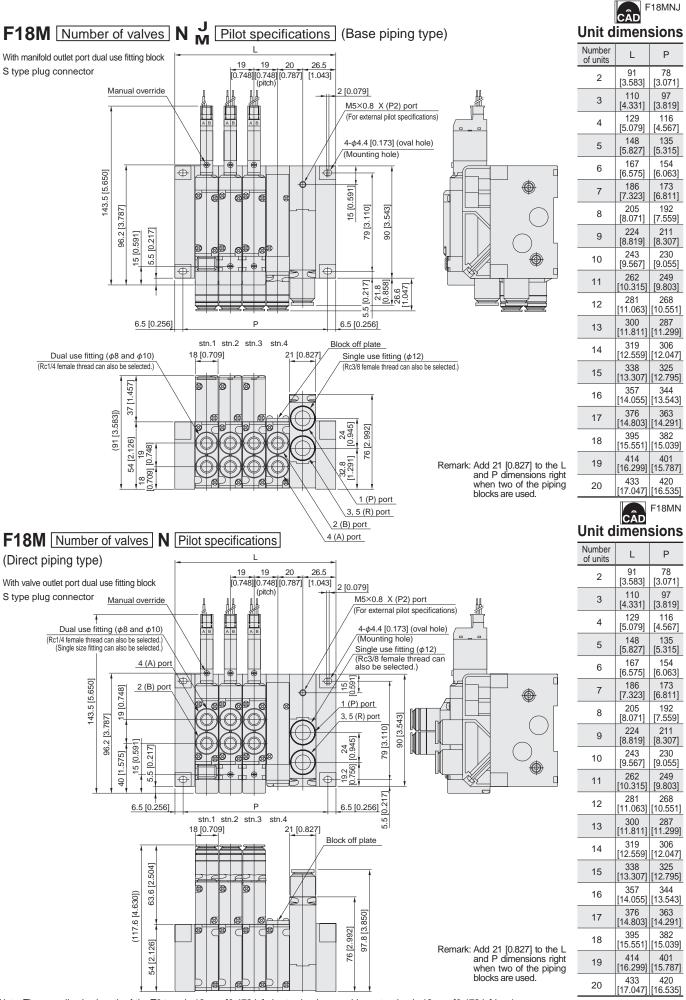

Note: The overall valve length of the T0 type is 12 mm [0.472 in] shorter (end cover side protrusion is 12 mm [0.472 in] less).


KOGANEI 183


F18 SERIES

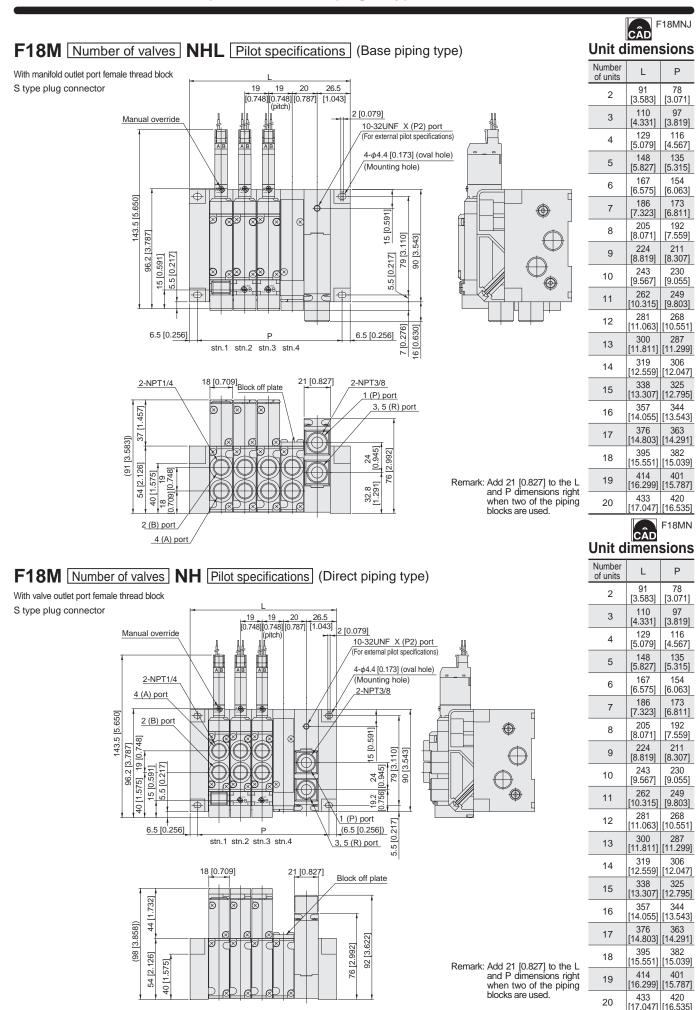

20

[16.535]

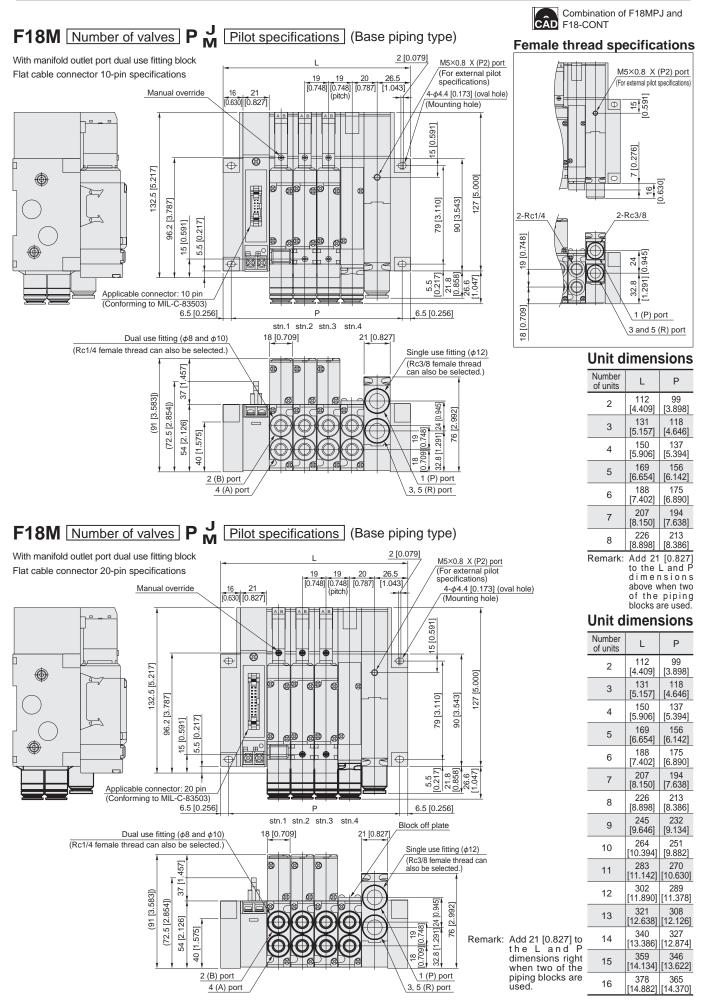


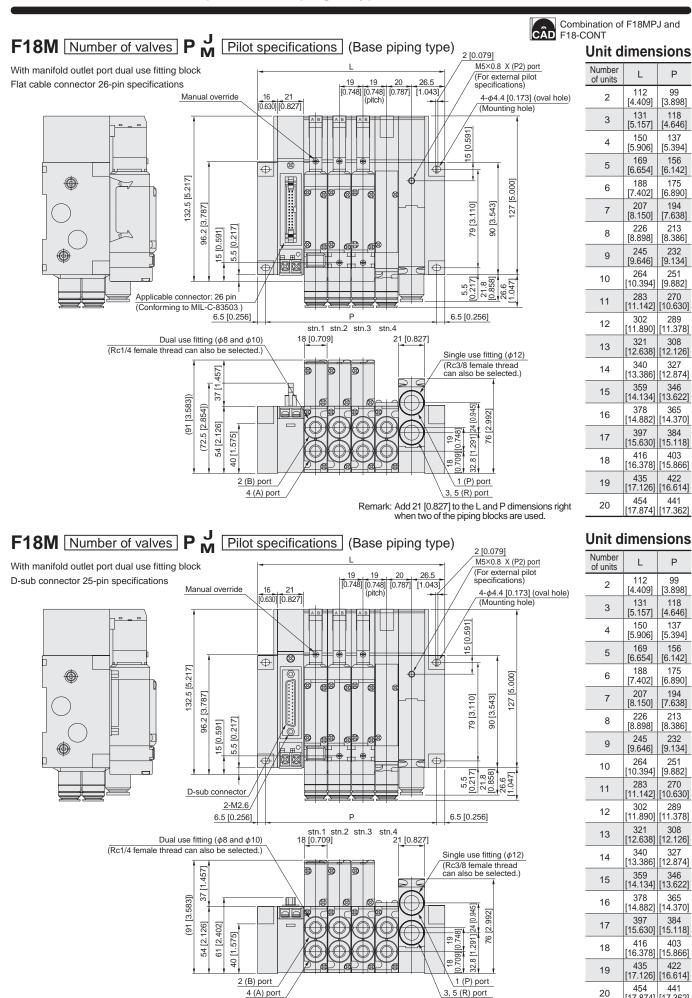

186 KOGANEI

Number of units	L	Р
2	112 [4.409]	99 [3.898]
3	131 [5.157]	118 [4.646]
4	150 [5.906]	137 [5.394]
5	169 [6.654]	156 [6.142]
6	188 [7.402]	175 [6.890]
7	207 [8.150]	194 [7.638]
8	226 [8.898]	213 [8.386]
9	245 [9.646]	232 [9.134]
10	264 [10.394]	251 [9.882]
11	283 [11.142]	270 [10.630]
12	302 [11.890]	289 [11.378]
13	321 [12.638]	308 [12.126]
14	340 [13.386]	327 [12.874]
15	359 [14.134]	346 [13.622]
16	378 [14.882]	365 [14.370]
17	397 [15.630]	384 [15.118]
18	416 [16.378]	403 [15.866]
19	435 [17.126]	422 [16.614]
20	454 [17.874]	441 [17.362]


Remark: Add 21 [0.827] to the L and P dimensions right when two of the piping blocks are used.

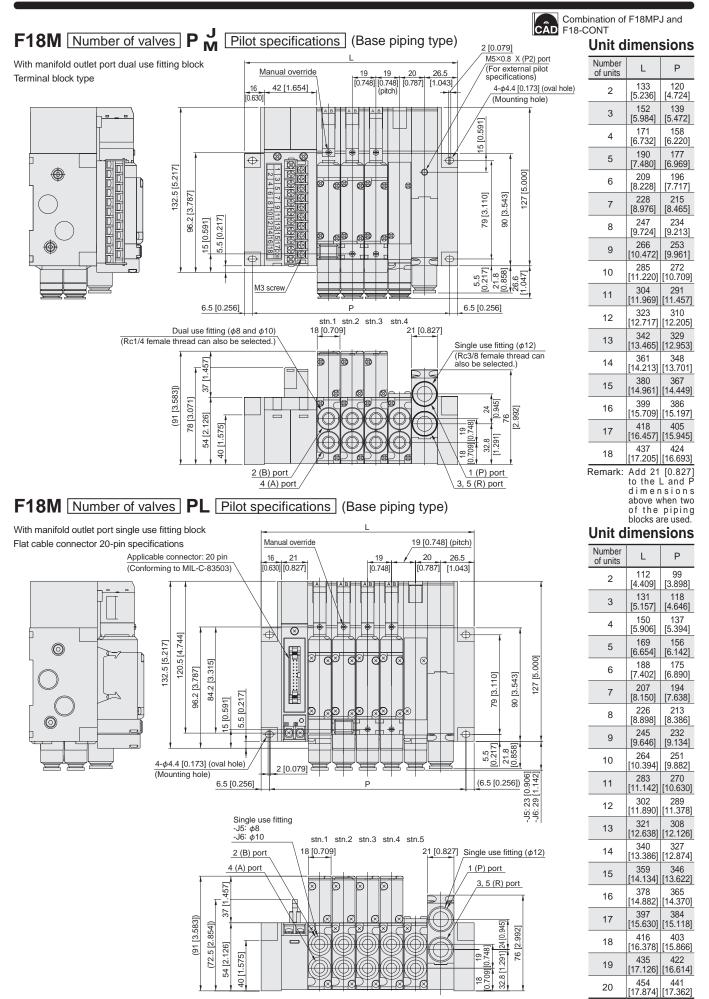

Remark: Add 21 [0.827] to the L and P dimensions right when two of the piping blocks are used.

F18M Number of valves **PHL** Pilot specifications (Base piping type)

With manifold outlet port female thread block Flat cable connector 10-pin specifications

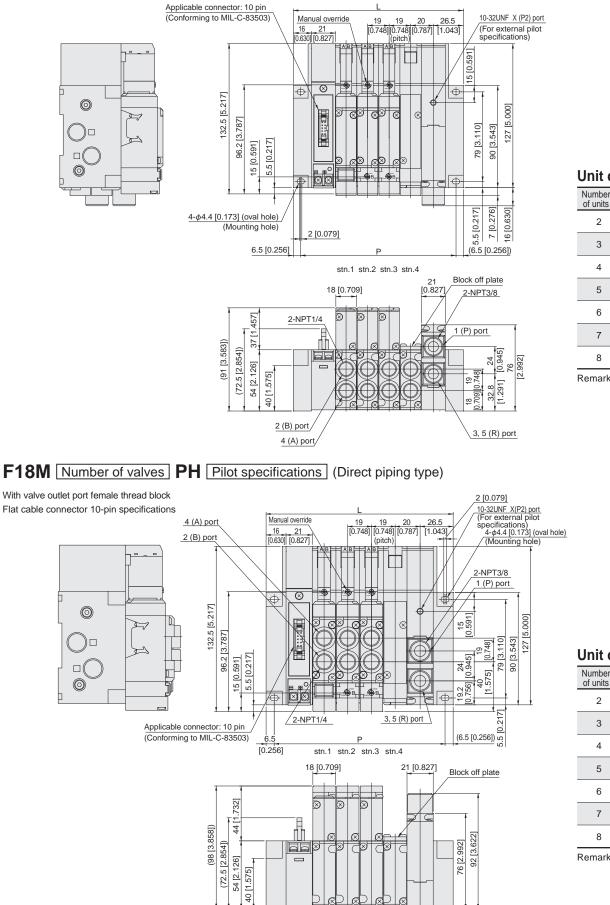

Unit dimensions

Combination of F18MPJ and

CÂD

F18-CONT

Number of units	L	Р
2	112 [4.409]	99 [3.898]
3	131 [5.157]	118 [4.646]
4	150 [5.906]	137 [5.394]
5	169 [6.654]	156 [6.142]
6	188 [7.402]	175 [6.890]
7	207 [8.150]	194 [7.638]
8	226 [8.898]	213 [8.386]
Remark:	to the dimension when two	[0.827] L and P ons above vo of the locks are

Unit dimensions L

Р

2	112 [4.409]	99 [3.898]
3	131 [5.157]	118 [4.646]
4	150 [5.906]	137 [5.394]
5	169 [6.654]	156 [6.142]
6	188 [7.402]	175 [6.890]
7	207 [8.150]	194 [7.638]
8	226 [8.898]	213 [8.386]
Remark: Add 21 [0.827] to the L and P dimensions above when two of the piping blocks are used.		


F18M Number of valves PHL Pilot specifications (Base piping type)


With manifold outlet port female thread block Flat cable connector 20-pin specifications

0


)0

0

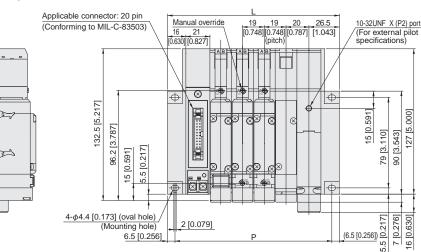



stn.1 stn.2 stn.3 stn.4

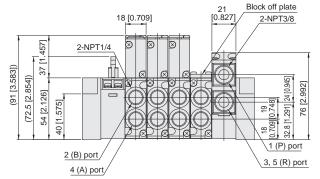

F18M Number of valves **PH** Pilot specifications (Direct piping type)

With valve outlet port female thread block 2 [0.079] Flat cable connector 20-pin specifications 10-32UNF X (P2) port (For external pilot specifications) Manual override 19 19 [0.748] [0.748] (pitch) 4 (A) port 20 [0.787] 26.5 16 21 [0.630] [0.827] 4-\$4.4 [0.173] (oval hole) 2 (B) port (Mounting hole) 2-NPT3/8 1 (P) port \otimes \oplus ₫ 132.5 [5.217] \bigcirc য 127 [5.000] 15 591 8 90 [3.543] [3.110] 96.2 [3.787 19 [0.748] 24 [0.945] 5.5 [0.217] 62 15 [0.591] 40 .575] 19.2 756] [i \bigcirc ¢ 3, 5 (R) port 2-NPT1/4 Applicable connector: 20 pin (6.5 [0.256]) 0 0 (Conforming to MIL-C-83503) Ρ [0.256] stn.2 stn.3 stn.4 stn.1 18 [0.709] 21 [0.827] Block off plate 732] 44 [1 (98 [3.858]) 巾 (72.5 [2.854]) 92 [3.622] 76 [2.992] 54 [2.126] 40 [1.575]

Unit dimensions

Number of units	L	Р
2	112 [4.409]	99 [3.898]
3	131 [5.157]	118 [4.646]
4	150 [5.906]	137 [5.394]
5	169 [6.654]	156 [6.142]
6	188 [7.402]	175 [6.890]
7	207 [8.150]	194 [7.638]
8	226 [8.898]	213 [8.386]
9	245 [9.646]	232 [9.134]
10	264 [10.394]	251 [9.882]
11	283 [11.142]	270 [10.630]
12	302 [11.890]	289 [11.378]
13	321 [12.638]	308 [12.126]
14	340 [13.386]	327 [12.874]
15	359 [14.134]	346 [13.622]
16	378 [14.882]	365 [14.370]
Remark:	to the dimensio	[0.827] L and P ons above vo of the

when two of the piping blocks are used.

[4.409] [3.898] 131 118 [5.157] [4.640]

Р

99

Combination of F18MPJ and

Number

of units

2


Unit dimensions

I.

112

CÂD

F18-CONT

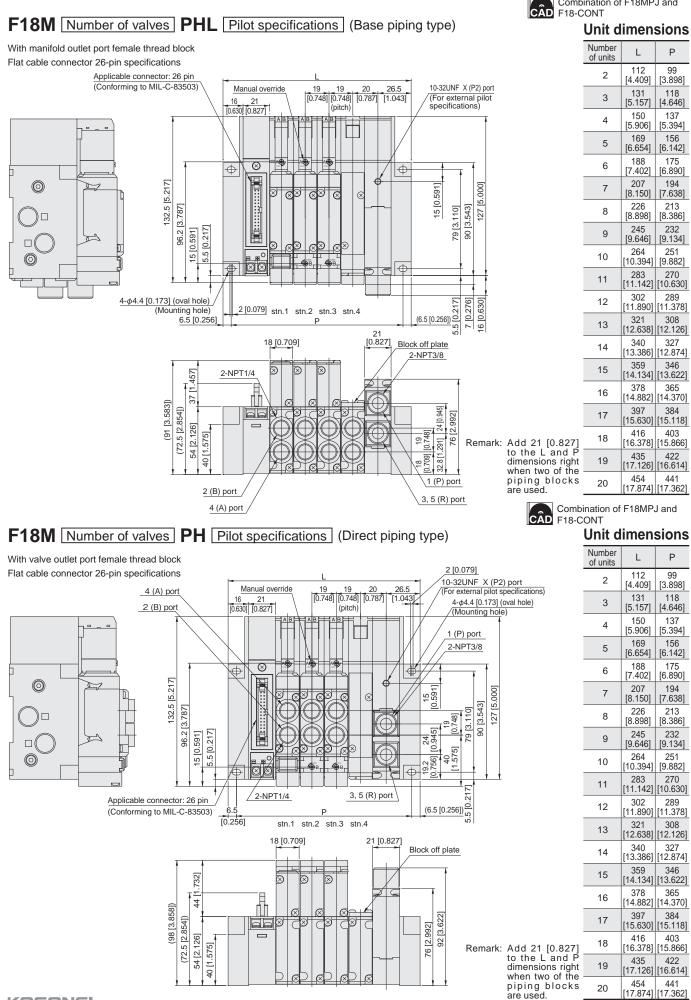

Combination of F18MPJ and

F18M Number of valves PHL Pilot specifications (Base piping type)

4

[1.575]


40

[98 [3.858]

[2.402] [2.126]

61 5

With manifold outlet port female thread block

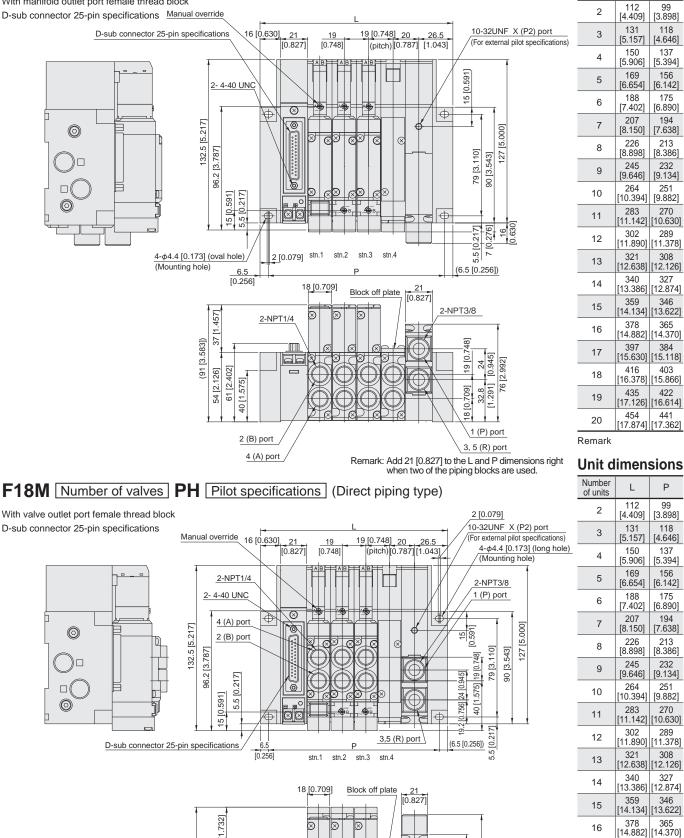

Unit dimensions

Р

156

194

Ρ

175

Number of units

F18 SERIES

384

[15.118]

Remark: Add 21 [0.827] to the L and P dimensions right when two of the piping blocks are used.

76 [2.992]

92 [3.622]

397

[15.630]


17

18

19

20 Remark

F18M Number of valves PHL Pilot specifications (Base piping type)

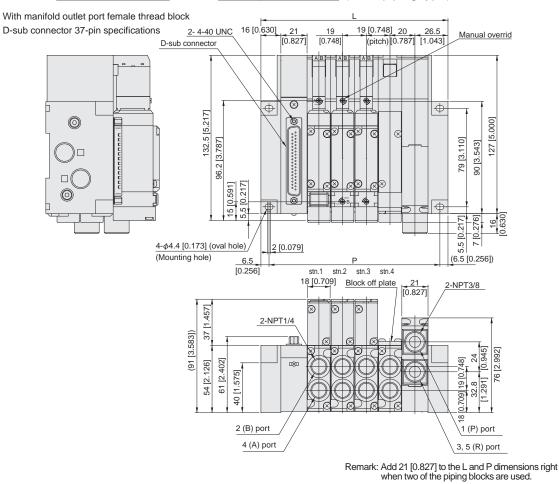


Number of units Р [4.409] [3.898] [5.157] [4.646] [5.906] [5.394] [6.654] [6.142] [7.402] [6.890] [8.150] [7.638] [8.386] [8.898] [9.646] [9.134] [9.882] 10.3941 11.142] [10.630] 11.890] [11.378] 12.638] [12.126] 13.386] [12.874] 14.134] [13.622] 14.882] 14.370] 15.630] [15.118] [15.866] 16.378]

Remark

Unit dimensions

17.126] [16.614]

454 441 [17.874] [17.362]

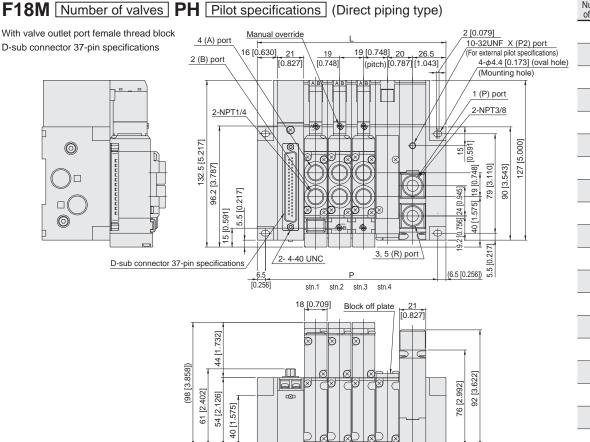

Number Ρ L of units [4.409] [3.898] [5.157] [4.646] [5.394] [5.906] [6.142] [6.654] [7.402] [6.890] [8.150] [7.638] [8.386] [8.898] [9.134] [9.646] 10.394] [9.882] [11.142] [10.630] 11.890] 11.378] [12.126] [12.638] 13.386] 12.874] [14.134] [13.622] [14.882] 14.370] [15.630] [15.118] [15.866] 16.3781 [17.126] [16.614] 454 441 [17.874] [17.362]

192 KOGANEI


Remark: Add 21 [0.827] to the L and P dimensions right when two of the piping blocks are used.

Remark

Unit dimensions

54 [2.126]


40 [1.575]

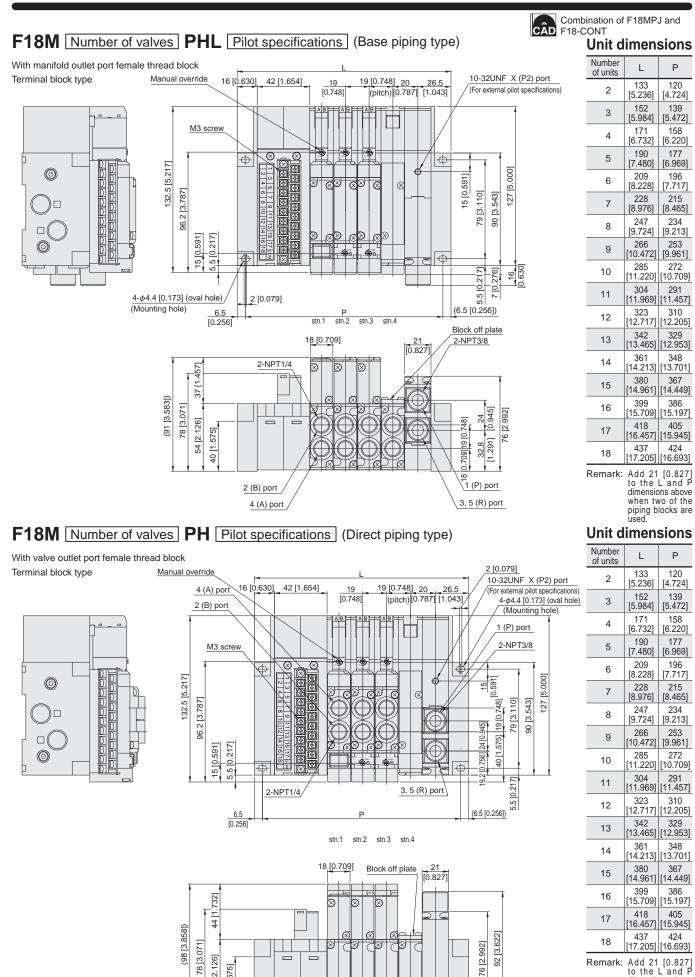

Add 21 [0.827] to the L and P Remark: dimensions above when two of the piping blocks are used


KOGANEI 193

Dimensions of F18 series serial transmission compatible manifold mm [in]

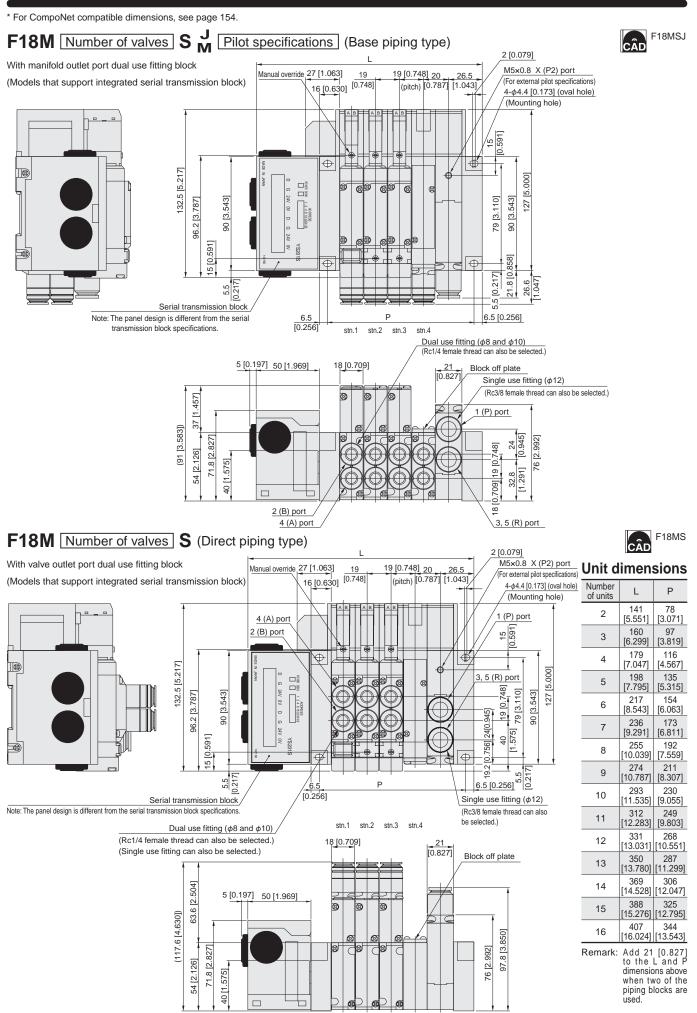


194 KOGANEI

Dimensions of F18 series serial transmission compatible manifold mm [in]

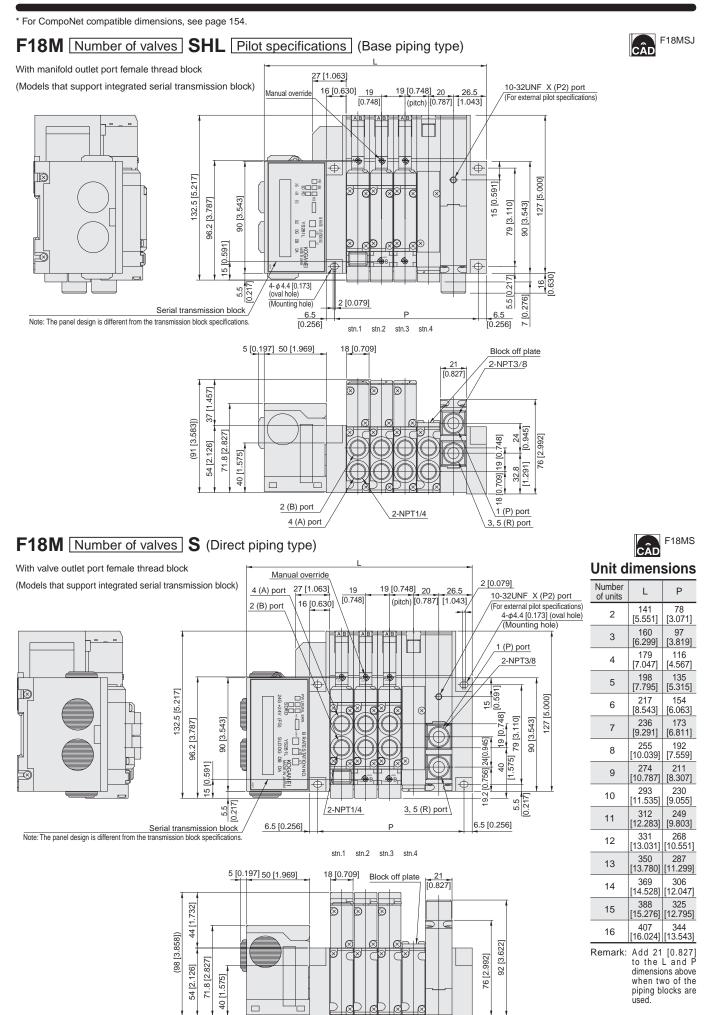


S M Pilot specifications (Base piping type) F18M Number of valves

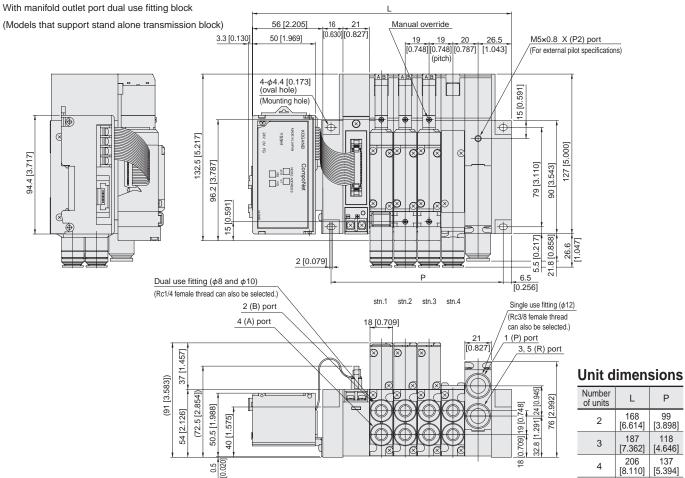


* The communication connectors are sold by Omron Corporation. Contact Omron Corporation for details.

Additional Parts (available separately)


•Muffler: KM-J12 [for both plug-in and non-plug-in]




Muffler: KM-J8 [for individual exhaust spacer only]



Muffler: KM-J10 [for individual exhaust spacer only]



196 KOGANEI

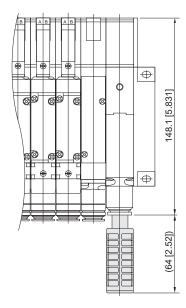

2	[6.614]	[3.898]
3	187 [7.362]	118 [4.646]
4	206 [8.110]	137 [5.394]
5	225 [8.858]	156 [6.142]
6	244 [9.606]	175 [6.890]
7	263 [10.354]	194 [7.638]
8	282 [11.102]	213 [8.386]
9	301 [11.850]	232 [9.134]
10	320 [12.598]	251 [9.882]
11	339 [13.346]	270 [10.630]
12	358 [14.094]	289 [11.378]
13	377 [14.843]	308 [12.126]
14	396 [15.591]	327 [12.874]
15	415 [16.339]	346 [13.622]
16	434 [17.087]	365 [14.370]
Remark:	to the dimension when tw	[0.827] L and P ons above vo of the locks are

Ρ

99

L

F18M Number of valves SHL Pilot specifications (Base piping type)

With manifold outlet port female thread block 56 [2.205] (Models that support stand alone transmission block)


94.4 [3.717]

Unit dimensions L

Ρ

Number


of units

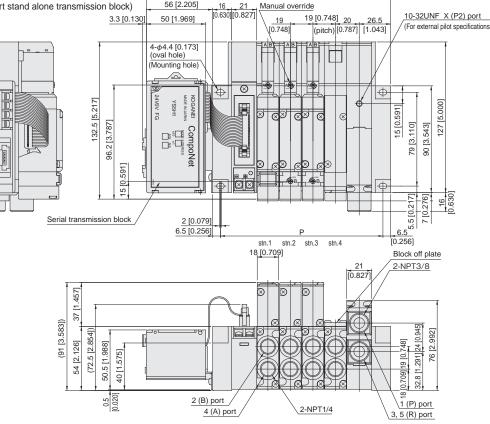

2	168 [6.614]	99 [3.898]
3	187 [7.362]	118 [4.646]
4	206 [8.110]	137 [5.394]
5	225 [8.858]	156 [6.142]
6	244 [9.606]	175 [6.890]
7	263 [10.354]	194 [7.638]
8	282 [11.102]	213 [8.386]
9	301 [11.850]	232 [9.134]
10	320 [12.598]	251 [9.882]
11	339 [13.346]	270 [10.630]
12	358 [14.094]	289 [11.378]
13	377 [14.843]	308 [12.126]
14	396 [15.591]	327 [12.874]
15	415 [16.339]	346 [13.622]
16	434 [17.087]	365 [14.370]
Remark: Add 21 [0.827] to the L and P dimensions above when two of the piping blocks are used.		

* The communication connectors are sold by Omron Corporation. Contact Omron Corporation for details.

F18M Number of valves **SH** Pilot specifications (Direct piping type)

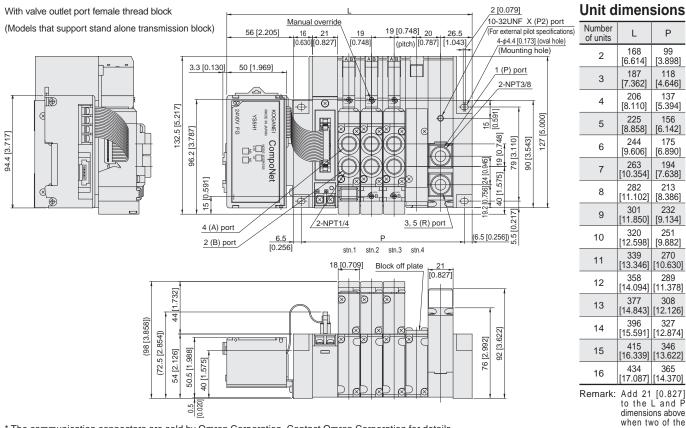

* The communication connectors are sold by Omron Corporation. Contact Omron Corporation for details.

piping blocks are used.

F Series Specifications confirmation Form

INDEX

F10, F15 Series

Monoblock Manifold A Type (Base Piping Type)	202
Monoblock Manifold F Type (Direct Piping Type)	204
Monoblock Manifold A Type, Wire-Saving Type	
(Base Piping Type)	206
Monoblock Manifold F Type, Wire-Saving Type	
(Direct Piping Type)	208
PC Board Manifold A Type (Base Piping Type)	210
PC Board Manifold F Type (Direct Piping Type)	212
Split Manifold Non-Plug-in Type	214
Split Manifold Plug-in Type	216
Serial Transmission Compatible Manifold	218

F18 Series

Monoblock Manifold A Type (Base Piping Type)	220
Monoblock Manifold F Type (Direct Piping Type)	221
Split Manifold Non-Plug-in Type	222
Split Manifold Plug-in Type	224
Serial Transmission Compatible Manifold	226

Example of Specifications Confirmation Form

When ordering F series manifolds, use this specifications confirmation form for complex model configurations, for confirming specifications, etc.

Using the example below for reference, fill out the required items in the "Specifications confirmation Forms" found on p.202 and up, and send it. (Make copies of the Specifications Confirmation Form for your use.)

F1(0, F15 Series	Company name	•	
	oblock Manifold	Contact person		
	be (Base Piping Type)	Order No.		
		ion Eo	·m 1/2	
5h	ecifications Confirmat		III 1/Z	
• Fill i	in selections inside the thick-lined boxes.			
_				
Manifold model		f ication rnal pilot manifold ernal pilot manifold		
nifold	Valve units 2 to 20			
Ma	Manifold outlet specification Valve size J : With dual use fitting blocks			
	10: 10mm width M: With female thread blocks 15: 15mm width L: With selectable fitting blocks			
	stn. 🗆 F Valve size T Valve specification	- Note 3 - A1 -	PS - ^{Note} - ^{Note} 8	Note DC24V
	······································			
	Operation type Blank: Internal pilot type ^{Note1}			Voltage DC12V ^{Note9} DC24V
	G : External pilot type (for positive pressure) ^{Note2} V : External pilot type (for vacuum) ^{Note2}			AC100V ^{Note10,13} AC120V ^{Note10}
				AC240V ^{Note10,11}
	Manual override Blank: Manual override button		essure prevention valve ^{Notes} lo back pressure prevention	5
	R : Manual override lever ^{Note3} 83 : Protruding locking type ^{Note11}	E1 : V	alve Vith back pressure prevention	
	Wiring specification		alve	
	Blank: L type plug connector, Without connector PN : S type plug connector, Without connector		al air supply and exhaust a	pacer, stop valve ^{Note5}
odel	PS : S type plug connector, Lead wire length 300mm [11.8in.] PL : L type plug connector, Lead wire length 300mm [11.8in.] PS3 : S type plug connector, Lead wire length 3000mm [118in.]	NPM : I	lo spacer and no stop valve ndividual air supply spacer (w 10) ^{Note13}	ith M5 female thread for
Mounting valve model	PL3 : L type plug connector, Lead wire length 3000mm [118in.] CPS : Pre-wired positive common terminal S type plug connector, Lea	NP6 : 1	ndividual air supply spacer (w ndividual air supply spacer (w	ith ϕ 6 fitting for F15) ^{Note} ith ϕ 8 fitting for F15) ^{Note}
ng va	length 300mm [11.8in.] CPL : Pre-wired positive common terminal L type plug connector, Lea	ad wire F	ndividual exhaust spacer (with 10) ^{Note13}	M5 female thread for
ountii	length 300mm [11.8in.] CPS3: Pre-wired positive common terminal S type plug connector, Least length 200mm [11.0in]	ad wire NR8 : I	ndividual exhaust spacer (with ndividual exhaust spacer (with	$\phi = \phi = 0$ fitting for F15) ^{Note13} $\phi = \phi = 0$ fitting for F15) ^{Note13}
Ž	length 3000mm [118in.] CPL3: Pre-wired positive common terminal L type plug connector, Lea length 3000mm [118in.]		Vith stop valve ^{Note1}	
	39L : DIN connector type with indicator ^{Note12} 39N : DIN connector type without indicator ^{Note12}			
	Manifold fitting specifications ^{Noted} Can be selected only when the manifold type is A at J5 : Manifold side outlet port with single use fitting			le fitting blocks (metric))
	J6 : Manifold side outlet port with single use fitting M : Manifold side outlet port with female thread b	g block (F10 : φ6, F15 : φ	8)	
	J5A : Manifold side outlet port with single use fitting J5B : Manifold side outlet port with single use fitting	g block, 3-port normally	open (NO) (F10: φ4, F15: φ6)
	J6A : Manifold side outlet port with single use fitting J6B : Manifold side outlet port with single use fitting MA : Manifold side outlet port with forgulat thread b	g block, 3-port normally	open (NO) (F10: φ6, F15: φ8)
	MA : Manifold side outlet port with female thread b MB : Manifold side outlet port with female thread b			
	Can be selected only when the manifold type is AH MH : Manifold side outlet port with female thread b			ble fitting blocks (imperia
	MAH : Manifold side outlet port with female thread b MBH : Manifold side outlet port with female thread b			
	Enter \bigcirc in each designated station in tables on the r	next page.		

	Mounting							1				1	1	· ·								
		valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
	F 🗌 T0 F 🗌 T1	2-position, for single solenoid only	0	$ \cup$	0	$\left \right\rangle$																
	F 🗌 T2	2-position, single solenoid specification 2-position, double solenoid specification			\cup	$\left \circ \right $	\bigcirc	\circ														
	F 🗆 T3	3-position, closed center		-					\cap	_												
	F 🗌 T4 ^{Note}									0												
	F 🗌 T5 ^{Note}	⁶ 3-position, pressure center																				
	F 🗌 TA ^{Note}	^{e7} Tandem 3-port (NC and NC)																				
		e7 Tandem 3-port (NC and NO)	<u> </u>	<u> </u>				<u> </u>														
		(Low current type) 2-position, for single solenoid only	_			<u> </u>																
		(Low current type) 2-position, single solenoid specification	<u> </u>	<u> </u>		-	<u> </u>	-														<u> </u>
	F 🗌 LT2 F 🗌 LT3	(Low current type) 2-position, double solenoid specification (Low current type) 3-position, closed center				-				_												
		(Low current type) 3-position, closed center		-	-	-	-			_												-
		^{ole6} (Low current type) 3-position, pressure center		-																		
		ote7 (Low current type) Tandem 3-port (NC and NC)																				
i le		lote7 (Low current type) Tandem 3-port (NO and NO)																				
Mounting valve models		ote7 (Low current type) Tandem 3-port (NC and NO)																				
a l	F 🗌 BP	Block-off plate																				
1 g	Manual	R Manual override lever ^{Note3}	0	0																		
.ing	override	83 Protruding locking type ^{Note11}																				
- In		J5 With single use fitting block																				
≤∥		J6 With single use fitting block M With female thread block		-		<u> </u>																
		M With female thread block J5A With single use fitting block, 3-port normally closed (NC)								_												
		J5B With single use fitting block, 3-port normally open (NO)																				
	Manifold fitting specification ^{Note4}	J6A With single use fitting block, 3-port normally closed (NC)																				
(Manifold side	J6B With single use fitting block, 3-port normally open (NO)																				
0	outlet port)	MA With female thread block, 3-port normally closed (NC)																				
		MB With female thread block, 3-port normally open (NO)																				
		MH With female thread block																				
		MAH With female thread block, 3-port normally closed (NC)																				
		MBH With female thread block, 3-port normally open (NO)																				
		ck pressure prevention valve		-	\cap																	
		vidual air supply spacer (with M5 female thread for F10) ividual air supply spacer (with ϕ 6 fitting for F15)			\bigcirc	$ \circ $																
		ividual air supply spacer (with ϕ 8 fitting for F15)	-	-	-	-	-		$\left \right $													-
		vidual exhaust spacer (with M5 female thread for F10)																				
		ividual exhaust spacer (with ϕ 6 fitting for F15)																				
		ividual exhaust spacer (with ϕ 8 fitting for F15)																				
	STP Wi	th stop valve																				

Company name Contact person


Order No.

Year/

Monoblock Manifold A Type (Base Piping Type)

Specifications Confirmation Form 1/2

• Fill in selections inside the thick-lined boxes.

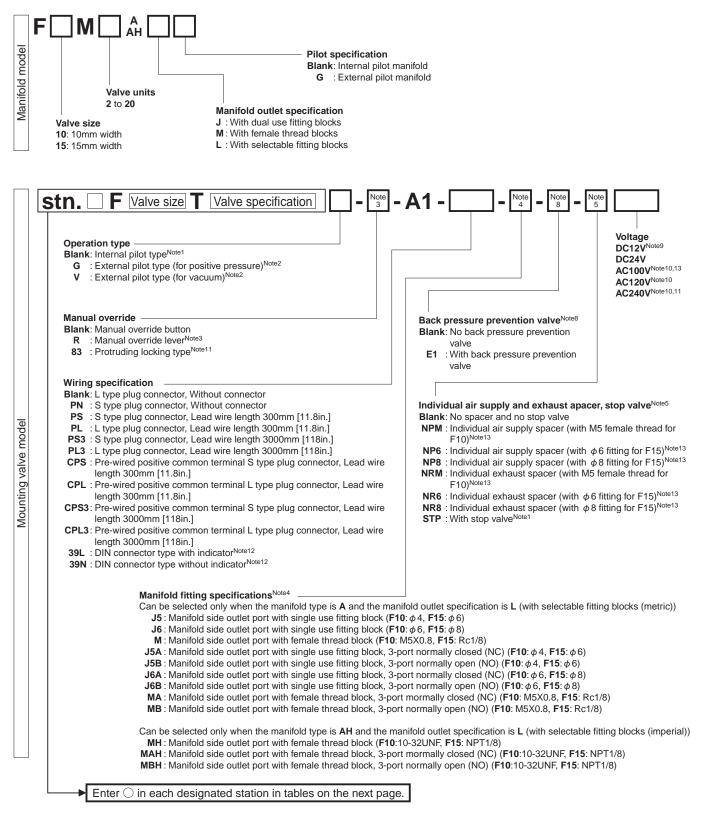

Monoblock Manifold A Type (Base Piping Type) **Specifications Confirmation Form 2/2**

· · · ·	-	ng the valve and block-off pl				r				r	·		r		-							
Mounting	valve,	block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F 🗌 T0	2-p	osition, for single solenoid only																				
F 🗌 T1	2-ро	osition, single solenoid specification																				
F 🗌 T2	2-ро	osition, double solenoid specification																				
F 🗌 T3	3-р	osition, closed center																				
F 🗌 T4 ^{Note}	⁶ 3-p	osition, exhaust center																				
F 🗌 T5 ^{Note}	⁶ 3-p	osition, pressure center																				
F 🗌 TA ^{Note}	7 Tan	dem 3-port (NC and NC)																				
F 🗌 TB ^{Note}	⁷ Tan	dem 3-port (NO and NO)																				
F C TC ^{Note}	⁷ Tan	dem 3-port (NC and NO)																				
F 🗆 LTO	(Low	current type) 2-position, for single solenoid only																				
F 🗌 LT1	(Low	current type) 2-position, single solenoid specification																				
F 🗌 LT2	(Low	current type) 2-position, double solenoid specification																				
F 🗆 LT3	(Lov	v current type) 3-position, closed center																				
F 🗆 LT4 ^{No}	te6 (Low	current type) 3-position, exhaust center																				
F □ LT5 ^{No}	te6 (Low	current type) 3-position, pressure center																				
	^{ote7} (Low	current type) Tandem 3-port (NC and NC)																				
	^{ote7} (Low	current type) Tandem 3-port (NO and NO)																				
	^{ote7} (Low	current type) Tandem 3-port (NC and NO)																				
F 🗌 BP	Blo	ck-off plate																				
Manual	R	Manual override leverNote3																				
override	83	Protruding locking type ^{Note11}																				
	J5	With single use fitting block																				
	J6	With single use fitting block																				
	м	With female thread block																				
	J5A	With single use fitting block, 3-port normally closed (NC)																				
Manifold fitting	J5B	With single use fitting block, 3-port normally open (NO)																				
specification ^{Note4}	J6A	With single use fitting block, 3-port normally closed (NC)																				
(Manifold side	J6B	With single use fitting block, 3-port normally open (NO)																				
outlet port)	MA	With female thread block, 3-port normally closed (NC)																				
	MB	With female thread block, 3-port normally open (NO)																				
	МН	With female thread block																				
	MAH	With female thread block, 3-port normally closed (NC)																				
		With female thread block, 3-port normally open (NO)									1											
E1 ^{Note8} Ba		ssure prevention valve																				
		supply spacer (with M5 female thread for F10)									1											
NP6 Indi	vidual a	air supply spacer (with ϕ 6 fitting for F15)																				
NP8 Indi	vidual a	air supply spacer (with ϕ 8 fitting for F15)	1					1			1											
		haust spacer (with M5 female thread for F10)									1											
		exhaust spacer (with ϕ 6 fitting for F15)									1											
		exhaust spacer (with ϕ 8 fitting for F15)																				
		valve																				

Notes:1. Cannot be mounted on the external pilot manifold.

Cannot be mounted on the internal pilot manifold.
 To designate a manual override lever, enter O in the manual override boxes of the designated station in the above table.

When the valve specification is T1 or T2, the manual override lever is placed only on the A side. This is not available with -39.

4. When the manifold outlet specifications are L (with selectable fitting), select fitting specification for each station, and enter 🔿 in the manifold fitting specification boxes of the above table.

The 3-port specifications are only available in valve specification T0, T1, and T2.

5. When mounting the individual air supply or exhaust spacer or stop valve, enter O in the spacer or stop valve boxes of the designated stations in the above table.

6. Not available in the vacuum valves.

 7. Not availabale in external pilot type and vacuum valves.
 8. When mounting the back pressure prevention valve, enter
 in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer and vacuum valve.

9. Not available in low-current type.

Not available in low-current type and tandem 3-port valves.
 Only for wiring specification -39.
 Only for F15 series and not available for valve specification T1, TA, TB, and TC. In addition, the valve is used only as a double solenoid for T2.

13. Not available with DIN connectors (-39.).

Quantity	set	Delivery

CONFIRMATION FORM


Monoblock Manifold

Company name	
Contact person	
Order No.	

F Type (Direct Piping Type)

Specifications Confirmation Form 1/2

• Fill in selections inside the thick-lined boxes.

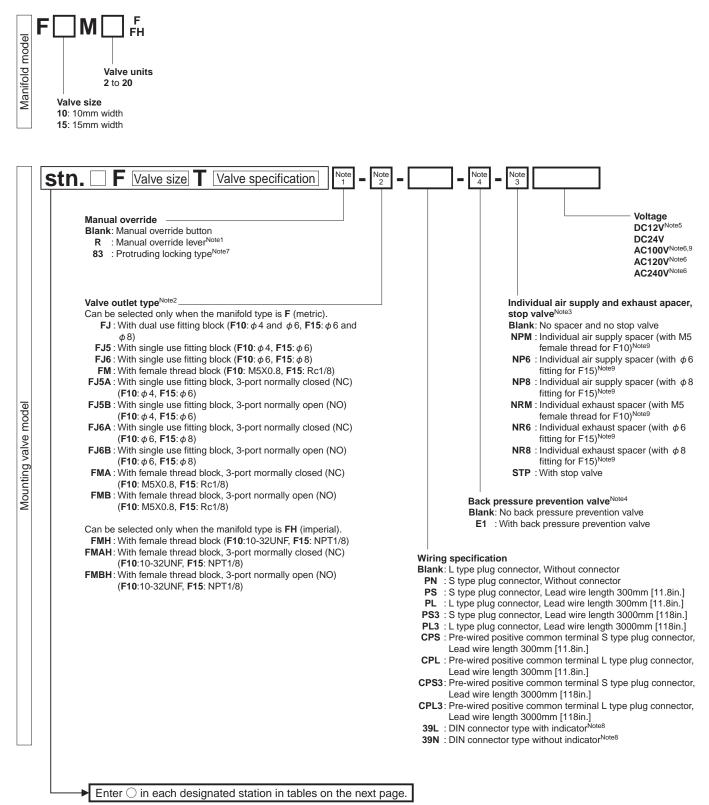

Monoblock Manifold F Type (Direct Piping Type) **Specifications Confirmation Form 2/2**

Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	2
F 🗌 T0	2-position, for single solenoid only																				
F 🗌 T1	2-position, single solenoid specification																				
F 🗌 T2	2-position, double solenoid specification																				
F 🗌 T3	3-position, closed center																				
F 🗌 T4	3-position, exhaust center																				
F 🗌 T5	3-position, pressure center																				
F 🗌 TA	Tandem 3-port (NC and NC)																				
F 🗌 TB	Tandem 3-port (NO and NO)																				
F 🗌 TC	Tandem 3-port (NC and NO)																				
F 🗌 LT0	(Low current type) 2-position, for single solenoid only																				Γ
F 🗌 LT1	(Low current type) 2-position, single solenoid specification																				
F 🗌 LT2	(Low current type) 2-position, double solenoid specification																				
F 🗌 LT3	(Low current type) 3-position, closed center																				F
F 🗌 LT4	(Low current type) 3-position, exhaust center																				t
F 🗌 LT5	(Low current type) 3-position, pressure center																				t
F 🗌 LTA																					t
F 🗌 LTB																					┢
																					┢
F 🗌 BP	Block-off plate																				┢
	R Manual override lever ^{Note1}																				┢
Manual override	83 Protruding locking type ^{Note7}																				⊢
	FJ With dual use fitting block																				\vdash
	FJ5 With single use fitting block																				┢
	FJ6 With single use fitting block																				┢
	FM With female thread block																				┝
																					┢
	FJ5A With single use fitting block, 3-port normally closed (NC)																			<u> </u>	-
Valve	FJ5B With single use fitting block, 3-port normally open (NO)																			<u> </u>	\vdash
outlet type ^{Note2}	FJ6A With single use fitting block, 3-port normally closed (NC)																			<u> </u>	\vdash
7 1 -	FJ6B With single use fitting block, 3-port normally open (NO)																			<u> </u>	┝
	FMA With female thread block, 3-port normally closed (NC)																			<u> </u>	╞
	FMB With female thread block, 3-port normally open (NO)																			<u> </u>	-
	FMH With female thread block																			<u> </u>	
	FMAH With female thread block, 3-port normally closed (NC)																				
	FMBH With female thread block, 3-port normally open (NO)																				L
	ack pressure prevention valve																				\vdash
	lividual air supply spacer (with M5 female thread for F10)																			<u> </u>	L
NP6 Inc	dividual air supply spacer (with ϕ 6 fitting for F15)																				
NP8 Inc	dividual air supply spacer (with ϕ 8 fitting for F15)																				L
NRM Ind	lividual exhaust spacer (with M5 female thread for F10)																				L
NR6 Inc	dividual exhaust spacer (with ϕ 6 fitting for F15)																				
NR8 Inc	dividual exhaust spacer (with ϕ 8 fitting for F15)																				

Notes:1. To designate a manual override lever, enter 🔿 in the manual override boxes of the designated station in the above table.

When the valve specification is T1 or T2, the manual override lever is placed only on the A side. This is not available with -39.

2. Select valve outlet type for each status, and enter \bigcirc in the valve outlet type boxes of the above table. The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**.

3. When mounting the individual air supply or exhaust spacer or stop valve, enter 🔿 in the spacer or stop valve boxes of the designated stations in the above table.

4. When mounting the back pressure prevention valve, enter O in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer.

5. Not available in low-current type.

6. Not available in low-current type and tandem 3-port valves.

Only for wiring specification -39 .
 Only for F15 series and not available for valve specification T1, TA, TB, and TC. In addition, the valve is used only as a double solenoid for T2.


9. Not available with DIN connectors (-39).

Delivery Quantity set

Year/


Monoblock Manifold A Type, Wire-Saving Type (Base Piping Type) Specifications Confirmation Form 1/2

• Fill in selections inside the thick-lined boxes.

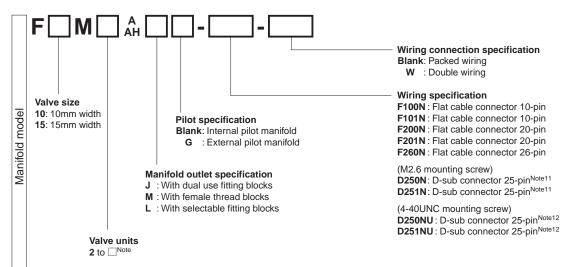

Note: For the maximum number of units, check the table for maximum number of valve units by wiring specification on page 51.

Company name

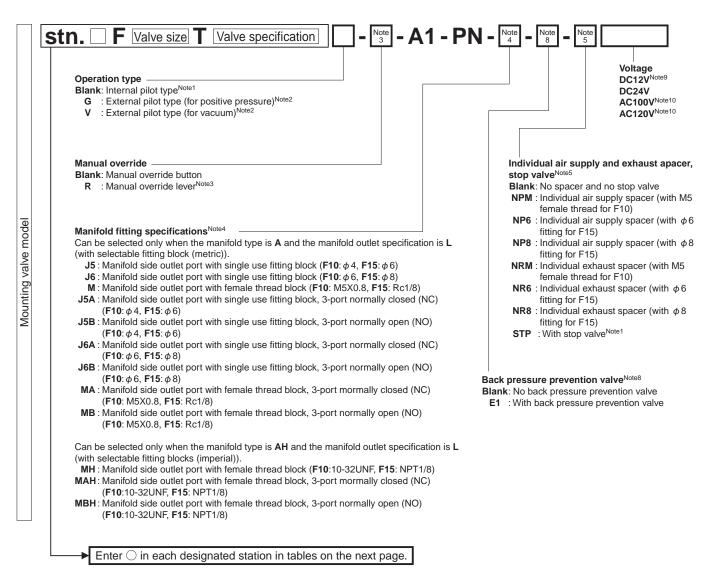

Monoblock Manifold A Type, Wire-Saving Type (Base Piping Type) **Specifications Confirmation Form 2/2**

Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	2
F 🗌 T0	2-position, for single solenoid only																				
F 🗌 T1	2-position, single solenoid specification																				
F 🗌 T2	2-position, double solenoid specification																				
F 🗌 T3	3-position, closed center																				
F 🗌 T4 ^{Note}	⁶ 3-position, exhaust center																				Γ
F 🗌 T5 ^{Note}	⁶ 3-position, pressure center																				
	⁷ Tandem 3-port (NC and NC)																				
F 🗌 TB ^{Note}	²⁷ Tandem 3-port (NO and NO)																				
F 🗌 TC ^{Note}	²⁷ Tandem 3-port (NC and NO)																				
F 🗌 LTO	(Low current type) 2-position, for single solenoid only																				
F 🗌 LT1	(Low current type) 2-position, single solenoid specification																				
F 🗌 LT2	(Low current type) 2-position, double solenoid specification																				
F 🗌 LT3	(Low current type) 3-position, closed center																				Γ
	te6 (Low current type) 3-position, exhaust center																				Γ
	te6 (Low current type) 3-position, pressure center																				
	te7 (Low current type) Tandem 3-port (NC and NC)																				
	^{bte7} (Low current type) Tandem 3-port (NO and NO)																				
	^{bte7} (Low current type) Tandem 3-port (NC and NO)																				
F 🗌 BP	Block-off plate																				
Manual ov	verride (-R) Manual override lever ^{Note3}																				
	J5 With single use fitting block																				
	J6 With single use fitting block																				
	M With female thread block																				
	J5A With single use fitting block, 3-port normally closed (NC)																				
Manifold fitting	J5B With single use fitting block, 3-port normally open (NO)																				
specification ^{Note4}	J6A With single use fitting block, 3-port normally closed (NC)																				
(Manifold side	J6B With single use fitting block, 3-port normally open (NO)																				
outlet port)	MA With female thread block, 3-port normally closed (NC)																				
	MB With female thread block, 3-port normally open (NO)																				
	MH With female thread block																				
	MAH With female thread block, 3-port normally closed (NC)																				
	MBH With female thread block, 3-port normally open (NO)																				
E1 ^{Note8} Ba	ck pressure prevention valve																				
NPM Indiv	vidual air supply spacer (with M5 female thread for F10)																				T
NP6 Indi	vidual air supply spacer (with ϕ 6 fitting for F15)																				Γ
NP8 Indi	vidual air supply spacer (with ϕ 8 fitting for F15)																				T
NRM Indi	vidual exhaust spacer (with M5 female thread for F10)																				T
NR6 Indi	vidual exhaust spacer (with ϕ 6 fitting for F15)																				T
NR8 Indi	vidual exhaust spacer (with ϕ 8 fitting for F15)																				
	th stop valve																				t

Notes:1. Cannot be mounted on the external pilot manifold. 2. Cannot be mounted on the internal pilot manifold.

3. To designate a manual override lever, enter 🔿 in the manual override boxes of the designated station in the above table.

When the valve specification is T1 or T2, the manual override lever is placed only on the A side.

4. When the manifold outlet specifications are L (with selectable fitting), select fitting specification for each station, and enter \bigcirc in the manifold fitting specification boxes of the above table.

The 3-port specifications are only available in valve specification T0, T1, and T2.

5. When mounting the individual air supply or exhaust spacer or stop valve, enter O in the spacer or stop valve boxes of the designated stations in the above table.

6. Not available wiith vacuum valves.

7. Not availabale in external pilot type and vacuum valves.

8. When mounting the back pressure prevention valve, enter 🔾 in the back pressure prevention valve boxes of the designated stations in the above table Not available with the individual exhaust spacer and vacuum valve.

9. Not available in low-current type.

Not available in low-current type and tandem 3-port valves. In addition, only available when the wiring specification is a D-sub connector.
 Can be selected only when the manifold typi is A.
 Can be selected only when the manifold typi is AH.

Delivery Quantity set


Year/

Contact person

Company name

Monoblock Manifold F Type, Order No. Wire-Saving Type (Direct Piping Type) **Specifications Confirmation Form 1/2**

Fill in selections inside the thick-lined boxes.

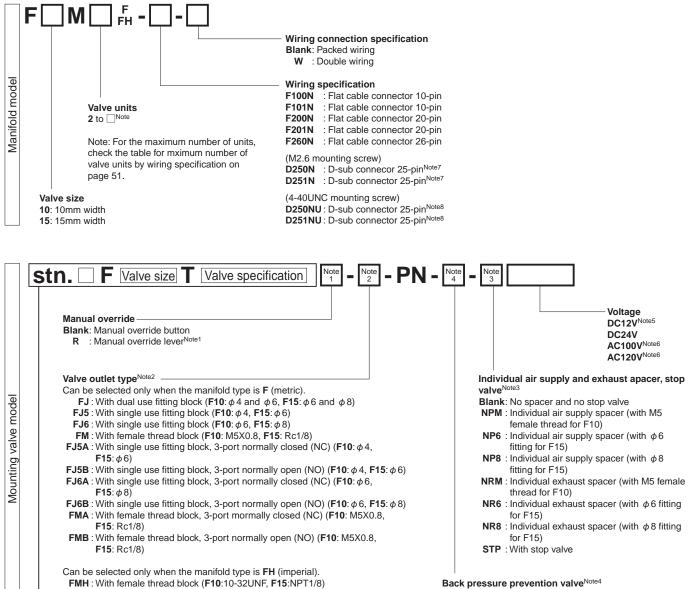

FMH : With female thread block (F10:10-32UNF, F15:NPT1/8) FMAH : With female thread block, 3-port mormally closed (NC) (F10:10-32UNF, F15: NPT1/8)

FMBH: With female thread block, 3-port normally open (NO) (F10:10-32UNF, F15: NPT1/8)

Enter \bigcirc in each designated station in tables on the next page.

Blank: No back pressure prevention valve

E1 : With back pressure prevention valve

Monoblock Manifold F Type Wire-Saving Type (Direct Piping Type) **Specifications Confirmation Form 2/2**

Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	2
F 🗌 T0	2-position, for single solenoid only																				
F 🗌 T1	2-position, single solenoid specification																				
F 🗌 T2	2-position, double solenoid specification																				
F 🗌 T3	3-position, closed center																				
F 🗌 T4	3-position, exhaust center																				Γ
F 🗌 T5	3-position, pressure center																				
F 🗌 TA	Tandem 3-port (NC and NC)																				
F 🗌 TB	Tandem 3-port (NO and NO)																				
F 🗌 TC	Tandem 3-port (NC and NO)																				
F 🗌 LT0	(Low current type) 2-position, for single solenoid only																				
F 🗌 LT1	(Low current type) 2-position, single solenoid specification																				1
F 🗌 LT2	(Low current type) 2-position, double solenoid specification																				Ē
F 🗌 LT3	(Low current type) 3-position, closed center																				
F 🗌 LT4	(Low current type) 3-position, exhaust center																				
F 🗌 LT5	(Low current type) 3-position, pressure center																				Γ
F 🗌 LTA	(Low current type) Tandem 3-port (NC and NC)																				T
F 🗌 LTB	(Low current type) Tandem 3-port (NO and NO)																				
F 🗌 LTC	(Low current type) Tandem 3-port (NC and NO)																				
F 🗌 BP	Block-off plate																				
Manual ov	verride (-R) Manual override lever ^{Note1}																				Γ
	FJ With dual use fitting block																				T
	FJ5 With single use fitting block																				
	FJ6 With single use fitting block																				
	FM With female thread block																				
	FJ5A With single use fitting block, 3-port normally closed (NC)																				F
Valve	FJ5B With single use fitting block, 3-port normally open (NO)																				T
outlet	FJ6A With single use fitting block, 3-port normally closed (NC)																				F
type ^{Note2}	FJ6B With single use fitting block, 3-port normally open (NO)																				T
	FMA With female thread block, 3-port normally closed (NC)																				
	FMB With female thread block, 3-port normally open (NO)																				
	FMH With female thread block																				T
	FMAH With female thread block, 3-port normally closed (NC)																				T
	FMBH With female thread block, 3-port normally open (NO)																				
E1 ^{Note4} Ba	ck pressure prevention valve																				t
	vidual air supply spacer (with M5 female thread for F10)																				
	ividual air supply spacer (with ϕ 6 fitting for F15)																				T
	ividual air supply spacer (with ϕ 8 fitting for F15)																				T
	ividual exhaust spacer (with M5 female thread for F10)																				\square
	lividual exhaust spacer (with ϕ 6 fitting for F15)																				\square
	lividual exhaust spacer (with ϕ 8 fitting for F15)																				t
	ith stop valve																				\vdash

Notes:1. To designate a manual override lever, enter ○ in the manual override boxes of the designated station in the above table. When the valve specification is T1 or T2, the manual override lever is placed only on the A side.
2. Select valve outlet type for each station, and enter ○ in the valve outlet type boxes of the above table. In addition, the 3-port specifications are only

available in valve specifications T0, T1, and T2. 3. When mounting the individual air supply or exhaust spacer or stop valve, enter 🔿 in the spacer or stop valve boxes of the designated stations in the

above table. 4. When mounting the back pressure prevention valve, enter \bigcirc in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer.

5. Not available in low-current type.

6. Not available in low-current type and tandem 3-port valves. In addition, only available when the wiring specification is a D-sub connector.

7. Can be selected only when the manifold typi is F. 8. Can be selected only when the manifold typi is FH.

Delivery Quantity set

Year/

PC Board Manifold A Type (Base Piping Type)


Company name

Contact person

Order No.

Specifications Confirmation Form 1/2

• Fill in selections inside the thick-lined boxes.

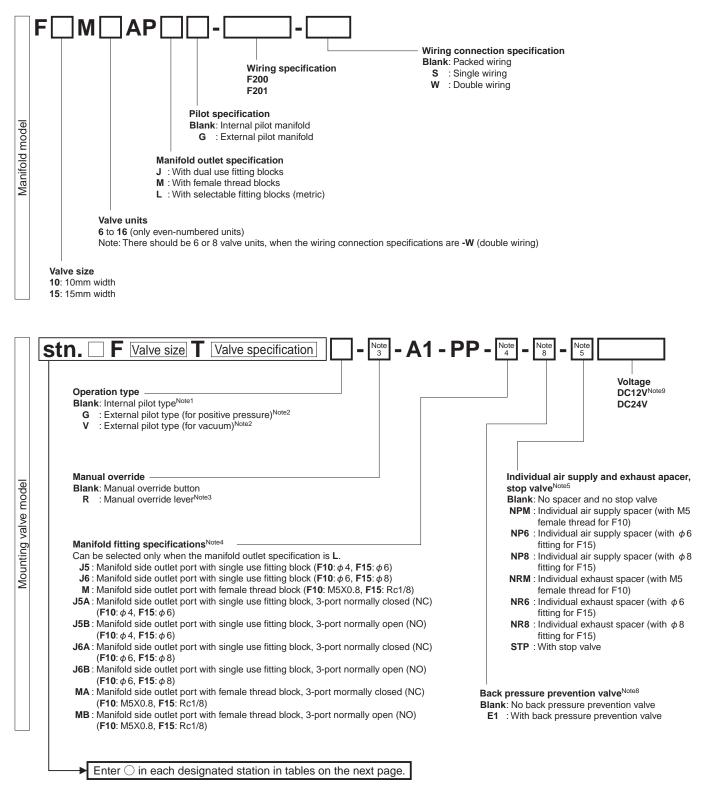

PC Board Manifold A Type (Base Piping Type) Specifications Confirmation Form 2/2

Wiring connection specifications are -S (for single wiring)

stFor specifying the valve and block-off plate to be mounted at each station, enter \bigcirc in each applicable box below. Station 1 2 8 9 10 11 12 13 14 15 16 Mounting valve, block-off plate 3 4 5 6 7

 F I T0
 2-position, for single solenoid only

 F I T1
 2-position, single solenoid specific

 2-position, single solenoid specification **F** LT0 (Low current type) 2-position, for single solenoid only F LT1 (Low current type) 2-position, single solenoid specification F BPC Block-off plate Manual override (-R) Manual override leverNote3 J5 With single use fitting block J6 With single use fitting block М With female thread block Manifold fitting J5A With single use fitting block, 3-port normally closed (NC) specification^{Note4} J5B With single use fitting block, 3-port normally open (NO) (Manifold side J6A With single use fitting block, 3-port normally closed (NC) outlet port) J6B With single use fitting block, 3-port normally open (NO) MA With female thread block, 3-port normally closed (NC) MB With female thread block, 3-port normally open (NO) E1^{Note8} Back pressure prevention valve **NPM** Individual air supply spacer (with M5 female thread for F10) **NP6** Individual air supply spacer (with ϕ 6 fitting for F15) **NP8** Individual air supply spacer (with ϕ 8 fitting for F15) NRM Individual exhaust spacer (with M5 female thread for F10) **NR6** Individual exhaust spacer (with ϕ 6 fitting for F15) **NR8** Individual exhaust spacer (with ϕ 8 fitting for F15) **STP** With stop valve^{Note1}

Caution: Valve units can be selected from only the even-numbered units between 6 and 16.

Wiring connection specifications are -W (for double wiring)

Mounting valve models

Mounting valve, block-off plate Station	1	2	3	4	5	6	7	8	
F T0 2-position, for single solenoid only									
F T1 2-position, single solenoid specification									Caution: There should be either 6 and 8 valves units.
F T2 2-position, double solenoid specification									
F T3 3-position, closed center									
F T4 ^{Note6} 3-position, exhaust center									
F T5 ^{Note6} 3-position, pressure center									
F TA ^{Note7} Tandem 3-port (NC and NC)									
F TB ^{Note7} Tandem 3-port (NO and NO)									
F C TC ^{Note7} Tandem 3-port (NC and NO)									
F LT0 (Low current type) 2-position, for single solenoid only									
F LT1 (Low current type) 2-position, single solenoid specification									
F LT2 (Low current type) 2-position, double solenoid specification									
F LT3 (Low current type) 3-position, closed center									
F LT4 ^{Note6} (Low current type) 3-position, exhaust center									Notes:1. Cannot be mounted on the external pilo
F LT5 ^{Note6} (Low current type) 3-position, pressure center							[manifold.
F LTA ^{Note7} (Low current type) Tandem 3-port (NC and NC)									2. Cannot be mounted on the internal pilo
F LTB ^{Note7} (Low current type) Tandem 3-port (NO and NO)							[manifold.
F LTC ^{Note7} (Low current type) Tandem 3-port (NC and NO)									 To designate a manual override lever, ente ○ in the manual override boxes of the
F BPC Block-off plate							[designated station in the left table.
Manual override (-R) Manual override lever ^{Note3}									4. When the manifold outlet specifications are I
J5 With single use fitting block									(with selectable fitting), select fitting
J6 With single use fitting block									specification for each station, and enter \bigcirc in
M With female thread block									the manifold fitting specification boxes of the
Manifold fitting J5A With single use fitting block, 3-port normally closed (NC)									left table.
Specification Mith single use fitting block 2 part normally open (NO)									The 3-port specifications are only available in
(Manifold side USA With single use fitting block 3-port normally closed (NC)									valve specification T0 , T1 , and T2 . 5. When mounting the individual air supply o
outlet port) J6B With single use fitting block, 3-port normally obset (NO)									exhaust spacer or stop valve, enter \bigcirc in the
MA With female thread block, 3-port normally closed (NC)									spacer or stop valve boxes of the designated
MB With female thread block, 3-port normally open (NO)									stations in the left table.
E1 ^{Note8} Back pressure prevention valve									Not available wiith vacuum valves.
NPM Individual air supply spacer (with M5 female thread for F10)									 7. Not availabale in external pilot type and
NP6 Individual air supply spacer (with ϕ 6 fitting for F15)									vacuum valves.
NP8 Individual air supply spacer (with ϕ 8 fitting for F15)									8. When mounting the back pressure prevention
NRM Individual exhaust spacer (with M5 female thread for F10)								+	valve, enter O in the back pressure prevention
NR6 Individual exhaust spacer (with ϕ 6 fitting for F15)								+	valve boxes of the designated stations in the left table. Not available with the individua
NR8 Individual exhaust spacer (with ϕ 8 fitting for F15)			<u> </u>	<u> </u>				+	exhaust spacer and vacuum valve.
STP With stop valve ^{Note1}								+	9. Not available in low-current type.

CONFIRMATION FORM

Year/


PC Board Manifold F Type (Direct Piping Type)

Company name	
Contact person	
Ordor No	

Order No.

Specifications Confirmation Form 1/2

Fill in selections inside the thick-lined boxes.

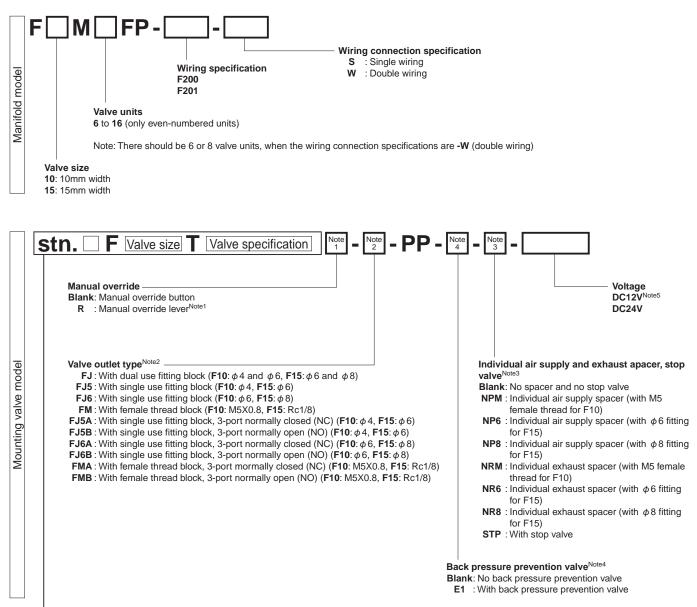

Enter \bigcirc in each designated station in tables on the next page.

212 KOGANEI

PC Board Manifold F Type (Direct Piping Type) Specifications Confirmation Form 2/2

•	ying the valve and block-off plate		2	3	4	5	6	7	8	9	10		12	13	14	15		
T0 2-	position, for single solenoid only			İ														
	position, single solenoid specification																	
<u>/</u> /	ow current type) 2-position, for single solenoid only																	
	w current type) 2-position, single solenoid specification																	
BPC Bl	de (-R) Manual override lever ^{Note1}																	
	FJ With dual use fitting block																	
	FJ5 With single use fitting block																	
	-J6 With single use fitting block																	
	M With female thread block																	
utlet P	JSA With single use fitting block, 3-port normally closed (NC)																	
	FJ5B With single use fitting block, 3-port normally open (NO) FJ6A With single use fitting block, 3-port normally closed (NC)																	
	FJ6B With single use fitting block, 3-port normally closed (NO)																	
	FMA With female thread block, 3-port normally closed (NC)																	
F	MB With female thread block, 3-port normally open (NO)			L														
	pressure prevention valve																	
	al air supply spacer (with M5 female thread for F10)								<u> </u>									
	ual air supply spacer (with ϕ 6 fitting for F15)		<u> </u>								<u> </u>							
	Lal air supply spacer (with ϕ 8 fitting for F15) al exhaust spacer (with M5 female thread for F10)																	
	ual exhaust spacer (with ϕ 6 fitting for F15)																	
	ual exhaust spacer (with ϕ 8 fitting for F15)																	
	top valve																	
	ying the valve and block-off plate	10 0	0 1110	unie	d at	eacr	n stat	lion,	ente	\sim 19	in ea	ich a	ppiic	able	x DOX	Deic	w.	
lounting valv	ve, block-off plate Station		2	3	d at 4	eacr 5	1 Stat 6	10n, 7	ente 8	er 🔾	in ea	ich a	ррис	able	xod 9	Deit	vv.	
Nounting valv	ve, block-off plate Station position, for single solenoid only				-						in ea	ich a	ррис	able	UUX	Deic	vv.	
Nounting valv TO 2- TI 2-	re, block-off plate Station position, for single solenoid only position, single solenoid specification				-													valves (
Mounting value TO 2- T1 2- T2 2-	e, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification				-													valves u
Mounting value T0 2- T1 2- T2 2- T3 3-	re, block-off plate Station position, for single solenoid only position, single solenoid specification				-													valves u
Mounting value TO 2-1 T1 2-1 T2 2-1 T3 3-1 T4 3-1 T5 3-1	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center				-													valves (
Aounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- TA Ta	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC)				-													valves u
Mounting valve T0 T1 T2 T3 T4 T5 TA TA TA TB	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NO and NO)				-													valves ι
Aounting valve T0 2 T1 2 T2 2 T3 3 T4 3 T5 3- TA Ta T5 3- TA Ta TB Ta TC Ta	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO)				-													valves (
Mounting value TO 2- T1 2- T2 2- T3 3- T5 3- T5 3- T5 TA T8 TB T7 TA T8 TC T8 TC	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only				-													valves t
Mounting value TO 2- T1 2- T2 2- T3 3- T4 3- T5 3- T8 Ta T8 Ta T7 TC T8 Ta T0 TC T4 Ta T5 TC T8 Ta T4 Ta T5 TC T8 Ta T0 TC T4 Ta T7 Ta T8 Ta T4 Ta T5 TC T6 TC T7 Ta T6 TC T7 Ta T8 Ta T9 Ta T1 Lta Lta Lta	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO)				-													valves ı
Mounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- T4 3- T5 3- T6 T6 T7 3- T8 T8 T0 CL0 LT2 (Lo LT3 (Lo	ve, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only w current type) 2-position, double solenoid specification w current type) 2-position, closed center				-													valves t
Mounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- T6 T6 T7 3- T8 T8 T8 T0 LT0 L0 LT1 L0 LT3 L12	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, single solenoid specification w current type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification w current type) 3-position, closed center pow current type) 3-position, exhaust center				-													valves t
Mounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- T6 T6 T7 78 T6 T6 T7 78 T8 T8 T0 (Lc LT1 (Lo LT2 Lo LT3 (Li LT4 (Li LT5 (Li LT4 (Li LT5 (Li LT5 (Li LT5 (Li	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification w current type) 3-position, closed center pow current type) 3-position, closed center pow current type) 3-position, pressure center				-													valves t
Mounting value TO 2- T1 2- T2 2- T3 3- T4 3- T5 3- T6 T6 T7 3- T7 3- T7 3- T7 3- T7 3- T7 7- T7 7- T7 7- T7 7- T7 7- T8 T8 T0 1.0 L10 1.0 L11 (Lo L12 1.0 L14 1.17 L15 (Lo L14 L15	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, closed center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification ow current type) 2-position, closed center ow current type) 3-position, closed center ow current type) 3-position, pressure center ow current type) 3-position, pressure center ow current type) 3-position, pressure center ow current type) Tandem 3-port (NC and NC)				-													valves t
Mounting value TO 2- T1 2- T2 2- T3 3- T4 3- T5 3- T6 T6 T8 T6 T0 LT0 LT1 L00 LT2 L00 LT3 L14 LT4 L00 LT4 L00 LT4 L00 LT4 L00 LT4 L00 LT5 L00 LT4 L00 LT5 L00 LT4 L00 LT5 L00 LT4 L00 LT5 L00 L14 L00 L15 L00 L14 L00	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, closed center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification w current type) 2-position, closed center ow current type) 3-position, closed center ow current type) 3-position, pressure center ow current type) 3-position, pressure center ow current type) Tandem 3-port (NC and NC) ow current type) Tandem 3-port (NC and NO)				-													valves t
Mounting value TO 2- T1 2- T2 2- T3 3- T4 3- T5 3- T4 3- T5 3- T6 T6 T7 3- T8 T8 T0 C LT0 Lcc LT2 Loc LT4 Lcc LT5 Lcc LT6 LCC BPC BH	ve, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 2-position, single solenoid specification ow current type) 3-position, closed center pow current type) 3-position, pressure center ow current type) 3-position, pressure center ow current type) 3-position, pressure center ow current type) Tandem 3-port (NC and NC) ow current type) Tandem 3-port (NC and NO) ow current type) Tandem 3-port (NC and NO) ow current type) Tandem 3-port (NC and NO) ock-off plate				-													valves t
Mounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- T4 3- T5 3- T6 T6 T0 10 LT0 LC LT1 L0 LT2 L0 LT3 L14 LT4 L0 LT5 L4 LT6 L6 LT7 L0 LT8 L0 LT4 L0 LT5 L4 L4 L75 L75 L74 L75 L75 L75 L76 L76 BPC Manual overni	ve, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 3-position, closed center pow current type) 3-position, pressure center pow current type) 3-position, pressure center pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NO) pock-off plate de (-R) Manual override lever ^{Note1}				-													valves t
Mounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- T6 T6 T6 T7 T6 T6 T7 T6 T6 T7 T7 T6 T7 T6 T7 T6 T7 T6 T7 T6 T7 T6 T7 T7 T8 T8 T8 T7 L00 L17 L17 L00 L17	ve, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 3-position, closed center pow current type) 3-position, pressure center pow current type) 3-position, pressure center pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NO) pock-off plate de (-R) Manual override lever ^{Note1}				-													valves t
Aounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- TA Ta T5 3- TA Ta TC Ta TC Ta LT0 (Lc LT1 (Lo LT3 (Li LT4 (Lo LT5 (Lo LT4 (Lo LT5 (Lo LT6 BPC Manual overring F	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification w current type) 3-position, closed center pow current type) 3-position, pressure center pow current type) 3-position, pressure center pow current type) 3-position, pressure center pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pock-off plate de (-R) Manual override lever ^{Note1} -J With dual use fitting block				-						autio	n: The	ere sh	ould I	oe eith	ner 6	and 8	
Mounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- T4 3- T5 TA T8 Ta T0 LT2 LT1 L0 LT2 L0 LT3 L12 LT4 L0 LT5 L4 LT4 L0 LT5 L4 LT6 BPC Manual overrist I I J J	ve, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 3-position, closed center pow current type) 3-position, pressure center pow current type) 3-position, pressure center pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NO) pock-off plate de (-R) Manual override lever ^{Note1}				-						autio	n: The	design	ould I nate : e ma	oe eith a mar nual	ner 6 nual c	and 8 werrid	e lever,
Aounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- T6 T6 T7 78 T6 T6 T7 10 T6 10 T7	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, closed center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification ow current type) 3-position, closed center ow current type) 3-position, closed center ow current type) 3-position, pressure center bw current type) 3-position, pressure center ow current type) 7-andem 3-port (NC and NC) ow current type) 7-andem 3-port (NC and NO) ock-off plate de (-R) Manual override lever ^{Note1} -J With dual use fitting block FJ5 With single use fitting block				-						autio	n:The . To () des	design in the	ould I nate a e ma ed sta	oe eith a mar nual tion ir	nual c over 1 the l	werrid ride t	e lever, poxes d
Aounting value TO 2- T1 2- T3 3- T4 3- T5 3- TA Ta T5 3- TA Ta T5 3- TA Ta T5 10 T4 3- T5 10 T4 10 LT0 LC LT2 L0 LT2 L0 LT4 L0 LT5 L0 LT6 LC BPC Bhanual overni If J Valve J valuet J	ve, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 3-position, closed center pow current type) 3-position, pressure center ow current type) 3-position, pressure center ow current type) 3-position, pressure center bw current type) Tandem 3-port (NC and NC) ow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3				-						autio	n: The . To (○ i des 2. Sele	design in the ect fitt	ould I nate : e ma ed sta ing fc	a mar nual tion iri e ac	ner 6 nual c over n the l h stal	and 8 werridt ride t eft tab	e lever, poxes c ile. nd ente
Mounting value T0 2- T1 2- T2 2- T3 3- T4 3- T5 3- T4 3- T5 3- T6 T6 T0 10 LT0 LC LT1 Lo LT4 L11 LT4 L12 LT4 L14 LLT4 Lo LT4 Lo LT5 Lo LT4 Lo LT5 Lo LT4 Lo LT5 Lo LT4 Lo LT5 Lo Anual overri F Jave J /alve J ypeNote2 J	ve, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) wcurrent type) 2-position, for single solenoid only wcurrent type) 2-position, for single solenoid specification w current type) 2-position, double solenoid specification wcurrent type) 3-position, chosed center pow current type) 3-position, pressure center pow current type) 3-position, pressure center pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) </td <td></td> <td></td> <td></td> <td>-</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td>autio</td> <td>n: The ○ i des 2. Sele the In a</td> <td>design n the ignate ect fitte valte</td> <td>ould I nate a e ma ed sta ing fc outle n, the</td> <td>a mar nual tion ir r eac t type</td> <td>nual co over n the l boxe: rt spe</td> <td>and 8 werrid ride t eft tab ion, a s of th</td> <td>e lever, poxes o ile. nd ente e above tions ar</td>				-						autio	n: The ○ i des 2. Sele the In a	design n the ignate ect fitte valte	ould I nate a e ma ed sta ing fc outle n, the	a mar nual tion ir r eac t type	nual co over n the l boxe: rt spe	and 8 werrid ride t eft tab ion, a s of th	e lever, poxes o ile. nd ente e above tions ar
Mounting valve TO 2- T1 2- T2 2- T3 3- T4 3- T5 3- T6 T6 T7 7- T6 T7 T7 7- T7 3- T7 10 T7	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, exhaust center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) w current type) 2-position, for single solenoid only w current type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification w current type) 3-position, closed center pow current type) 3-position, closed center ow current type) 3-position, pressure center pow current type) 3-position, pressure center pow current type) Tandem 3-port (NC and NC) w current type) Tandem 3-port (NC and NO) pock-off plate de (-R) Manual override lever ^{Note1} 5J With single use fitting block 4 With single use fitting block, 3-port normally closed (NC) 15B With single use fitting block, 3-port normally closed (NC) 16B With single use fitting block, 3-port normally closed (NC) 16B With single use fitting block, 3-port normally closed (NC) 16B With single use fitting block, 3-port normally closed (NC) 16B With single use fitting block, 3-port normally closed (NC)				-						autio	. To () des 2. Sele In a avai	design n the ignate ect fitte valte	ould I nate a e ma ed sta ing fc outle n, the	a mar nual tion ir r eac t type	nual co over n the l boxe: rt spe	and 8 werrid ride t eft tab ion, a s of th	e lever, poxes d ile. nd ente e above
Mounting valve TO 2 T1 2 T3 3 T4 3 T5 3 T6 T6 T7 7- T3 3 T4 3 T7 7- T6 T6 T7 7- T6 T7 T7 1-	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, pressure center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) wcurrent type) 2-position, for single solenoid only wcurrent type) 2-position, for single solenoid specification wcurrent type) 2-position, single solenoid specification wcurrent type) 3-position, closed center wcurrent type) 3-position, pressure center pow current type) 3-position, pressure center wcurrent type) 3-position, pressure center pow current type) 3-position, pressure center wcurrent type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) bdc (-R) Manual override lever ^{Note1} cow current type) cd (-R)				-						autio otes:1	. To () des 2. Selé the In a avai T2 .	desigr in the grate ct fitt valve ddtion lable	ould I e ma ed sta ing fc outle n, the in va	a mar nual tion ir or eac t type s 3-po l/ve sp	nual c over n the l h stat boxe rt spoecific	and 8 werride t ride t eft tab ion, a s of th ecifica actions	e lever, boxes o le. nd ente e above tions ar s T0, T
Mounting valve TO 2- T1 2- T3 3- T4 3- T5 3- T6 T6 T7 3- T7 10 LT0 Lt2 L17 Lt4 L17 Lt6 L17 Lt7 L17 Lt6 L17 Lt7 L17 Lt7<	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, single solenoid specification position, closed center position, closed center position, closed center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) mdem 3-port (NC and NO) wcurrent type) 2-position, for single solenoid only wcurrent type) 2-position, for single solenoid specification wcurrent type) 2-position, single solenoid specification wcurrent type) 3-position, closed center ww current type) 3-position, closed center wcurrent type) 3-position, pressure center wcurrent type) 3-position, pressure center wcurrent type) 3-position, pressure center wcurrent type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) bow current type) Tande				-						autio otes:1	n: The . To c output . Sele the In a avai avai . Sele the In a avai . Sele the In a avai . Sele . Sele	design n the ignate valve ddtiou ilable en mo	ould I a mate a e ma a ed sta ing fc outle n, the in va ountir	a mar nual tion ir r eac t type s 3-po lve sp ng the	nual c over n the l boxe rt spo occific e indiv	and 8 everrid ride t eft tab ion, a s of th ceifica: ations vidual	e lever, poxes o ile. nd ente e above tions ar
Mounting valve T0 2- T1 2- T3 3- T4 3- T5 3- T6 T6 T7 3- T7 3- T5 3- T6 T6 T7 7- T8 T8 T0 LC LT1 Lo LT2 Lo LT4 L1 LT4 L1 LT4 L0 LT4 L1 LT4 L0 LT4 L0 LT4 L1 LT5 L0 LT4 L0 LT5 L0 LT4 L1 L10 L1 L1 L1	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, closed center position, pressure center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) wcurrent type) 2-position, for single solenoid only wcurrent type) 2-position, for single solenoid specification wcurrent type) 2-position, single solenoid specification wcurrent type) 3-position, closed center wcurrent type) 3-position, pressure center pow current type) 3-position, pressure center wcurrent type) 3-position, pressure center pow current type) 3-position, pressure center wcurrent type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) wcurrent type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) bdc (-R) Manual override lever ^{Note1} cow current type) cd (-R)				-						autio otes:1	n: The . To () des 2. Sele In a avai T2. 3. White spai	design in the ignate ect fitt valve iddtion ilable en mo	ould I e ma ed sta in ya pountir space stop	a mar nual tion ir or eac t type s 3-poo live sp ng the r or s valve	nual co over n the I h stat boxe: e indiv top va	and 8 averrid t ride t eft tab ion, a s of th scifica ations <i>v</i> idual alve, e	e lever, poxes o ile. nd ente e above tions ar s T0 , T ⁻ air sup
Auounting valve TO 2 T1 2 T2 2 T3 3 T4 3 T5 3 T4 3 T5 TA T8 Ta T1 Lto LT1 Lto LT2 LT3 LT4 Lto LT4 Lto LT5 Lta LT4 Lta LT5 Lta LT4 Lta LT5 Lta LT4 Lta LT5 Lta LT4 Lta LT5 Lta Annual overring J J J Valve J J J LTNote4 Back F J IPM Individu IP6 Individu	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, double solenoid specification position, double solenoid specification position, exhaust center position, pressure center ndem 3-port (NC and NC) indem 3-port (NC and NO) wcurrent type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only wcurrent type) 3-position, closed center w current type) 3-position, chosed center pow current type) 3-position, chosed center w current type) 3-position, pressure center pow current type) 3-position, pressure center w current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) w current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) w current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) w current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) w current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NC) w current type) Tandem 3-port (NC and NC) pok 4-fiting block J With dual use fitting block J With dual use fitting block J With dual use fitting block				-						autio	n: The . To () des 2. Sele the ln a avai T2. 5. Whi exhi- spa stat	desigre in the cot fitt valve ddtioo lable en mo aust s cer or ions in	ould I e mate a e ma d sta ing fc outle n, the in va ountir space c stop n n the	a mar nual tion ir or eac t type s 3-po live sp ng the r or s valve left ta	ner 6 nual c over h stat boxe overfic e boxe blo.	and 8 werride t ride t ion, a s of th ecifica ations <i>i</i> dual alve, e s of th	e lever, boxes o le. nd ente e above tions ar s T0, T air sup inter ⊖ ne desig
Mounting valve TO 2 T1 2 T2 2 T3 3 T4 3 T5 3 T5 3 T6 T6 T0 2- T3 3 T5 3 T6 T7 T6 T7 T7 7- T6 T7 T7 7- T8 T8 T0 10- L17 10- L18 10- L19 10- <t< td=""><td>re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, double solenoid specification position, closed center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) indem 3-port (NC and NO) wcurrent type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only wcurrent type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification wcurrent type) 3-position, chased center ow current type) 3-position, pressure center pow current type) 3-position, pressure center ow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pock-off plate de (-R) Manual override lever^{Note1} FJ SJ With dual use fitting block M With female thread block MWith single use fitting block, 3-port normally closed (NC) JSB With single use fitting block, 3-port normally closed (NC) JSB With single use fitting block, 3-port normally closed (NC)</td><td></td><td></td><td></td><td>-</td><td></td><td></td><td></td><td></td><td></td><td>autio</td><td>n: The . To c o the ln a available the ln a available the spate stat . When</td><td>design n the ignate valve ddtiou ilable en mo aust s cer or ions il ons il ons il</td><td>ould I nate a e ma ed sta ing fo outle n, the space r stop n the ountin</td><td>a mar nual tion ir r eac t type s 3-po ulve s ng the r or s valve g the</td><td>nual c over n the l h stat boxe rt spo cecific e indiv top va ble. ble. ble.</td><td>and 8 averridt ride t eft tab ion, a s of th coffica: vidual alve, e s of tt pressi</td><td>e lever, poxes o le. nd ente e above tions ar s T0, T air sup inter ⊖ ne desig ure prev</td></t<>	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, double solenoid specification position, closed center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) indem 3-port (NC and NO) wcurrent type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only wcurrent type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification wcurrent type) 3-position, chased center ow current type) 3-position, pressure center pow current type) 3-position, pressure center ow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pock-off plate de (-R) Manual override lever ^{Note1} FJ SJ With dual use fitting block M With female thread block MWith single use fitting block, 3-port normally closed (NC) JSB With single use fitting block, 3-port normally closed (NC) JSB With single use fitting block, 3-port normally closed (NC)				-						autio	n: The . To c o the ln a available the ln a available the spate stat . When	design n the ignate valve ddtiou ilable en mo aust s cer or ions il ons il ons il	ould I nate a e ma ed sta ing fo outle n, the space r stop n the ountin	a mar nual tion ir r eac t type s 3-po ulve s ng the r or s valve g the	nual c over n the l h stat boxe rt spo cecific e indiv top va ble. ble. ble.	and 8 averridt ride t eft tab ion, a s of th coffica: vidual alve, e s of tt pressi	e lever, poxes o le. nd ente e above tions ar s T0 , T air sup inter ⊖ ne desig ure prev
Mounting valve TO 2 T1 2 T2 2 T3 3 T4 3 T5 3 T5 3 T5 3 T5 3 T5 3 T6 TA T8 Ta T0 (Lc LT1 (Lo LT3 (Li LT4 (Li LT4 LC LT4 (Li LT4 (Li LT4 (Li LT5 (Li LT6 LT7<(Li	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, double solenoid specification position, closed center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) wd urrent type) 2-position, for single solenoid only w urrent type) 2-position, for single solenoid only w urrent type) 2-position, for single solenoid specification w urrent type) 3-position, closed center ow current type) 3-position, pressure center pow current type) 3-position, pressure center ow current type) Tandem 3-port (NC and NC) pow current type) Tandem 3-port (NC and NO) ow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3				-						autio	n: The . To () des 2. Sele In a avai T2. . Whe valv valv	design in the ignate ect fitt valve cer or ions in en mo cors in en mo ce, ent e box	ould I e ma e d sta in ya pountir s stop n the puntin er \bigcirc	a mar nual tion ir or eac t type s 3-poo live sy her the sy valve left ta g the in the the to the to	nuel c over n the l h stat boxe: ble. back design	and 8 verrid t ride t eft tab ion, a s of th actions vidual alve, e s of th press press pared s	e lever, poxes o le. nd ente e above tions ar s T0 , T air sup neter ⊖ re desig ure prev ure prev stations
Mounting valve TO 2 T1 2 T2 2 T3 3 T4 3 T5 3 T6 T6 T7 3 T6 T6 T7 3 T7 10-	re, block-off plate Station position, for single solenoid only position, single solenoid specification position, double solenoid specification position, double solenoid specification position, closed center position, pressure center indem 3-port (NC and NC) indem 3-port (NC and NO) indem 3-port (NC and NO) wcurrent type) 2-position, for single solenoid only w current type) 2-position, for single solenoid only wcurrent type) 2-position, for single solenoid specification w current type) 2-position, for single solenoid specification wcurrent type) 3-position, chased center ow current type) 3-position, pressure center pow current type) 3-position, pressure center ow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pow current type) Tandem 3-port (NC and NO) pock-off plate de (-R) Manual override lever ^{Note1} FJ SJ With dual use fitting block M With female thread block MWith single use fitting block, 3-port normally closed (NC) JSB With single use fitting block, 3-port normally closed (NC) JSB With single use fitting block, 3-port normally closed (NC)				-						autio otes:1 2	n: The . To (des 2. Sele the avai T2 . 3. Whe exhi- spai stat 4. Why valv left	desigre in the in the cet fitt valve ddtion lable en mc cer or ions in en mc table	ould I nate a e ma ed sta ing fc outle in va ountir space outle in va ountir space outle in va ountir space outle in va ountir space outle in va outle in va outle	a mar nual tion ir or eac t type e 3-po live sp og the r or s valve left ta g the in the ta vali	ner 6 nual c over h stat boxecific e indiv back back back back back back back back	and 8 verrid t ride t eft tab ion, a s of th actions vidual alve, e s of th press press pared s	e lever, boxes o le. nd ente e above tions ar s T0 , T air sup enter ane desig

Quantity

set Delivery

F10, F15 Series Company name Contact person Split Manifold Non-Plug-in Type Order No. **Specifications** Confirmation Form 1/2 Fill in selections inside the thick-lined boxes. Ν Μ F NH Piping block specification (air supply and exhaust) Can be selected only when the manifold type is N (metric). **Pilot specification** JR : With dual use fitting, right-side mounting Blank: Internal pilot manifold JL : With dual use fitting, left-side mounting G : External pilot manifold JD : With dual use fitting, both-side mounting Manifold mode MR : With female thread, right-side mounting ML : With female thread, left-side mounting Manifold outlet specification MD : With female thread, both-side mounting : With dual use fitting blocks J5R : With single use fitting ϕ 8, right-side mounting м : With female thread blocks **J6R** : With single use fitting ϕ 10, right-side mounting : With selectable fitting blocks **J5L** : With single use fitting ϕ 8, left-side mounting Blank: With plates (direct piping type) **J6L** : With single use fitting ϕ 10, left-side mounting **J5D** : With single use fitting ϕ 8, both-side mounting Valve units **J6D** : With single use fitting ϕ 10, both-side mounting 2 to 20 Can be selected only when the manifold type is NH (imperial). Valve size MRH: With female thread, right-side mounting 10: 10mm width MLH : With female thread, left-side mounting 15: 15mm width MDH: With female thread, both-side mounting When manifold outlet specifications are J, M, or L. Δ1 Note 7 stn. Valve size Valve specification Note4 Voltage DC12VNc te11 **Operation type** Manual override Blank: Internal pilot typeNote1 Blank: Manual override button DC24V G : External pilot type^{Note2} AC100VNote12 R : Manual override leverNote3 AC120VNote12 Manifold fitting specifications^{Note5} Port isolator Blank: No port isolator Can be selected only when the manifold type is N and the manifold outlet specification is L SP : For 1(P) port^{Note7} (with selectable fitting blocks (metric)) SR : For 3(R2), 5(R1) ports^{Note7} J5 : Manifold side outlet port with single use fitting block^{Note13} (F10: ϕ 4, F15: ϕ 6) J6 : Manifold side outlet port with single use fitting block^{Note13} (F10: \$\phi 6, F15: \$\phi 8) SA : For 1(P), 3(R2), 5(R1) ports^{Note7} Manifold side outlet port with single dse nting block ^{Note13} (F10: Ø5, F13, Ø5) M : Manifold side outlet port with single use fitting block, 3-port normally closed (NC)^{Note13} (F10: Ø4, F15: Ø6) Individual air supply and exhaust apacer^{Note6} J5B : Manifold side outlet port with single use fitting block, 3-port normally open (NO)^{Note13} (F10: \$\phi4\$, F15: \$\phi6\$) Blank: No spacer **J6A** : Manifold side outlet port with single use fitting block, 3-port normally closed (NC)^{Note13} (F10: ϕ 6, F15: ϕ 8) NPM : Individual air supply spacer (with M5 J6B : Manifold side outlet port with single use fitting block, 3-port normally closed (NC)^{Note13} (F10: ϕ 6, F15: ϕ 8) MA : Manifold side outlet port with female thread block, 3-port normally closed (NC)^{Note13} (F10: M5X0.8, F15: Rc1/8) female thread for F10) NP6 : Individual air supply spacer (with $\phi 6$ fitting for F15) MB : Manifold side outlet port with female thread block, 3-port normally open (NO)Note13(F10: M5X0.8, F15: Rc1/8) **NP8** : Individual air supply spacer (with $\phi 8$ Can be selected only when the manifold type is NH and the manifold outlet specification is L Mounting valve model fitting for F15) (with selectable fitting blocks (imperial)) NRM : Individual exhaust spacer (with M5 MH : Manifold side outlet port with female thread block^{Note14} (F10:10-32UNF, F15: NPT1/8) female thread for F10) MAH : Manifold side outlet port with female thread block, 3-port mormally closed (NC)^{Note14} (F10:10-32UNF, F15: NPT1/s) MBH : Manifold side outlet port with female thread block, 3-port normally open (NO)^{Note14} (F10:10-32UNF, F15: NPT1/s) **NR6** : Individual exhaust spacer (with $\phi 6$ fitting for F15) **NR8** : Individual exhaust spacer (with $\phi 8$ Wiring specification PN: S type plug connector, Without connector fitting for F15) PS: S type plug connector, Lead wire length 300mm [11.8in.] Back pressure prevention valve^{Note10} PS3 : S type plug connector, Lead wire length 3000mm [118in.] Blank: No back pressure prevention valve CPS : Pre-wired positive common terminal S type plug connector, Lead wire length 300mm E2 : With back pressure prevention valve [11.8in.] CPS3 : Pre-wired positive common terminal S type plug connector, Lead wire length 3000mm [118in.] Valve outlet type A1 : With plate (When manifold outlet specification are J, M, or L, the valve type should be A1.) Can be selected only when the manifold type is N and the manifold outlet specification is "Blank" (metric). **FJ** : With dual use fitting block^{Note4} (**F10**: ϕ 4 and ϕ 6, **F15**: ϕ 6 and ϕ 8) **FJ5** : With single use fitting block^{Note4} (**F10**: ϕ 4, **F15**: ϕ 6) FJ6 : With single use fitting block^{Note4} (F10: ϕ 6, F15: ϕ 8) FM : With female thread block^{Note4} (F10: M5X0.8, F15: Rc1/8) FJ5A : With single use fitting block, 3-port normally closed (NC)^{Note4} (F10: ϕ 4, F15: ϕ 6) **FJ5B** : With single use fitting block, 3-port normally closed (NO)^{Noted} (F10: ϕ 4, F15: ϕ 6) **FJ5B** : With single use fitting block, 3-port normally open (NO)^{Noted} (F10: ϕ 4, F15: ϕ 8) **FJ6B** : With single use fitting block, 3-port normally closed (NO)^{Noted} (F10: ϕ 6, F15: ϕ 8) **FJ6B** : With single use fitting block, 3-port normally open (NO)^{Noted} (F10: ϕ 6, F15: ϕ 8) **FMA**: With female thread block, 3-port normally closed (NC)^{Note4} (**F10**: M5X0.8, **F15**: Rc1/8) **FMB**: With female thread block, 3-port normally open (NO)^{Note4} (**F10**: M5X0.8, **F15**: Rc1/8) Can be selected only when the manifold type is NH and the manifold outlet specification is "Blank" (imperial). FMH: With female thread block^{Note4} (F10:10-32UNF, F15: NPT1/8) FMAH: With female thread block, 3-port mormally closed (NC)^{Note4} (F10:10-32UNF, F15: NPT1/8) FMBH: With female thread block, 3-port normally open (NO)^{Note4} (F10:10-32UNF, F15: NPT1/8)

Order Date Month/

Day/

Year/

Split Manifold Non-Plug-in Type **Specifications Confirmation Form 2/2**

Mounting	valve, block-off plate Sta	tion	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	1
F 🗌 T0	2-position, for single solenoid onl	y																				Τ
F 🗌 T1	2-position, single solenoid specifica	tion																				T
F 🗌 T2	2-position, double solenoid specifica	tion																				T
F 🗌 T3	3-position, closed center																					T
F 🗌 T4	3-position, exhaust center																					t
F 🗌 T5	3-position, pressure center																					t
F TANot	e9 Tandem 3-port (NC and NC)																					t
F TB ^{Not}	^{e9} Tandem 3-port (NO and NO)																					t
	^{re9} Tandem 3-port (NC and NO)																				<u> </u>	+
F LT0	(Low current type) 2-position, for single solenoid	only																				+
F 🗌 LT1	(Low current type) 2-position, single solenoid specifi																					+
F 🗌 LT2	(Low current type) 2-position, double solenoid specifi																					+
	(Low current type) 2-position, dduid solchod specific (Low current type) 3-position, closed ce																					+
	(Low current type) 3-position, exhaust cer																					+
	(Low current type) 3-position, pressure co																					+
	Low current type) 3-position, pressure ca																					+
					<u> </u>		-															+
	ote9 (Low current type) Tandem 3-port (NO and																					+
	pte9 (Low current type) Tandem 3-port (NC and	(UVI																				+
	Block-off plate	3																				+
Manual ov	rerride (-R) Manual override lever ^{Not}	=0																			<u> </u>	+
	FJ With dual use fitting block																					+
	FJ5 With single use fitting block																					_
	FJ6 With single use fitting block	< (+
	FM With female thread block																					
	FJ5A With single use fitting block, 3-port normally close	1 /																				
Valve	FJ5B With single use fitting block, 3-port normally oper	(NO)																				
outlet	FJ6A With single use fitting block, 3-port normally close	I (NC)																				
type ^{Note4}	FJ6B With single use fitting block, 3-port normally oper	(NO)																				
	FMA With female thread block, 3-port normally close	d (NC)																				
	FMB With female thread block, 3-port normally oper	(NO)																				T
	FMH With female thread block																					T
	FMAH With female thread block, 3-port normally close	d (NC)																				T
	FMBH With female thread block, 3-port normally oper	. ,																				t
	J5 With single use fitting block	1 /																				t
	J6 With single use fitting block																					t
	M With female thread block																					t
	J5A With single use fitting block, 3-port normally close	I (NC)																				t
Manifold fitting	J5B With single use fitting block, 3-port normally oper																					+
specification ^{Note5}	J6A With single use fitting block, 3-port normally close																					+
(Manifold side	J6B With single use fitting block, 3-port normally oper	. /																				+
outlet port)	MA With female thread block, 3-port normally close																					+
outorporty	MB With female thread block, 3-port normally oper																					+
		(INO)																				+
																						┿
	MAH With female thread block, 3-port normally close																					+
EeNote10	MBH With female thread block, 3-port normally oper	(NU)																				+
	Back pressure prevention valve	E40		-		<u> </u>	-		-			-										+
	dividual air supply spacer (with M5 female thread for	,																			<u> </u>	+
	ndividual air supply spacer (with ϕ 6 fitting for										-										<u> </u>	4
	dividual air supply spacer (with ϕ 8 fitting for																				<u> </u>	\downarrow
	dividual exhaust spacer (with M5 female thread for																					
NR6 Ir	ndividual exhaust spacer (with ϕ 6 fitting for	F15)																				
	ndividual exhaust spacer (with ϕ 8 fitting for	F15)																				
	or (-SP) For 1(P) port ^{Note8}																					
	or (-SR) For 3(R2), 5(R1) portsNote8											1										T

Notes:1. Cannot be mounted on the external pilot manifold. 2. Cannot be mounted on the internal pilot manifold.

3. To designate a manual override lever, enter () in the manual override boxes of the designated stations in the above table.

4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter 🔿 in the valve outlet type boxes of the above table.

The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**. 5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter \bigcirc in the manifold fitting specification boxes of the above table.

The 3-port specifications are only available in valve specifications T0, T1, and T2.

6. When mounting the individual air supply or exhaust spacer, enter () in the spacer boxes of the desigated stations in the above table.
 7. To designate a port isolator, enter () in one box of the designated stations in the above table.
 8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA,


or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller stn. No.).

9. Not availabale in external pilot type.
10. When mounting the back pressure prevention valve , enter () in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer.

11. Not available in low-current type.

12. Not available in low-current type and tandem 3-port valves.

Quantity set Delivery

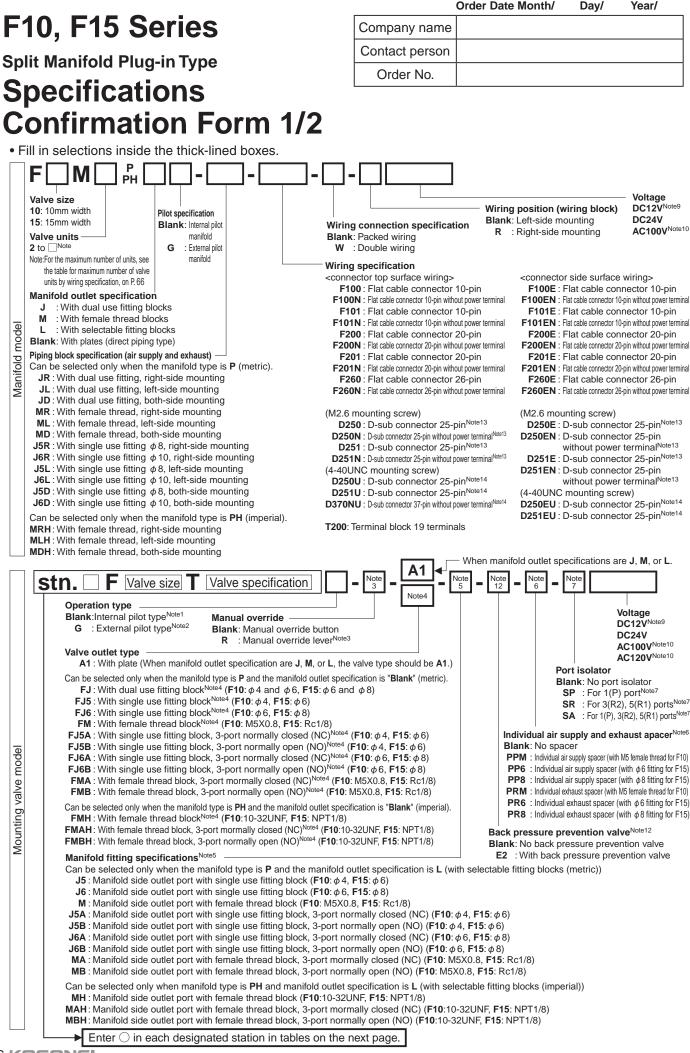

F10, F15 Series

Split Manifold Plug-in Type **Specifications Confirmation Form 2/2**

	ecifying the valve and block-off p	late	o be	mοι	intec	l at e	ach	stati	on, e	enter	\bigcirc ir	n ead	h ap	plica	able	box ł	oelov	v.			
Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F 🗌 T0	2-position, for single solenoid only																				
F 🗆 T1	2-position, single solenoid specification																				
F 🗌 T2	2-position, double solenoid specification																				
F 🗌 T3	3-position, closed center																				
F 🗆 T4	3-position, exhaust center																				
F 🗌 T5	3-position, pressure center																				
F 🗌 TA ^N																					
F 🗌 TB ^N																					
F 🗌 LTO																					
F 🗌 LT1	(Low current type) 2-position, single solenoid specification																				
F 🗌 LT2																					
F 🗌 LT3																					
F 🗌 LT4																					
F 🗌 LT5																					
	Note11 (Low current type) Tandem 3-port (NC and NC)	ļ													L						
	Note11 (Low current type) Tandem 3-port (NO and NO)																				
	Note11 (Low current type) Tandem 3-port (NC and NO)		ļ																		
F 🗌 BPF		ļ																			
Manual of	override (-R) Manual override lever ^{Note3}		<u> </u>			L				L	L			L							
	FJ With dual use fitting block																				
	FJ5 With single use fitting block																				
	FJ6 With single use fitting block																				
	FM With female thread block																				
	FJ5A With single use fitting block, 3-port normally closed (NC)																				
≚ Valve	FJ5B With single use fitting block, 3-port normally open (NO)																				
	FJ6A With single use fitting block, 3-port normally closed (NC)																				
type ^{Note4}	FJ6B With single use fitting block, 3-port normally open (NO)																				
Valve outlet type ^{Note4}	FMA With female thread block, 3-port normally closed (NC)																				
8	FMB With female thread block, 3-port normally open (NO)																				
≥	FMH With female thread block																				
	FMAH With female thread block, 3-port normally closed (NC)																				
	FMBH With female thread block, 3-port normally open (NO)																				
	J5 With single use fitting block																				
	J6 With single use fitting block		<u> </u>																		
	M With female thread block		ļ																		
	J5A With single use fitting block, 3-port normally closed (NC)																				
Manifold fitting	J5B With single use fitting block, 3-port normally open (NO)																				
specification ^{Not}																					
(Manifold side	J6B With single use fitting block, 3-port normally open (NO)		<u> </u>																		
outlet port)	MA With female thread block, 3-port normally closed (NC)					<u> </u>								<u> </u>							<u> </u>
	MB With female thread block, 3-port normally open (NO)		-																		
	MH With female thread block										-				-						
	MAH With female thread block, 3-port normally closed (NC)					<u> </u>								<u> </u>							
FeNote12	MBH With female thread block, 3-port normally open (NO)																				
	Back pressure prevention valve																				
PPM	Individual air supply spacer (with M5 female thread for F10)																				
PP6	Individual air supply spacer (with ϕ 6 fitting for F15)																				
	Individual air supply spacer (with ϕ 8 fitting for F15)																				
PRM	Individual exhaust spacer (with M5 female thread for F10)																				
	Individual exhaust spacer (with ϕ 6 fitting for F15)																				
	Individual exhaust spacer (with ϕ 8 fitting for F15)																				
	ator (-SP) For 1(P) port ^{Note8}																				
	ator (-SR) For $3(R2)$, $5(R1)$ ports ^{Note8}																				
Port Isola	tor (-SA) For 1(P), 3(R2), 5(R1) ports ^{Note8}														1						

Notes:1. Cannot be mounted on the external pilot manifold.

2. Cannot be mounted on the internal pilot manifold.

3. To designate a manual override lever, enter () in the manual override boxes of the designated stations in the above table.

4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter \bigcirc in the valve outlet type boxes of the above table.

The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**. 5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter \bigcirc in the manifold fitting specification boxes of the above table. The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**.

6. When mounting the individual air supply or exhaust spacer, enter \bigcirc in the spacer boxes of the desigated stations in the above table.

To designate a port isolator, enter O in one port isolator box of the designated stations in the above table.

8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller stn. No.).
 9. Not available in low-current type.


10. AC100V and AC120V can only be used when wiring specifications are -D250 , -D251 (D-sub connector), or -T200 (terminal). In addition, not available in low-current type and tandem 3-port valves

Not availabale in external pilot type.
 When mounting the back pressure prevention valve, enter () in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer.

13. Can be selected only when the manifold type is P

14. Can be selected only when the manifold type is PH.

Quantity set Delivery

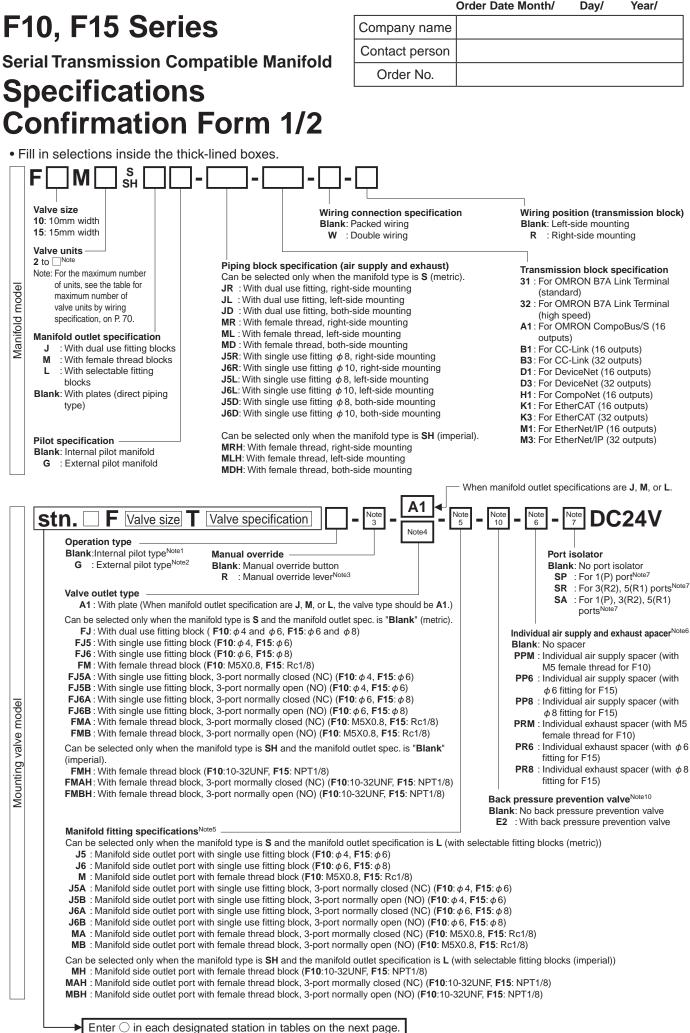

F10, F15 Series

Serial Transmission Compatible Manifold Specifications Confirmation Form 2/2

Mounting	ecifying the valve and blove valve, block-off plate	Station	1	2	3	4	5	6	7	8	9	11	-	13		15		17	18	19	
F 🗌 TO	2-position, for single solen									-	-					-	-			-	t
F 🗌 T1	2-position, single solenoid sp	-																			+
F 🗌 T2	2-position, double solenoid sp																				+
F 🗌 T3	3-position, closed center	comotion																			╈
F 🗌 T4	3-position, exhaust center																				+
F 🗌 T5	3-position, pressure center																				+
	¹⁶⁹ Tandem 3-port (NC and N	2)																			╈
	^{te9} Tandem 3-port (NO and N	0) 0)																			╀
	^{te9} Tandem 3-port (NC and N																				+
																					+
	(Low current type) 2-position, for single																				+
	(Low current type) 2-position, single solen																				+
	(Low current type) 2-position, double solen																				+
F 🗌 LT3	(Low current type) 3-position, close																				+
F 🗌 LT4	(Low current type) 3-position, exh																				╀
F 🗌 LT5	(Low current type) 3-position, pres																				∔
	(Low current type) Tandem 3-port (I	,																			+
F 🗌 LTB	(Low current type) Tandem 3-port (,														L					+
	(Low current type) Tandem 3-port (NC and NO)																			+
F 🗌 BPP	Block-off plate	Nucl																			+
Manual ov	verride (-R) Manual override le																				4
	FJ With dual use fitting																				
	FJ5 With single use fitting	5																			
	FJ6 With single use fitting	5																			
	FM With female thread b	lock																			
	FJ5A With single use fitting block, 3-port not	rmally closed (NC)																			
Valve	FJ5B With single use fitting block, 3-port no	rmally open (NO)																			
outlet	FJ6A With single use fitting block, 3-port not	rmally closed (NC)																			
type ^{Note4}	FJ6B With single use fitting block, 3-port no	rmally open (NO)																			
	FMA With female thread block, 3-port nor	mally closed (NC)																			T
	FMB With female thread block, 3-port no	rmally open (NO)																			Τ
	FMH With female thread b	lock																			Ť
	FMAH With female thread block, 3-port nor	mally closed (NC)																			t
	FMBH With female thread block, 3-port no	rmally open (NO)																			t
	J5 With single use fitting																				t
	J6 With single use fitting	-																			t
	M With female thread b	5																			t
	J5A With single use fitting block, 3-port not																				t
Manifold fitting	J5B With single use fitting block, 3-port no																				t
specification ^{Note5}	J6A With single use fitting block, 3-port not																				t
(Manifold side	J6B With single use fitting block, 3-port not																				t
outlet port)	MA With female thread block, 3-port nor																				+
	MB With female thread block, 3-port no																				+
	MH With female thread b																				+
	MAH With female thread block, 3-port nor																				+
	MBH With female thread block, 3-port not																				+
E2Note10 E																					$\frac{1}{2}$
	Back pressure prevention valv																				+
	ndividual air supply spacer (with M5 female t	,																			+
	ndividual air supply spacer (with ϕ 6 fi	,																			4
	ndividual air supply spacer (with ϕ 8 fi	· /																			\downarrow
	ndividual exhaust spacer (with M5 female	,														L					4
	ndividual exhaust spacer (with ϕ 6 fi																				4
	ndividual exhaust spacer (with ϕ 8 final sp	tting for F15)											<u> </u>		<u> </u>						4
	or (-SP) For 1(P) port ^{Note8}	N														L	L				1
	or (-SR) For 3(R2), 5(R1) por	tsNote8									1						1	1			

Notes:1. Cannot be mounted on the external pilot manifold. 2. Cannot be mounted on the internal pilot manifold.

3. To designate a manual override lever, enter () in the manual override boxes of the designated stations in the above table.

4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter 🔿 in the valve outlet type boxes of the above table.

The 3-port specifications are only available in valve specifications **T0**, **T1**, and **T2**. 5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter \bigcirc in the manifold fitting specification boxes of the above table.

The 3-port specifications are only available in valve specifications T0, T1, and T2.

6. When mounting the individual air supply or exhaust spacer, enter () in the spacer boxes of the designated stations in the above table.
 7. To designate a port isolator, enter () in one port isolator box of the designated stations in the above table.
 8. Port isolators can be installed only when piping blocks are installed on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA,

or 1 each port isolator for -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller stn. No.).

9. Not availabale in external pilot type.
10. When mounting the back pressure prevention valve , enter () in the back pressure prevention valve boxes of the designated stations in the above table. Not available with the individual exhaust spacer.

Quantity	set	Delivery
----------	-----	----------

Company name Contact person

Order No.

Year/

Monoblock Manifold

A Type (Base Piping Type)

Specifications Confirmation Form

• Fill in selections inside the thick-lined boxes.

Manifold model		M A AH Valve units 2 to 20	J :\ M :\ L :\	Vith d Vith fe Vith s	lual u: emale electa	t spe se fitt threa able fi	ing blo ad blo tting l	ocks icks blocks				Bla G	nk:lr	xterna	l pilot al pilo	t man		_					
	Blank G V Wirin	ation type t: Internal pilot type ^b : External pilot type pressure) ^{Note2} : External pilot type g specification	(for positive (for vacuum) ^{Note2}		n	В	anua lank: R :	l over Manu Manua	rride Ial ove	1 -	outtor er ^{Note3}	n 3]-	Note 4	- []	ote 5	AC1	2V 4V 00V ^{No}					
Mounting valve model	Blank PN PS PL3 CPS CPS CPL3 39L 39N	 c: L type plug conne : S type plug conne : S type plug conne : S type plug conne : L type plug conne : S type plug conne : L type plug conne : Pre-wired positive wire length 300mr : DIN connector type : DIN connector type 	common terminal L n [11.8in.] common terminal S nm [118in.] common terminal L nm [118in.]	ttor h 300 h 300 h 300 type type type type	omm ()0mm 00mm plug o plug o plug o	11.8ir [118 [118 conne conne conne	n.] n.] ector, l ector, l ector, l	Lead Lead Lead	ach	Can I speci J5 : J6 : Can I outle MH :	be se ificati Mani Mani be se t spe Mani	fitting elected on is l ifold s ifold s elected cificat ifold s	J spe d only L (witi ide ou ide ou d only ion is ide ou	Bland NP8 NP0 NR8 NR0 cifica wher h sele utlet p utlet p wher L (win utlet p	k: Wit : Ind : Ind : Ind : Ind : Ind tions the r ctable ort wi ort wi th sele ort wi	hout s ividua ividua ividua ividua note4 manife e fittin th sin th sin manife ectab th NP	space al air s al air s al exh al exh	$\frac{1}{2}$	A and hetric) fittin A and hetric) fittin AH ar bocks (i e thre	er (w er (with r (with the r)) g bloo ng blo ng blo ng blo ng blo ng blo ng blo ng blo ng blo	ck ock • mani ial))	8 fittin 10 fitt fitting) fitting	ing)) g)
unt		valve, block-off plate		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
Σ	F18T0	2-position, for sing			-	-		-	-		-	-	-		_	-	· ·	-	-	-	-	-	
	F18T1		olenoid specification									1											$\left - \right $
	F18T2											-											$\left - \right $
			olenoid specification									-											$\left - \right $
	F18T3	3-position, closed										-											$\left - \right $
	F18T4 ^{Note6}	- p																					$\left - \right $
	F18T5 ^{Note6}	3-position, pressu	ire center																				
	F18BP	Block-off plate																					
	Manual	R Manual overr	ide lever ^{Note3}	7																			
	override	83 Protruding lo	cking type ^{Note7}																				
	Manifold fitting		se fitting block																				
	specification ^{Note4}		se fitting block																				
	(Manifold side	MH With female t	-									-											$\left - \right $
	outlet port)																						$\left - \right $
		idual air supply spac	,														<u> </u>						\mid
	NP0 Indiv	idual air supply space	er (with ϕ 10 fitting)														<u> </u>						
	NR8 Indiv	idual exhaust space	er (with ϕ 8 fitting)																				
	NR0 Indiv	idual exhaust space	er (with ϕ 10 fitting)																				
		annot be mounted or annot be mounted or	n the external pilot m									·											

3. To designate a manual override lever, enter O in the manual override boxes of the designated station in the above table.

4. When the manifold outlet specifications are L (with selectable fitting), select fitting specification for each station, and enter \bigcirc in the manifold fitting specification boxes of the above table.
5. When mounting the individual air supply or exhaust spacer, enter
in the spacer boxes of the designated stations in the above table.
6. Not available with vacuum valves.
7. Only for wiring specification -39
.

8. Not available for valve specification T1. In addition, the valve is used only as a double solenoid for T2.

9. Not available with DIN connectors (-39.).

Quantity	set Delivery	
----------	--------------	--

Company name Contact person

Order No.

Year/

Monoblock Manifold

F Type (Direct Piping Type)

Specifications Confirmation Form

• Fill in selections inside the thick-lined boxes.

Manifold model	F18	M F FH Valve units 2 to 20																				
	stn.	F18T Valve specific	atio	n	No 1	te	Note 2	L_[ote 3										
						_					- L											
	Bland R 83 Valve Can b FJ	al override κ: Manual override button : Manual override lever ^{Note1} : Protruding locking type ^{Note4} coutlet type ^{Note2} be selected only when the manifold type With dual use φ 8 and φ 10 fitting block With single use φ 8 fitting block		metric	;).					E	Blank	dual a	air su	AC12 AC24 pply	V V OV ^{Noti} OV OV ^{Noti} and e	e4 exhau						
		With single use ϕ 10 fitting block With Rc1/4 female thread block										: Indiv : Indiv										
		With RC1/4 lemale thread block										: Indiv								g)		
		be selected only when the manifold type With NPT1/4 female thread block	is FH	(impe	erial).						NR0	: Indiv	vidual	exha	ust sp	bacer	(with	φ10	fitting)		
Mounting valve model	♥ ※For spe	ecifying the valve and block-off pl		PN : PL : PS3 : PL3 : CPS : CPS : CPL : CPS : CPL : 39L : 39N :	S typ S typ L typ S typ Pre- Pre- DIN DIN	e plu e plu e plu e plu wired wired wired wired conne	g conr g conr g conr g conr g conr g conr positiv positiv positiv ector tr ector tr	necto necto necto necto ve co ve co ve co ve co ype v ype v	r, Witł r, Lea r, Lea r, Lea mmor mmor mmor mmor vith ind vith ou	hout o d wind d wind d wind d wind t term h term h term dicato t indic	conne e leng e leng e leng ninal l ninal l ninal l ninal l cator ^h	ector gth 30 gth 30 gth 30 gth 30 S type L type S type L type Note5	0mm 00mr 00mn plug plug plug plug	[11.8i n [118 n [118 conn conn conn conn	n.] Bin.] ector, ector, ector, ector,	Lead Lead Lead	wire wire wire	length length length	1 300i 1 300 1 300	mm [1 0mm	1.8in [118ir	.] n.]
Mol	Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
	F18T0 2	-position, for single solenoid only									1											
	F18T1 2	-position, single solenoid specification																				
	F18T2 2	-position, double solenoid specification																				
	F18T3 3	-position, closed center																				
	F18T4 3	-position, exhaust center																				
	F18T5 3	-position, pressure center																				
	F18BP E	Block-off plate																				
	Manual	R Manual override lever ^{Note1}																				
	override	83 Protruding locking type ^{Note4}																				
		FJ With dual use fitting block																				
	Valve	FJ5 With single use fitting block																				
	outlet	FJ6 With single use fitting block																				
	type ^{Note2}	FM With female thread block																				
		FMH With female thread block																				
	NP8 Indiv	vidual air supply spacer (with ϕ 8 fitting)																				
	NP0 Indiv	ridual air supply spacer (with ϕ 10 fitting)																				
	NR8 Indiv	vidual exhaust spacer (with ϕ 8 fitting)																				
	NR0 Indiv	vidual exhaust spacer (with ϕ 10 fitting)																				
	Notes:1. To	designate a manual override lever, ente	er () i	n the	manu	al ov	erride	boxe	s of th	ne de	signa	ted st	ation	in the	abov	e tabl	e.					

Select valve outlet type for each station, and enter O in the valve outlet type boxes of the above table.
 When mounting the individual air supply or exhaust spacer, enter O in the spacer boxes of the designated stations in the above table.
 Only for wiring specification -39[.


Not available for valve specification T1. In addition, the valve is used only as a double solenoid for T2.
 Not available with DIN connectors (-39]).

Quantity	set	Delivery
Quantity	001	Donvory

Split Manifold Non-Plug-in Type

Specifications Confirmation Form 1/2

• Fill in selections inside the thick-lined boxes.

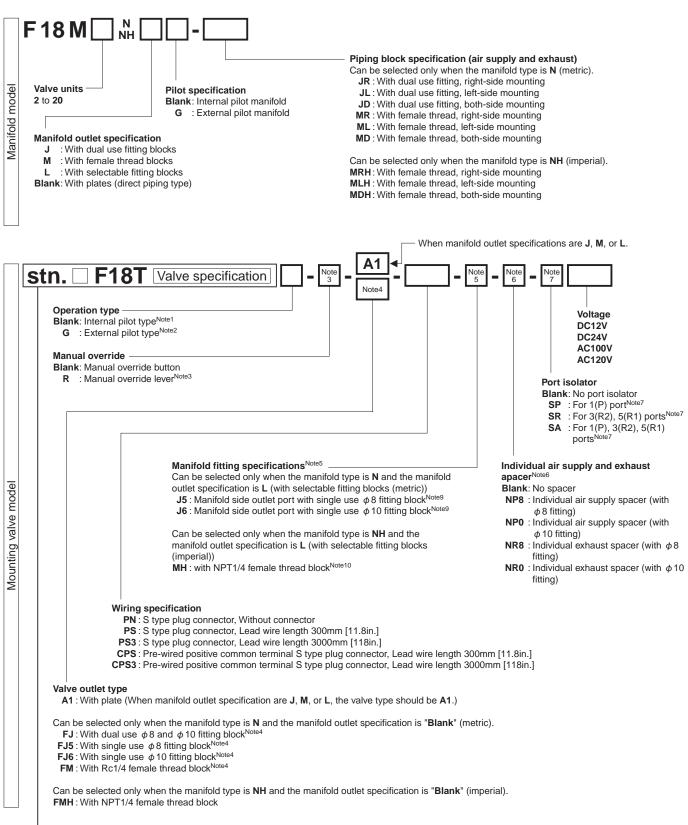

Enter \bigcirc in each designated station in tables on the next page.

Company name Contact person

Order No.

Year/

Split Manifold Non-Plug-in Type **Specifications Confirmation Form 2/2**

Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F18T0	2-position, for single solenoid only																				
F18T1	2-position, single solenoid specification																				
F18T2	2-position, double solenoid specification																				
F18T3	3-position, closed center																				
F18T4	3-position, exhaust center																				
F18T5	3-position, pressure center																				
F18BPN	Block-off plate																				
Manual ov	verride (-R) Manual override lever ^{Note3}																				
	FJ With dual use fitting block																				
Valve	FJ5 With single use fitting block																				
outlet	FJ6 With single use fitting block																				
type ^{Note4}	FM With female thread block																				
	FMH With female thread block																				
Manifold fitting	J5 With single use fitting block																				
specification ^{Note5} (Manifold side	J6 With single use fitting block																				
outlet port)	MH With female thread block																				
NP8 Indiv	vidual air supply spacer (with ϕ 8 fitting)																				
NP0 Indiv	ridual air supply spacer (with ϕ 10 fitting)																				
NR8 Indiv	vidual exhaust spacer (with ϕ 8 fitting)																				
NR0 Indiv	vidual exhaust spacer (with ϕ 10 fitting)																				
Port isolat	or (-SP) For 1(P) port ^{Note8}																				
Port isolat	or (-SR) For 3(R2), 5(R1) ports ^{Note8}																				
Port isolate	or (-SA) For 1(P), 3(R2), 5(R1) ports ^{Note8}																				

Notes:1. Cannot be mounted on the external pilot manifold.

Cannot be mounted on the internal pilot manifold.
 To designate a manual override lever, enter O in the manual override boxes of the designated stations in the above table.

4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter O in the valve outlet type boxes of the above


4. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter ○ in the manifold fitting specification boxes of the above table.
5. When mounting the individual air supply or exhaust spacer, enter ○ in the one spacer box of the desigated stations in the above table.
6. When mounting the individual air supply or exhaust spacer, enter ○ in the one spacer box of the desigated stations in the above table.
7. To designate a port isolator box of the designated station, enter ○ in the port isolator box in the above table.
9. Dort isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA,

8. Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator dor -SP and -SR for a total of 2 locations.

When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn. No.).

Quantity	set	Delivery
----------	-----	----------

Year/

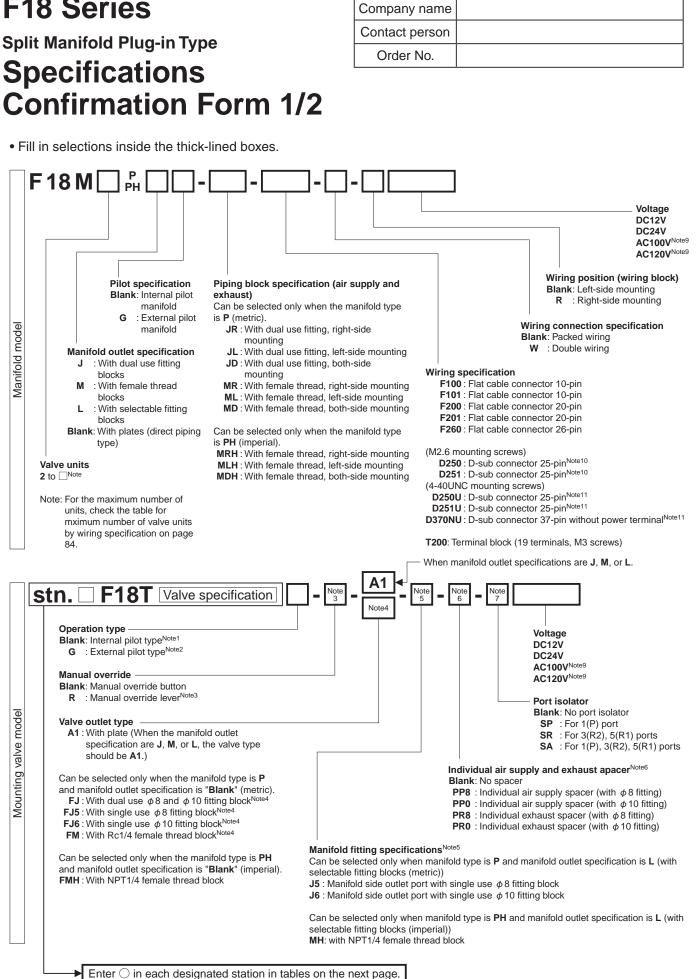

Split Manifold Plug-in Type **Specifications Confirmation Form 2/2**

Mounting	valve, block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F18T0	2-position, for single solenoid only																				
F18T1	2-position, single solenoid specification																				
F18T2	2-position, double solenoid specification																				
F18T3	3-position, closed center																				
F18T4	3-position, exhaust center																				
F18T5	3-position, pressure center																				
F18BPP	Block-off plate																				
Manual ov	verride (-R) Manual override lever ^{Note3}																				
	FJ With dual use fitting block																				
Valve	FJ5 With single use fitting block																				
Valve outlet type ^{Note4}	FJ6 With single use fitting block																				
type ^{Note4}	FM With female thread block																				
	FMH With female thread block																				
Manifold fitting	J5 With single use fitting block																				
specification ^{Note5} (Manifold side	J6 With single use fitting block																				
outlet port)	MH With female thread block																				
PP8 Indiv	vidual air supply spacer (with ϕ 8 fitting)																				
PP0 Indiv	vidual air supply spacer (with ϕ 10 fitting)																				
PR8 Indiv	vidual exhaust spacer (with ϕ 8 fitting)																				
PR0 Indiv	vidual exhaust spacer (with ϕ 10 fitting)																				
Port isolat	or (-SP) For 1(P) port ^{Note8}																				
Port isolat	or (-SR) For 3(R2), 5(R1) ports ^{Note8}																				
Port isolate	or (-SA) For 1(P), 3(R2), 5(R1) ports ^{Note8}																				

Notes:1. Cannot be mounted on the external pilot manifold.

Cannot be mounted on the internal pilot manifold.
 To designate a manual override lever, enter O in the manual override boxes of the designated stations in the above table.

4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter O in the valve outlet type boxes of the above table.

When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter O in the manifold fitting specification boxes of the above table.

6. When mounting the individual air supply or exhaust spacer, enter \bigcirc in the spacer boxes of the designated stations in the above table. 7. To designate a port isolator box of the designated station, enter \bigcirc in the port isolator box in the above table.

 Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator dor -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are installed between the designated station and the station to its immediate left (the next smaller stn. No.).

9. AC100V and AC120V can only be used when wiring specifications are **-D250**, **-D251** (D-sub connector), or **-T200** (terminal).


10. Can be selected only when the manifold type is **P**. 11. Can be selected only when the manifold type is **PH**.

Delivery Quantity set

Serial Transmission Compatible Manifold

Specifications Confirmation Form 1/2

• Fill in selections inside the thick-lined boxes.

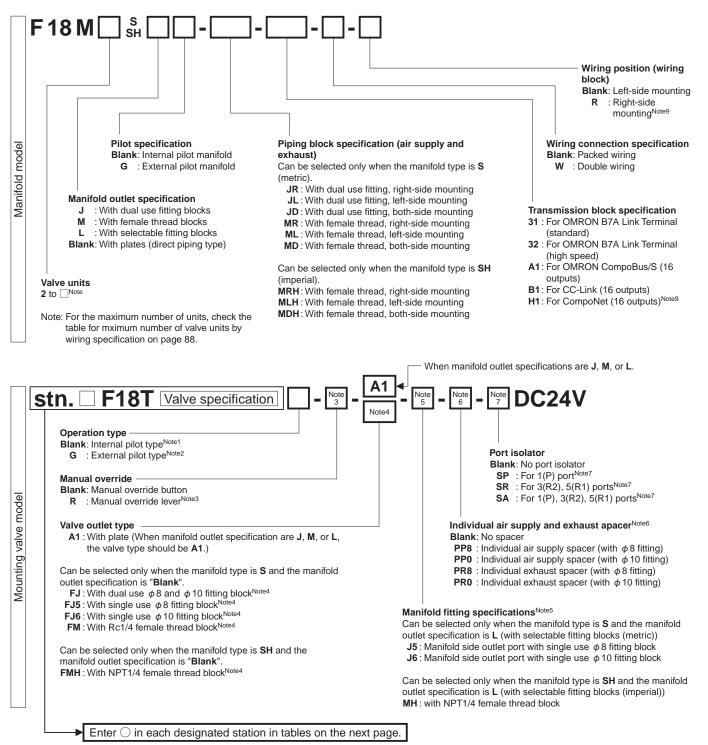

226 KOGANEI

Serial Transmission Compatible Manifold Specifications Confirmation Form 2/2

Mounting	valve,	block-off plate Station	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
F18T0	2-po	sition, for single solenoid only																				
F18T1	2-po	sition, single solenoid specification																				
F18T2	2-po	sition, double solenoid specification																				
F18T3	3-ро	sition, closed center																				
F18T4	3-ро	sition, exhaust center																				
F18T5	3-ро	sition, pressure center																				
F18BPP	Bloc	k-off plate																				
Manual ov	/erride	e (-R) Manual override lever ^{Note3}																				
Manual ov	FJ	With dual use fitting block																				
Valve	FJ5	With single use fitting block																				
outlet	FJ6	With single use fitting block																				
type ^{Note4}	FM	With female thread block																				
	FMH	With female thread block																				
Manifold fitting	J5	With single use fitting block																				
specification ^{Note5} (Manifold side	J6	With single use fitting block																				
outlet port)	MH	With female thread block																				
PP8 Indi	/idual	air supply spacer (with ϕ 8 fitting)																				
PP0 Indi	/idual a	air supply spacer (with ϕ 10 fitting)																				
PR8 Indi	vidual	exhaust spacer (with ϕ 8 fitting)																				
PR0 Indi	vidual	exhaust spacer (with ϕ 10 fitting)																				
Port isola	or (-S	P) For 1(P) port ^{Note8}																				
Port isola	or (-S	R) For 3(R2), 5(R1) ports ^{Note8}																				
Port isolat	or (-S /	A) For 1(P), 3(R2), 5(R1) ports ^{Note8}																				

Notes:1. Cannot be mounted on the external pilot manifold.

Cannot be mounted on the internal pilot manifold.
 To designate a manual override lever, enter O in the manual override boxes of the designated stations in the above table.

4. When the manifold outlet specifications are "Blank", select fitting specification for each station, and enter O in the valve outlet type boxes of the above

table.
5. When the manifold outlet specifications are L (with selectable fitting), select manifold fitting specification for each station, and enter ○ in the manifold fitting specification boxes of the above table.

6. When mounting the individual air supply or exhaust spacer, enter \bigcirc in the spacer boxes of the designated stations in the above table. 7. To designate a port isolator box of the designated station, enter \bigcirc in the port isolator box in the above table.

 Port isolators can be installed only when piping blocks are mounted on both sides. In addition, only 1 port isolator can be mounted in 1 manifold for -SA, or 1 each port isolator dor -SP and -SR for a total of 2 locations. When shipping, the designated port isolators are mounted between the designated station and the station to its immediate left (the next smaller stn.

No.). 9. The -H1 (for CompoNet (16 outputs)) transmission block is mountable on the left side only.

Quantity	set	Delivery
----------	-----	----------

WEWO

Limited Warranty • KOGANEI CORP. shall in no way be liable or responsible for KOGANEI CORP. warrants its products to be free from defects in material and workmanship subject to the following provisions. injuries or damage to persons or property arising out of the use or operation of the manufacturer's product. Warranty Period The warranty period is 180 days from the date • This warranty shall be void if the engineered safety devices of delivery. are removed, made inoperative or not periodically checked for If a defect in material or workmanship is found Koganei proper functioning. Responsibility during the warranty period, KOGANEI CORP. • Any operation beyond the rated capacity, any improper use or will replace any part proved defective under normal use free of charge and will provide the application, or any improper installation of the product, or any substitution upon it with parts not furnished or approved by service necessary to replace such a part. KOGANEI CORP., shall void this warranty. Limitations This warranty is in lieu of all other warranties, • This warranty covers only such items supplied by KOGANEI expressed or implied, and is limited to the original cost of the product and shall not CORP. The products of other manufacturers are covered only by include any transportation fee, the cost of such warranties made by those original manufacturers, even installation or any liability for direct, indirect though such items may have been included as the components. or consequential damage or delay resulting from the defects. The specifications are subject to change without notice.

URL http://www.koganei.co.jp

E-mail: overseas@koganei.co.jp

KOGANEI CORPORATION

OVERSEAS DEPARTMENT 3-11-28, Midori-cho, Koganei City, Tokyo 184-8533, Japan Tel: 81-42-383-7271 Fax: 81-42-383-7276

KOGANEI INTERNATIONAL AMERICA, INC.

39300 Civic Center Dr., Suite 280, Fremont, CA 94538, U.S.A. Tel : 1-510-744-1626 Fax : 1-510-744-1676

SHANGHAI KOGANEI INTERNATIONAL TRADING CORPORATION Room 2606-2607, Tongda Venture Building No.1, Lane 600, Tianshan Road, Shanghai, 200051, China

Tel: 86-21-6145-7313 Fax: 86-21-6145-7323

TAIWAN KOGANEI TRADING CO., LTD.

Rm. 2, 13F., No88, Sec. 2, Zhongxiao E. Rd., Zhongzheng Dist., Taipei City 100, Taiwan (ROC) Tel: 886-2-2393-2717 Fax: 886-2-2393-2719

KOGANEI KOREA CO., LTD.

6F-601, Tower Bldg., 1005, Yeongdeo-dong, Giheung-gu, Yongin-si, Gyeonggi-do, 446-908, Korea Tel: 82-31-246-0414 Fax: 82-31-246-0415

KOGANEI (THAILAND) CO., LTD.

3300/90, Tower B, Elephant Tower,16th Fl., Phaholyothin Road, Chomphon, Chatuchak, Bangkok 10900, Thailand Tel: 66-2-937-4250 Fax: 66-2-937-4254

KOGANEI ASIA PTE. LTD.

69 Ubi Road 1, #05-18 Oxley Bizhub, Singapore 408731 Tel: 65-6293-4512 Fax: 65-6293-4513

KOGONEI

KOGANEI

No.BK-P033




http://www.koganei.co.jp




F10 & F15 series solenoid valves

IP specifications

IP65 compliant protective construction can be used in a wide range of operating environments!

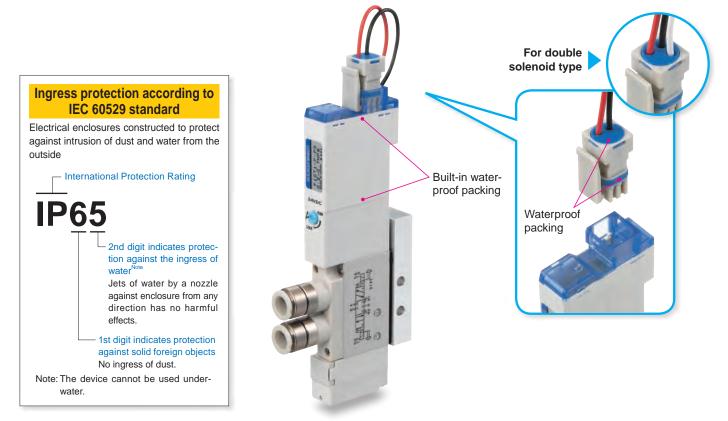


Variations

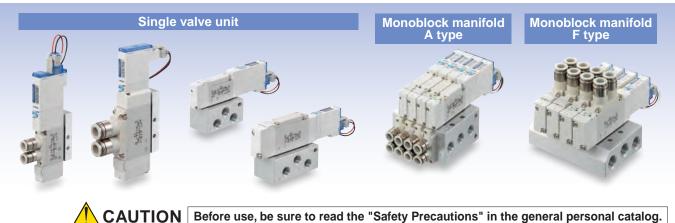

*Consult the nearest Koganei sales office for use in locations or environments subject to liquids other than water, such as organic solvents, cutting oil, or chemicals.


F10, F15 Series Single Valve Unit Order Codes

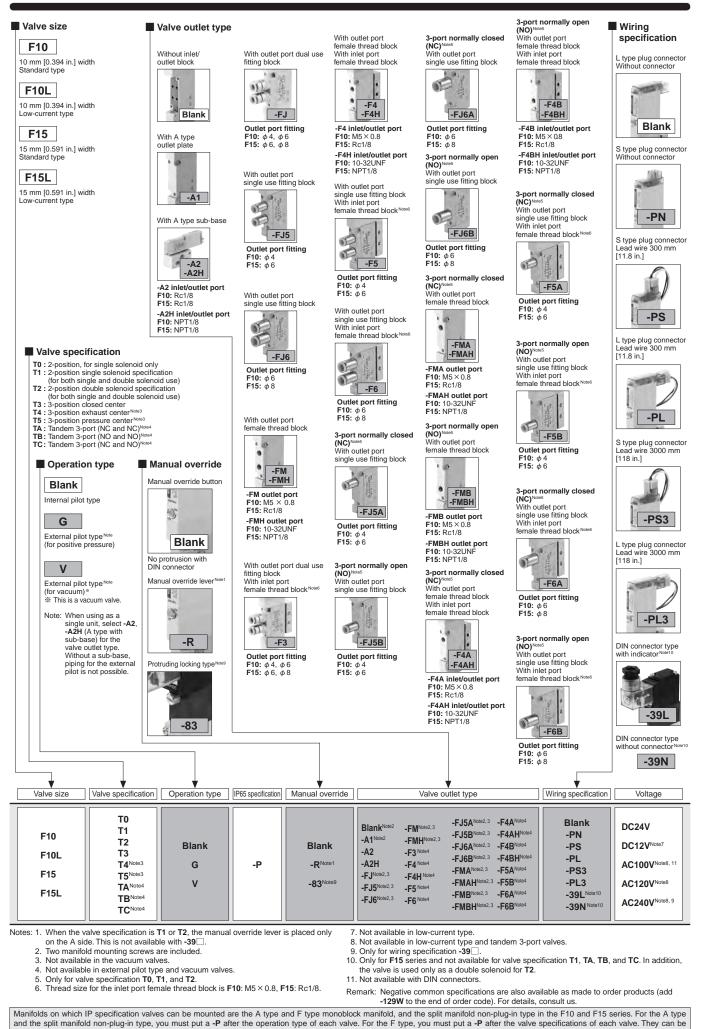

KOGANEI

combined only with IP specification valves. See the F series solenoid valve catalog for details about the manifold order code

1

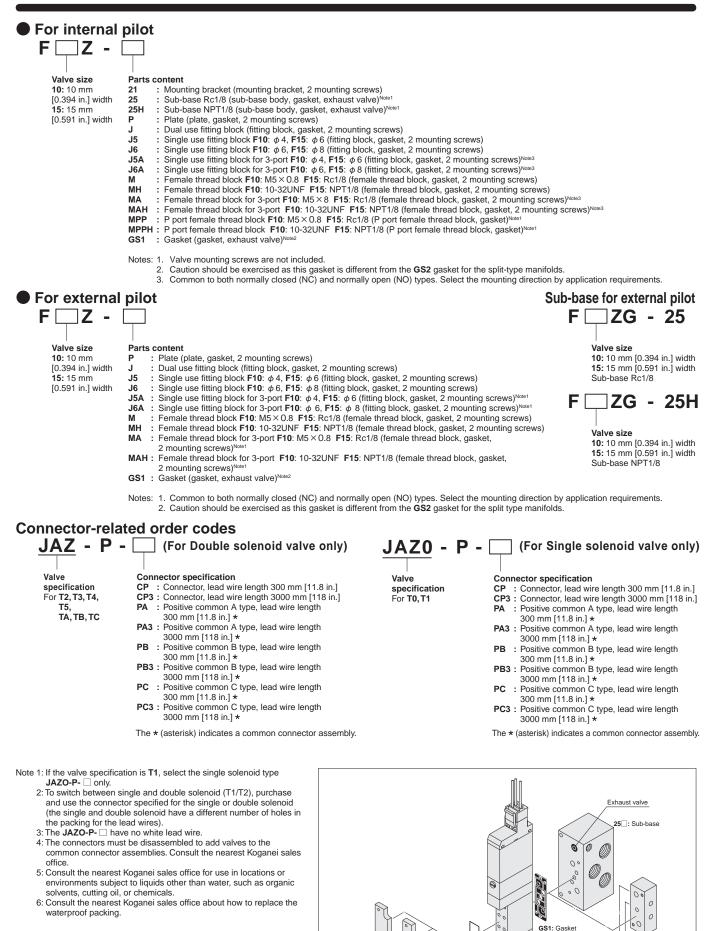

P. Plate

M: Female thread block

MA : Female thread block

J, J5, J6: Fitting block

6

J5A, J6A: Fitting block


MP : P port female thread block

21: Mounting bracke

a

a

è

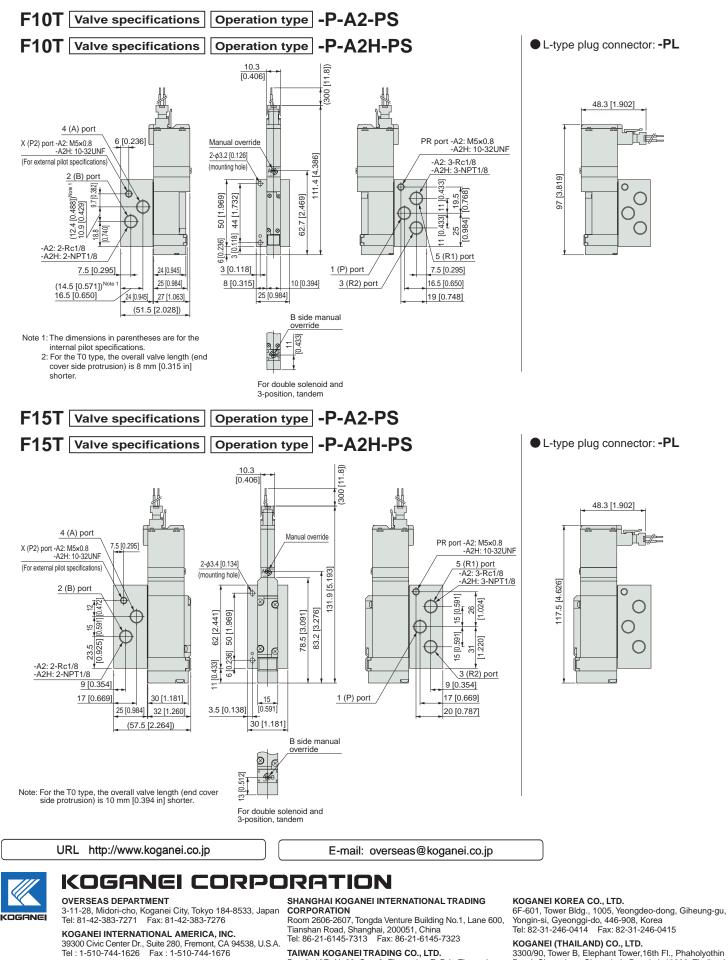

TAIWAN KOGANEI TRADING CO., LTD. Rm. 2, 13F., No88, Sec. 2, Zhongxiao E. Rd., Zhongzheng Dist., Taipei City 100, Taiwan (ROC) Tel: 886-2-2393-2717 Fax: 886-2-2393-2719

5/'15 AB ©KOGANEI CORP. PRINTED IN JAPAN KOGANEI ASIA PTE. LTD. 69 Ubi Road 1, #05-18 Oxley Bizhub, Singapore 408731 Tel: 65-6293-4512 Fax: 65-6293-4513

Road, Chomphon, Chatuchak, Bangkok 10900, Thailand Tel: 66-2-937-4250 Fax: 66-2-937-4254